



**City of Tampa**  
*Jane Castor, Mayor*

**Contract Administration**  
**Richard Mutterback, Director**  
306 East Jackson Street, 4N  
Tampa, FL 33602  
Office (813) 274-8116  
Fax: (813) 274-7368

**ADDENDUM 1**  
**Via E-Mail**  
**DATE: August 2, 2024**

**Contract: 22-C-00027; W. Cleveland Street at Rome Avenue Traffic Signal - FDOT LAP Rebid**

Bidders on the above referenced project are hereby notified that the following addendum is made to the Contract Documents. BIDS TO BE SUBMITTED SHALL CONFORM TO THIS NOTICE.

Item 1- Bid Opening Date is hereby changed to Tuesday, August 20<sup>th</sup>, 2024

Item 2- Replace Division I specs (43 - 58) with included file: LADIV1-CLASS D-724 REV01

Item 3- Replace Division II specs (122-157) with the included file: 44377125801-SPECS-REV01

Item 4- Replace the key sheet of the roadway plans with the included  
file: 44371125801-PLANS- 01-ROADWAY-REV01

Item 5- RFI's and Responses follow:

**RFI #1:** Will you please provide the 5 char/digit LAP Agreement Contract Number for this project?

**R.** The contract number is G2878

All other provisions of the Contract Documents and Specifications not in conflict with this Addendum shall remain in full force and effect.

Questions are to be e-mailed to [ContractAdministration@tampagov.net](mailto:ContractAdministration@tampagov.net) .

*Jim Greiner*

Jim Greiner, P.E., Contract Management Supervisor

**LAP DIVISION 1 SPECIFICATIONS.**

(REV6-4-24) (FA 3-29-24) (8-24)

Construction Checklist Specifications  
from  
Department of Transportation  
Standard Specifications for Road and Bridge Construction

*The following excerpts from the Standard Specifications and Special Provisions are provided for use in LAP Specifications as needed in accordance with the Local Programs Manual (525-010-300) and the Local Agency Program Checklist for Construction Contracts (Phase 58) – Federal and State Requirements (525-070-44)*

## **FROM SECTION 1 – DEFINITIONS AND TERMS:**

**Department Name** \_\_\_\_\_

**Engineer** \_\_\_\_\_

### **Contractor's Engineer of Record.**

A Professional Engineer registered in the State of Florida, other than the Engineer of Record or his subcontracted consultant, who undertakes the design and drawing of components of the permanent structure as part of a redesign or Cost Savings Initiative Proposal, or for repair designs and details of the permanent work. The Contractor's Engineer of Record may also serve as the Specialty Engineer.

The Contractor's Engineer of Record must be an employee of a pre-qualified firm. The firm shall be pre-qualified in accordance with the Rules of the Department of Transportation, Chapter 14-75. Any Corporation or Partnership offering engineering services must hold a Certificate of Authorization from the Florida Department of Business and Professional Regulation.

As an alternate to being an employee of a pre-qualified firm, the Contractor's Engineer of Record may be a pre-qualified Specialty Engineer. For items of the permanent work declared by the State Construction Office to be "major" or "structural", the work performed by a pre-qualified Specialty Engineer must be checked by another pre-qualified Specialty Engineer. An individual Engineer may become pre-qualified in the work groups listed in the Rules of the Department of Transportation, Chapter 14-75, if the requirements for the Professional Engineer are met for the individual work groups. Pre-qualified Specialty Engineers are listed on the State Construction Website. Pre-qualified Specialty Engineers will not be authorized to perform redesigns or Cost Savings Initiative Proposal designs of items fully detailed in the plans.

### **Specialty Engineer.**

A Professional Engineer registered in the State of Florida, other than the Engineer of Record or his subcontracted consultant, who undertakes the design and drawing preparation of components, systems, or installation methods and equipment for specific temporary portions of the project work or for special items of the permanent works not fully detailed in the plans and required to be furnished by the Contractor. The Specialty Engineer may also provide designs and details, repair designs and details, or perform Engineering Analyses for items of the permanent work declared by the State Construction Office to be "minor" or "non-structural".

For items of work not specifically covered by the Rules of the Department of Transportation, a Specialty Engineer is qualified if he has the following qualifications:

- (1) Registration as a Professional Engineer in the State of Florida.
- (2) The education and experience necessary to perform the submitted design as required by the Florida Department of Business and Professional Regulation.

## **FROM SECTION 6 – CONTROL OF MATERIALS (MATERIAL CERTIFICATION, APL, AND CONVICT LABOR ).**

### **6-1.3 Certification:**

**6-1.3.1 Manufacturer Material Certification:** Submit material certifications for all materials to the Engineer for approval when required by the Specifications. Materials will not be considered for payment when not accompanied by a material certification. Sample material certification forms are available on the Department's website at the following URL: <https://www.fdot.gov/materials/administration/resources/library/publications/certifications/sampleforms.shtm>. Ensure that the material certification follows the format of the sample form, is submitted on the manufacturer's letterhead and is signed by a legally responsible person employed by the manufacturer.

**6-1.3.1.1 Approved Product List:** This list provides assurance to Contractors, consultants, designers, and Department personnel that specific products and materials are approved for use on Department facilities. The Department will limit the Contractor's use of products and materials that require use of APL items to those listed on the APL effective at the time of placement. Where the terms Qualified Products List (QPL) appear in the Contract Documents, they will be synonymous with Approved Product List (APL).

### **6-5 Products and Source of Supply.**

**6-5.1 Source of Supply–Convict Labor (Federal-Aid Contracts Only):** Do not use materials that were produced after July 1, 1991, by convict labor for Federal-aid highway construction projects unless the prison facility has been producing convict-made materials for Federal-aid highway construction projects before July 1, 1987.

Use materials that were produced prior to July 2, 1991, by convicts on Federal-aid highway construction projects free from the restrictions placed on the use of these materials by 23 U.S.C. 114. The Department will limit the use of materials produced by convict labor for use in Federal-aid highway construction projects to:

1. Materials produced by convicts on parole, supervised release, or probation from a prison or,
2. Materials produced in a qualified prison facility.

The amount of such materials produced for Federal-aid highway construction during any 12-month period shall not exceed the amount produced in such facility for use in such construction during the 12-month period ending July 1, 1987.

**6-5.2 Source of Supply:** Comply with 2 CFR 184 and 2 CFR 200.322, which includes the Buy America Sourcing Preferences of the Build America, Buy America Act (BABA). Domestic compliance for all affected products will be listed on the APL. The list of affected articles, materials, and supplies that have been added to the APL and are not identified in each individual Section can be found at the following URL: <https://www.fdot.gov/programmanagement/ProductEvaluation/Default.shtm>.

**6-5.2.1 Steel and Iron:** Use steel and iron manufactured in the United States, in accordance with the Buy America provisions of 23 CFR 635.410, as amended. Ensure that all manufacturing processes for this material occur in the United States. As used in this specification, a manufacturing process is any process that modifies the chemical content, physical shape or size, or final finish of a product, beginning with the initial melting and continuing through the final shaping and coating. If a steel or iron product is taken outside the

United States for any manufacturing process, it becomes foreign source material. When using steel or iron materials as a component of any manufactured product (e.g., concrete pipe, prestressed beams, corrugated steel pipe, etc.), these same provisions apply. Foreign steel and iron may be used when the total actual cost of such foreign materials does not exceed 0.1% of the total Contract amount or \$2,500, whichever is greater. These requirements are applicable to all steel and iron materials incorporated into the finished work but are not applicable to steel and iron items that the Contractor uses but does not incorporate into the finished work. Submit a certification from the manufacturer of steel or iron, or any product containing steel or iron, stating that all steel or iron furnished or incorporated into the furnished product was produced and manufactured in the United States or a statement that the product was produced within the United States except for minimal quantities of foreign steel and iron valued at \$ (actual cost). Submit each such certification to the Engineer prior to incorporating the material or product into the project. Prior to the use of foreign steel or iron materials on a project, submit invoices to document the actual cost of such material, and obtain the Engineer's written approval prior to incorporating the material into the project.

**6-5.2.2 Manufactured Products:** Use Manufactured Products that are consumed in, incorporated into, or affixed to an infrastructure project that are manufactured in the United States, in accordance with BABA requirements and applicable waivers.

**6-5.2.3 Construction Materials:** Use non-ferrous metals, plastic and polymer-based products, glass, lumber, and drywall articles, materials, and supplies that are consumed in, incorporated into, or affixed to an infrastructure project that are manufactured in the United States, in accordance with BABA requirements.

**6-5.2.4 Exemptions to Build America, Buy America:** Temporary devices, equipment, and other items removed at or before the completion of the project are exempt from BABA funding eligibility requirements. Aggregates, cementitious materials, and aggregate binding agents or additives are exempted from BABA funding eligibility requirements.

**6-5.3 Contaminated, Unfit, Hazardous, and Dangerous Materials:** Do not use any material that, after approval and/or placement, has in any way become unfit for use. Do not use materials containing any substance that has been determined to be hazardous by the State of Florida Department of Environmental Protection or the U.S. Environmental Protection Agency (EPA). Provide workplaces free from serious recognized hazards and to comply with occupational safety and health standards, as determined by the U.S. Department of Labor Occupational Safety and Health Administration (OSHA).

## **FROM SECTION 7 – LEGAL REQUIREMENTS AND RESPONSIBILITIES TO THE PUBLIC (FHWA 1273, WAGE RATES, E-VERIFY, TITLE VI, DBE, AND ON-THE-JOB TRAINING)**

**7-1.1 Compliance with FHWA 1273:** The FHWA-1273 Electronic version, dated October 23, 2023 is posted on the Department's website at the following URL address:

[https://fdotwww.blob.core.windows.net/sitefinity/docs/default-source/programmanagement/implemented/urlinspecs/files/fhwa\\_1273\\_revised-10-23-23.pdf?sfvrsn=d7604d20\\_1](https://fdotwww.blob.core.windows.net/sitefinity/docs/default-source/programmanagement/implemented/urlinspecs/files/fhwa_1273_revised-10-23-23.pdf?sfvrsn=d7604d20_1)

Take responsibility to obtain this information and comply with all requirements posted on this website up through five calendar days before the opening of bids.

Comply with the provisions contained in FHWA-1273.

If the Department's website cannot be accessed, contact the Department's Specifications Office Web Coordinator at (850) 414-4101.

#### **7-1.4 Compliance with Federal Endangered Species Act and other Wildlife**

**Regulations:** The Federal Endangered Species Act requires that the Department investigate the potential impact to a threatened or endangered species prior to initiating an activity performed in conjunction with a highway construction project. If the Department's investigation determines that there is a potential impact to a protected, threatened or an endangered species, the Department will conduct an evaluation to determine what measures may be necessary to mitigate such impact. When mitigation measures and/or special conditions are necessary, these measures and conditions will be addressed in the Contract Documents or permits.

In addition, in cases where certain protected, threatened or endangered species are found or appear within close proximity to the project boundaries, the Department has established guidelines that will apply when interaction with certain species occurs, absent of any special mitigation measures or permit conditions otherwise identified for the project.

These guidelines are posted at the following URL  
address: [https://fdotwww.blob.core.windows.net/sitefinity/docs/default-source/programmanagement/implemented/urlinspecs/files/endangeredwildlifeguidelines.pdf?sfvrsn=e27baf3f\\_2](https://fdotwww.blob.core.windows.net/sitefinity/docs/default-source/programmanagement/implemented/urlinspecs/files/endangeredwildlifeguidelines.pdf?sfvrsn=e27baf3f_2).

Take responsibility to obtain this information and take all actions and precautions necessary to comply with the conditions of these guidelines during all project activities.

Prior to establishing any off-project activity in conjunction with a project, notify the Engineer of the proposed activity. Covered activities include but are not necessarily limited to borrow pits, concrete or asphalt plant sites, disposal sites, field offices, and material or equipment storage sites. Include in the notification the Financial Project ID, a description of the activity, the location of the site by township, range, section, county, and city, a site location map including the access route, the name of the property owner, and a person to contact to arrange a site inspection. Submit this notification at least 30 days in advance of planned commencement of the off-site activity, to allow for the Department to conduct an investigation without delaying job progress.

Do not perform any off-project activity without obtaining written clearance from the Engineer. In the event the Department's investigation determines a potential impact to a protected, threatened or endangered species and mitigation measures or permits are necessary, coordinate with the appropriate resource agencies for clearance, obtain permits and perform mitigation measures as necessary. Immediately notify the Engineer in writing of the results of this coordination with the appropriate resource agencies. Additional compensation or time will not be allowed for permitting or mitigation, associated with Contractor initiated off-project activities.

**7-1.8 Compliance with Section 4(f) of the USDOT Act:** Section 4(f) of the USDOT Act prohibits the U. S. Secretary of Transportation from approving a project which requires the use of publicly owned land of a public park, recreation area or a wildlife and waterfowl refuge, or of any historic site of national, state, or local significance unless there is no prudent or feasible alternative to using that land and the program or project includes all possible planning to minimize the harm to the site resulting from the use.

Before undertaking any off-project activity associated with any federally assisted undertaking, ensure that the proposed site does not represent a public park, recreation area, wildlife or waterfowl refuge, or a historic site (according to the results of the Cultural Resources Survey discussed in 120-6.2). If such a site is proposed, notify the Engineer and provide a description of the proposed off-site activity, the Financial Project ID, the location of the site by township, range, section, a county or city map showing the site location, including the access

route and the name of the property. It is the Contractor's responsibility to submit justification for use of Section 4(f) property that is sufficient for the Florida Department of Transportation and the Federal Highway Administration to make a Section 4(f) determination. Submit this notification sufficiently in advance of planned commencement of the off-site activity to allow a reasonable time for the Engineer to conduct an investigation without delaying job progress. Do not begin any off-project activity without obtaining written clearance from the Engineer.

#### **7-16 Wage Rates for Federal-Aid Projects.**

For this Contract, payment of predetermined minimum wages applies.

The U.S. Department of Labor (USDOL) Wage Rates applicable to this Contract are listed in table below, as modified up through ten days prior to the opening of bids.

Wage Rate Decision Number	County	Associated Work
FL20240169	Hillsborough	Highway

Review the General Decisions for all classifications necessary to complete the project. Request additional classifications through the Engineer's office when needed.

#### **7-24 Disadvantaged Business Enterprise Program.**

**7-24.2 Required Contract and Subcontract DBE Assurance Language:** In accordance with 49 CFR 26.13 (b), the Contract FDOT signs with the Contractor (and each subcontract the prime contractor signs with a subcontractor) must include the following assurance: "The Contractor, sub-recipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted Contracts. Failure by the Contractor to carry out these requirements is a material breach of this Contract, which may result in the termination of this Contract or such other remedy as the recipient deems appropriate, which may include, but is not limited to,

1. Withholding monthly progress payments;
2. Assessing sanctions;
3. Liquidated damages; and/or
4. Disqualifying the Contractor from future bidding as non-responsible."

**7-24.4 DBE Records and Reports:** Submit the following through the Equal Opportunity Compliance System:

1. DBE Commitments - at or before the Pre-Construction Conference.
2. Report monthly, through the Equal Opportunity Compliance System on the Department's Website, actual payments (including retainage) made to DBEs for work performed with their own workforce and equipment in the area in which they are certified. Report payments made to all DBE and Minority Business Enterprise (MBE) subcontractors and DBE and MBE construction material and major suppliers.

The Equal Opportunity Office will provide instructions on accessing this system. Develop a record keeping system to monitor DBE affirmative action efforts which include the following:

1. the procedures adopted to comply with these Specifications;
  2. the number of subordinated Contracts on Department projects awarded to DBEs;
  3. the dollar value of the Contracts awarded to DBEs;
  4. the percentage of the dollar value of all subordinated Contracts awarded to DBEs as a percentage of the total Contract amount;
  5. a description of the general categories of Contracts awarded to DBEs;
- and
6. the specific efforts employed to identify and award Contracts to DBEs.

Upon request, provide the records to the Department for review.

Maintain all such records for a period of five years following acceptance of final payment and have them available for inspection by the Department and the Federal Highway Administration.

#### **7-24.5 Counting DBE Participation and Commercially Useful Functions:**

49 CFR Part 26.55 specifies when DBE credit shall be awarded for work performed by a DBE. DBE credit can only be awarded for work actually performed by DBEs themselves for the types of work for which they are certified. When reporting DBE Commitments, only include the dollars that a DBE is expected to earn for work they perform with their own workforce and equipment. Update DBE Commitments to reflect changes to the initial amount that was previously reported or to add DBEs not initially reported.

When a DBE participates in a contract, the value of the work is determined in accordance with 49 CFR Part 26.55, for example:

1. The Department will count only the value of the work performed by the DBE toward DBE goals. The entire amount of the contract that is performed by the DBE's own forces (including the cost of supplies, equipment and materials obtained by the DBE for the contract work) will be counted as DBE credit.

2. The Department will count the entire amount of fees or commissions charged by the DBE firm for providing a bona fide service, such as professional, technical, consultant, or managerial services or for providing bonds or insurance specifically required for the performance of a Department-assisted contract, toward DBE goals, provided that the Department determines the fees to be reasonable and not excessive as compared with fees customarily followed for similar services.

3. When the DBE subcontracts part of the work of its contract to another firm, the Department will count the value of the subcontracted work only if the DBE's subcontractor is itself a DBE. Work that a DBE subcontracts to a non-DBE firm does not count toward DBE goals.

4. When a DBE performs as a participant in a joint venture, the Department will count the portion of the dollar value of the contract equal to the distinct, clearly defined portion of the work the DBE performs with its own forces toward DBE goals.

5. The Contractors shall ensure that only expenditures to DBEs that perform a commercially useful function (CUF) in the work of a contract may be counted toward the voluntary DBE goal.

6. A DBE performs a commercially useful function when it is responsible for execution of the work of the contract and is carrying out its responsibilities by actually performing, managing, and supervising the work involved. To perform a commercially useful function, the DBE must also be responsible, with respect to materials and supplies used on the



contract, for negotiating price, determining quality and quantity, ordering the material, and installing (where applicable) and paying for the material itself.

7. Contractors wishing to use joint checks involving DBE credit must provide written notice to the District Contract Compliance Office prior to issuance of the joint check. The Contractor must also provide a copy of the notice to the DBE subcontractor and maintain a copy with the project records.

8. To determine whether a DBE is performing a commercially useful function, the Department will evaluate the amount of work subcontracted, industry practices, whether the amount the firm is to be paid under the contract is commensurate with the work it is actually performing and the DBE credit claimed for its performance of the work, and other relevant factors.

9. A DBE does not perform a commercially useful function if its role is limited to that of an extra participant in a transaction, contract, or project through which funds are passed in order to obtain the appearance of DBE participation.

10. If a DBE does not perform or exercise responsibility for at least 30% of the total cost of its contract with its own workforce, or if the DBE subcontracts a greater portion of the work of a contract than would be expected on the basis of normal industry practice for the type of work involved, the DBE has not performed a commercially useful function.

**7-24.6 Prompt Payments:** Meet the requirements of 9-5 for payments to all DBE subcontractors.

#### **7-25 On-The-Job Training Requirements.**

As part of the Contractor's equal employment opportunity affirmative action program, the Contractor shall provide training aimed at developing full journeymen in a trade or job classification involved on all applicable roadway and bridge construction projects receiving federal funds.

The anticipated minimum number of trainees will be initially derived from construction contract calendar days and dollar value as represented within the provided Table 7-1. A final training goal will be determined at the Training Evaluation Meeting based upon the Department's consideration of all relevant factors including qualitative evidence in the form of contractor efforts to advance equal employment opportunity beyond mere compliance with legal obligations; the availability of eligible trainees; potential for effective training; contractor workforce; project location; type of work and work items; and contractor participation in other approved training or workforce development programs.

No trainees will be required for Federal-aid Contracts administered with a Contract Time allowance of less than 275 calendar days. When the Contract Time allowance is 275 calendar days or more, the estimated required number of trainees shown in Table 7-1, with all other relevant factors, be the basis in determining totals. The ability of the contractor to successfully achieve completion of required training goals is desired. From consideration of all criteria presented during the Training Evaluation Meeting, the District Contract Compliance Manager may adjust the minimum number of trainees regarding those totals.

Table 7-1	
Estimated Contract Values	Anticipated Required Trainees
\$3,500,000 or less	0
Over \$3,500,000 to \$7,500,000	2

Table 7-1	
Estimated Contract Values	Anticipated Required Trainees
Over \$7,500,000 to \$12,000,000	3
Over \$12,000,000 to \$20,000,000	4
Over \$20,000,000 to \$30,000,000	6
Over \$30,000,000 to \$40,000,000	8
Over \$40,000,000 to \$60,000,000	10
Over \$60,000,000 to \$75,000,000	12
Over \$75,000,000 to \$90,000,000	14
Over \$90,000,000 to \$100,000,000	15
Over \$100,000,000 to \$125,000,000	17
Over \$125,000,000 to \$150,000,000	20
Over \$150,000,000 to \$175,000,000	22
Over \$175,000,000 to \$200,000,000	25
Over \$200,000,000* One additional trainee per \$10,000,000 additional Construction Contract amount	

Training and upgrading of minority, nonminority, women, and economically disadvantaged persons toward journeyman status is a primary objective of this Section. Accordingly, by conducting systematic and direct recruitment through public and private sources likely to yield minorities and women trainees the Contractor shall make every effort to enroll candidates to the extent such individuals are located and available within a reasonable area of recruitment. This training is not intended, and shall not be used, to discriminate against any applicant or prevent access of, whether minority, nonminority, woman, or persons believed economically disadvantaged.

The intent of these provisions is to provide training in construction crafts rather than clerical type positions. Training is permissible in lower-level management positions such as Office Engineers, Estimators etc., where the training is oriented toward construction applications. Training in the laborer classifications, except Common or General Laborer, may be permitted provided that significant and meaningful training plan is provided and approved by the District Contract Compliance Manager. Training as a Helper for any position, Rodman/Chainman, and Timekeeper classifications will not be approved for the On-The-Job Training Program.

The Contractor may incorporate the requirements of this Section, including responsibility for training a portion of trainees, in any such subcontract maintaining continued primary responsibility and satisfaction of requirements imposed by this Section.

The Department and the Contractor shall establish a training program which is tied to construction scope of work, length of operations, and satisfy all equal employment opportunity obligations of the Contractor. Other additionally recognized apprenticeship or training programs may be considered acceptable provided those are being administered in a manner consistent with the equal employment obligations of Federal-aid Highway Construction Contracts. Approval or acceptance of a training schedule shall be obtained from the Department prior to commencing work with classifications covered by such programs.

The Department and Contractor shall determine the training goal, classification types and minimum total hours needed during the Trainee Evaluation Meeting. An On-the-Job Training Schedule indicating number of training candidates and appropriate Proficiency Standards for

each classification must be submitted by the Contractor within ten days after the meeting for approval by the Department.

This schedule may be subject to change and a revised schedule shall be submitted for approval by the Department if any of the following occur:

Start date on the approved On-The-Job Training Schedule or Plan has been missed by 14 or more days.

1. Start date on the approved On-The-Job Training Schedule or Plan is accelerated to commence earlier than 14 or more days.

2. A change in previously approved classifications.

3. Replacement trainees are added due to voluntary or involuntary termination.

The Contractor is responsible for identifying qualified candidates for enrollment and feasibly 25% of trainees in each occupation are in their first year of training. To ensure eligibility, the Contractor should include appropriate questions in the employee application or by other suitable means. Regardless of the method used, the Contractor's records should document the findings in each case. The Department will gather additional information regarding the proposed Candidates' previous work experience, training, as well as understanding of the On-the-Job Program and Proficiency Standards established for the classification.

The Trainee Enrollment and Notification of Personnel Action form is to be submitted fourteen days prior to the requested enrollment date. To be considered for enrollment, the proposed trainee candidate must meet the following criteria:

1. The candidate did not successfully complete a training course leading to journeyman status for the proposed classification.

2. The candidate did not gain sufficient experience by working in the proposed classification.

3. The candidate was not hired as a journeyman in the proposed classification.

4. The candidate is not currently enrolled in the On-the-Job Program.

The Contractor shall compensate the trainee at no less than the laborer rate established in the Contract at the commencement of training. The compensation rate will be increased to the journeyman's wage upon graduation from the training program for the remainder of the time the trainee graduate works in the classification in which they were trained.

If an economically disadvantaged non-minority person is enrolled, such action shall be accompanied by a disadvantaged certification or a justification for such action acceptable to the Department. The Contractor will be responsible for, and provided an opportunity to identify actions and steps taken in pursuance thereof, prior to a determination of compliance with this Section being assessed the Contractor.

The Contractor may only enroll a trainee in one active classification per instance prior to approval of an additional classification for that trainee on the same project unless approved by the District Contract Compliance Manager. At beginning of training, the Contractor shall furnish the trainee a copy of the scheduled program they will follow during the intended training period and upon completion, award certification indicating type and total hours satisfactorily achieved.

To complete training, the transfer of trainees from project to project and from district to district is permitted. This includes transfers between multiple projects which could include non-FDOT government projects (City, County, etc.) provided there is the existence of an agreement to monitor the OJT Trainees in accordance with the OJT Program with the contractor, FDOT and other participating agencies. A trainee is only allowed to be enrolled on the original project.

The Contractor shall generate, maintain and furnish the District Contract Compliance Manager with the Monthly Time Report reflecting known training hours apart from other work

hours performed by each individual trainee as part of this Contract. The report shall be submitted no later than the tenth day of the subsequent month and identify proficiency occurring.

Graduation to journeyman status will be based upon satisfactory accomplishment of:

1. Proficiency Demonstration being achieved upon conclusion of training as established for the specific training classification.
2. Completion of the minimum hours in a training classification range.
3. The employer's satisfaction that the trainee does meet journeyman status in the classification of training.

The Contractor shall furnish the following documentation to the Department within seven days of successfully demonstrating proficiency:

1. Trainee Enrollment and Notification of Personnel Action form.
2. Proficiency Demonstration Verification Form signed by representatives of both the Contractor and the Department as well as the trainee indicating successful completion of each Proficiency Standard established for the classification.

The Contractor shall submit to the Department a copy of the Trainee Enrollment and Notification of Personnel Action form no later than seven days after the effective date when the candidate is voluntarily or involuntarily terminated from the program.

When approved in advance, the Department provides the Contractor the opportunity to participate in "Voluntary On-the-Job Training Program for Banking". Banking Certificates will be issued when the Contractor desires to preserve credit for a trainee. Further, if the Contractor or subcontractor requests to utilize banked trainees, the Banking Certificate will be validated allowing credit to the Contractor on a subsequent Federal-Aid Project. Banked credits of Prime Contractors working as Subcontractors may be accepted for credit. Voluntary On-the-Job Training Program for Banking can be considered under the following circumstances:

1. Federal-aid Projects – Banking Certificates are issued for training of persons in excess of the required number of candidates based on the awarded Contract amount less items of work for which no training can be afforded.
2. State Funded Projects - the Contractor will have the option to train employees on project for which On-the-Job Training Program mandates do not apply. However, the request to participate must be evaluated and will be considered if adequate Department staff are available to monitor compliance with the training criteria.

The following criteria will be used in determining if the Contractor has complied with the requirements of this specification:

1. Credit will be allowed for each trainee who satisfactorily completes training for the classification in which the trainee is enrolled.
2. Credit will be allowed for each trainee who continues training in the same job classification and who completes their training on a different contract.
3. Credit will be allowed for a trainee who is given the greatest practical amount of training on the contract; however, the trainee is unable to complete the training due to insufficient amount of work available in the classification.
4. Credit will be allowed for any position indicated in the approved On-the-Job Training Schedule or Plan, for which the Contractor can demonstrate that a good faith effort was made to provide training.
5. No credit will be allowed for a trainee whose employment by the Contractor is involuntarily terminated unless the Contractor can clearly demonstrate good cause for this action.
6. Banking certificates may be redeemed within five (5) years of issuance. The issuance and redemption of banking certificates are tracked by each District and the EEO.

7. Earned banking credits are redeemed by presenting the original banking certificate to the DCCM of the district where the project on which the credit is to be applied.

8. A contractor utilizing banking credit(s) to fulfill agreed upon trainee requirement(s), must present the original banking certificate for redemption. If the contractor has determined at the TEM that banked credits will be used to meet trainee requirements, then the certificate(s) is submitted with the initial training schedule. A prime contractor working as a subcontractor to another prime, may redeem their earned banking certificates for the prime.

9. If the contractor subsequently determines to use banked credit(s) to meet trainee requirements, then the certificate(s) are submitted with the revised training schedule.

The Contractor will have fulfilled the responsibilities of this Specification when acceptable training has been provided to the trainee as specified above.

#### **7-29 E-Verify.**

The Contractor shall utilize the U.S. Department of Homeland Security's E-Verify system to verify the employment eligibility of all new employees hired by the Contractor during the term of the Contract and shall expressly require any subcontractors performing work or providing services pursuant to the Contract to likewise utilize the U.S. Department of Homeland Security's E-Verify system to verify the employment eligibility of all new employees hired by the subcontractor during the Contract term.

### **FROM SECTION 8 - PROSECUTION AND PROGRESS (SUBLETTING, CONTRACT TIME EXTENSION, AND LIQUIDATED DAMAGES).**

#### **8-1 Subletting or Assigning of Contracts.**

Do not, sell, transfer, assign or otherwise dispose of the Contract or Contracts or any portion thereof, or of the right, title, or interest therein, without written consent of the Department. If the Contractor chooses to sublet any portion of the Contract, the Contractor must provide a written request to sublet work on the Certification of Sublet Work form developed by the Department for this purpose. With the Engineer's acceptance of the request, the Contractor may sublet a portion of the work, but shall perform with its own organization work amounting to not less than 40% of the total Contract amount. The Certification of Sublet Work request will be deemed acceptable by the Department, for purposes of the Department's consent, unless the Engineer notifies the Contractor within 5 business days of receipt of the Certification of Sublet Work that the Department is not consenting to the requested subletting.

Include in the total Contract amount the cost of materials and manufactured component products, and their transportation to the project site. For the purpose of meeting this requirement the Department will not consider off-site commercial production of materials and manufactured component products that the Contractor purchases, or their transportation to the project, as subcontracted work.

If the Contractor sublets a part of a Contract item, the Department will use only the sublet proportional cost in determining the percentage of subcontracted normal work.

Execute all agreements to sublet work in writing and include all pertinent provisions and requirements of the Contract. All other agreements must be in writing and reference all applicable Contract provisions. Upon request, furnish the Department with a copy of the subcontract and agreement. The subletting of work does not relieve the Contractor or the surety of their respective liabilities under the Contract.

The Department recognizes a subcontractor only in the capacity of an employee or agent of the Contractor, and the Engineer may require the Contractor to remove the subcontractor as in the case of an employee.

**8-3.2 Submission of Contract Schedule:** Within 21 calendar days after Contract award or at the preconstruction conference, whichever is earlier, submit to the Engineer a Contract Schedule for the project. The Engineer will review and respond to the Contractor within 15 calendar days of receipt.

Provide a Contract Schedule that shows the various activities of work in sufficient detail to demonstrate a reasonable and workable plan to complete the project within the Contract Time. Show the order and interdependence of activities and the sequence for accomplishing the work. Describe all activities in sufficient detail so that the Engineer can readily identify the work and measure the progress on of each activity. Show each activity with a beginning work date, a duration, and a monetary value. Include activities for procurement fabrication, and delivery of materials, plant, and equipment, and review time for shop drawings and submittals. Include milestone activities when milestones are required by the Contract Documents. In a project with more than one phase, adequately identify each phase and its completion date, and do not allow activities to span more than one phase.

Conduct sufficient liaison and provide sufficient information to indicate coordination activities with utility owners that have facilities within the limits of construction have been resolved. Incorporate in the Contract Schedule any utility work schedules included in the Contract Documents unless the utility company and the Department mutually agree to changes to the utility schedules shown in the Contract.

Submit a working plan with the Contract Schedule, consisting of a concise written description of the construction plan.

The Engineer will return inadequate Contract Schedules to the Contractor for corrections. Resubmit a corrected schedule within 15 calendar days from the date of the Engineer's return transmittal.

Submit an updated Contract Schedule, for Engineer's acceptance, if there is a significant change in the planned order or duration of an activity. The Engineer will review the corrected schedule and respond within 7 calendar days of receipt.

By acceptance of the Contract Schedule, the Engineer does not endorse or otherwise certify the validity or accuracy of the activity durations or sequencing of activities. The Engineer will use the accepted schedule as the baseline against which to measure the progress.

If the Contractor fails to finalize either the initial or a revised Contract Schedule in the time specified, the Engineer may withhold all Contract payments until the Engineer accepts the schedule.

The Contract Schedule may indicate a completion date in advance of the expiration of Contract Time. However, the Department will not be liable in any way for the Contractor's failure to complete the project prior to expiration of Contract Time. Any additional costs, including extended overhead incurred between the Contractor's scheduled completion date and the expiration of Contract Time, shall be the responsibility of the Contractor. The Contractor shall not be entitled to claim or recover any such costs from the Department.

### **8-7.3 Adjusting Contract Time:**

**8-7.3.1 Increased Work:** The Department may grant an extension of Contract Time when it increases the Contract amount due to overruns in original Contract items, adds new work items, or provides for unforeseen work. The Department will base the consideration for

granting an extension of Contract Time on the extent that the time normally required to complete the additional designated work delays the Contract completion schedule.

**8-7.3.2 Contract Time Extensions:** The Department may grant an extension of Contract Time when a controlling item of work is delayed by factors not reasonably anticipated or foreseeable at the time of bid. The Department may allow such extension of time only for delays occurring during the Contract Time period or authorized extensions of the Contract Time period. When failure by the Department to fulfill an obligation under the Contract results in delays to the controlling items of work, the Department will consider such delays as a basis for granting a time extension to the Contract.

Whenever the Engineer suspends the Contractor's operations, as provided in 8-6, for reasons other than the fault of the Contractor, the Engineer will grant a time extension for any delay to a controlling item of work due to such suspension. The Department will not grant time extensions to the Contract for delays due to the fault or negligence of the Contractor.

The Department does not include an allowance for delays caused by the effects of inclement weather or suspension of Contractor's operations in establishing Contract Time. The Engineer will continually monitor the effects of weather and, when found justified, grant time extensions on either a bimonthly or monthly basis. The Engineer will not require the Contractor to submit a request for additional time due to the effects of weather.

The Department will grant time extensions, on a day for day basis, for delays caused by the effects of rains or other inclement weather conditions, related adverse soil conditions or suspension of operations that prevent the Contractor from productively performing controlling items of work resulting in:

1. The Contractor being unable to work at least 50% of the normal work day on pre-determined controlling work items; or
2. The Contractor must make major repairs to work damaged by weather, provided that the damage is not attributable to the Contractor's failure to perform or neglect; and provided that the Contractor was unable to work at least 50% of the normal workday on pre-determined controlling work items.

When the Department grants a time extension due to rains or other inclement weather, the Contractor shall submit any objection to the additional time in writing within ten calendar days from receipt of written notice from the Engineer. Failure to submit a written appeal within ten calendar days from receipt of the written notice shall constitute a waiver of any and all rights to appeal the Department's decision at a later time.

No additional compensation will be made for delays caused by the effects of inclement weather.

The Department will consider the delays in delivery of materials or component equipment that affect progress on a controlling item of work as a basis for granting a time extension if such delays are beyond the control of the Contractor or supplier. Such delays may include an area-wide shortage, an industry-wide strike, or a natural disaster that affects all feasible sources of supply. In such cases, the Contractor shall furnish substantiating letters from a representative number of manufacturers of such materials or equipment clearly confirming that the delays in delivery were the result of an area-wide shortage, an industry-wide strike, etc. No additional compensation will be made for delays caused by delivery of materials or component equipment.

The Department will not consider requests for time extension due to delay in the delivery of custom manufactured equipment such as traffic signal equipment, highway lighting equipment, etc., unless the Contractor furnishes documentation that he placed the order

for such equipment in a timely manner, the delay was caused by factors beyond the manufacturer's control, and the lack of such equipment caused a delay in progress on a controlling item of work. No additional compensation will be paid for delays caused by delivery of custom manufactured equipment.

The Department will consider the affect of utility relocation and adjustment work on job progress as the basis for granting a time extension only if all the following criteria are met:

1. Delays are the result of either utility work that was not detailed in the Plans, or utility work that was detailed in the Plans but was not accomplished in reasonably close accordance with the schedule included in the Contract Documents.

2. Utility work actually affected progress toward completion of controlling work items.

3. The Contractor took all reasonable measures to minimize the effect of utility work on job progress, including cooperative scheduling of the Contractor's operations with the scheduled utility work at the preconstruction conference and providing adequate advance notification to utility companies as to the dates to coordinate their operations with the Contractor's operations to avoid delays.

The Department will consider requests for time extension due to delay in work operations within the limits of the railroad right-of-way, the adjoining 15 feet, or determined by the Railroad or Department to be able to potentially foul the tracks regardless of distance from railroad right-of-way on job progress as the basis for granting a time extension only if all the following criteria are met:

1. Delays are due to a lack of availability of Railroad protective services as required by 7-11.4.

2. Work within the limits of the railroad right-of-way or the adjoining 15 feet actually impacted progress toward completion of controlling work items.

3. The Contractor took all reasonable measures to minimize the effect of work operations within the limits of the railroad right-of-way or the adjoining 15 feet on job progress, including compliance with all provisions of 7-11.4 and 5-12, and cooperative scheduling of the Contractor's operations.

As a condition precedent to an extension of Contract Time the Contractor must submit to the Engineer:

A preliminary request for an extension of Contract Time must be made in writing to the Engineer within ten calendar days after the commencement of a delay to a controlling item of work. If the Contractor fails to submit this required preliminary request for an extension of Contract Time, the Contractor fully, completely, absolutely and irrevocably waives any entitlement to an extension of Contract Time for that delay. In the case of a continuing delay only a single preliminary request for an extension of Contract Time will be required. Each such preliminary request for an extension of Contract Time shall include as a minimum the commencement date of the delay, the cause of the delay, and the controlling item of work affected by the delay.

Furthermore, the Contractor must submit to the Engineer a request for a Contract Time extension in writing within 30 days after the elimination of the delay to the controlling item of work identified in the preliminary request for an extension of Contract Time. Each request for a Contract Time extension shall include as a minimum all documentation that the Contractor wishes the Department to consider related to the delay, and the exact number of days requested to be added to Contract Time. If the Contractor contends that the delay is



compensable, then the Contractor shall also be required to submit with the request for a Contract Time extension a detailed cost analysis of the requested additional compensation. If the Contractor fails to submit this required request for a Contract Time extension, with or without a detailed cost analysis, depriving the Engineer of the timely opportunity to verify the delay and the costs of the delay, the Contractor waives any entitlement to an extension of Contract Time or additional compensation for the delay.

Upon timely receipt of the preliminary request of Contract Time from the Contractor, the Engineer will investigate the conditions, and if it is determined that a controlling item of work is being delayed for reasons beyond the control of the Contractor the Engineer will take appropriate action to mitigate the delay and the costs of the delay. Upon timely receipt of the request for a Contract Time extension the Engineer will further investigate the conditions, and if it is determined that there was an increase in the time or the cost of performance of the controlling item of work beyond the control of the Contractor, then an adjustment of Contract Time will be made, and a monetary adjustment will be made, excluding loss of anticipated profits, and the Contract will be modified in writing accordingly.

The existence of an accepted schedule, including any required update(s), is a condition precedent to the Contractor having any right to the granting of an extension of Contract Time or any monetary compensation arising out of any delay. Contractor failure to have an accepted schedule, including any required update(s), for the period of potential impact, or in the event the currently accepted schedule and applicable updates do not accurately reflect the actual status of the project or fail to accurately show the true controlling or non-controlling work activities for the period of potential impact, will result in any entitlement determination as to time or money for such period of potential impact being limited solely to the Department's analysis and identification of the actual controlling or non-controlling work activities. Further, in such instances, the Department's determination as to entitlement as to either time or compensability will be final, unless the Contractor can prove by clear and convincing evidence to a Disputes Review Board that the Department's determination was without any reasonable factual basis.

## **8-10 Liquidated Damages for Failure to Complete the Work.**

**8-10.2 Amount of Liquidated Damages:** Applicable liquidated damages are the amounts established in the following schedule:

Original Contract Amount	Daily Charge Per Calendar Day
\$299,999 and under.....	\$904
\$300,000 but less than \$2,000,000.....	\$1,685
\$2,000,000 but less than \$5,000,000.....	\$2,667
\$5,000,000 but less than \$10,000,000.....	\$3,813
\$10,000,000 but less than \$20,000,000.....	\$5,021
\$20,000,000 but less than \$40,000,000.....	\$7,442
\$40,000,000 and over.....	\$10,224 plus 0.00005 of any amount over \$40 million (Round to nearest whole dollar)

The Engineer may approve adjustments to the liquidated damages amounts in accordance with the Construction Project Administration Manual (CPAM) provided all contract work is complete.

## **FROM SECTION 9 - MEASUREMENT AND PAYMENT (PARTIAL PAYMENTS).**

### **9-5 Partial Payments.**

**9-5.1 General:** The Engineer will make partial payments on monthly estimates based on the amount of work that the Contractor completes during the month (including delivery of certain materials, as specified herein below). The Engineer will make approximate monthly payments, and the Department will correct all partial estimates and payments in the subsequent estimates and in the final estimate and payment.

The Department will base the amount of such payments on the total value of the work that the Contractor has performed to the date of the estimate, based on the quantities completed and the Contract prices, less payments previously made and less any retainage withheld.

Contract amount is defined as the original Contract amount adjusted by approved supplemental agreements.

Retainage will be determined for each job on multiple job Contracts. The Department will not accept Securities, Certificates of Deposit or letters of credit as a replacement for retainage. **9-5.2 Unsatisfactory Payment Record:** In accordance with Sections 255.05 and 337.16 of the Florida Statutes, and the rules of the Department, the Department may disqualify the Contractor from bidding on future Department contracts if the Contractor's payment record in connection with contract work becomes unsatisfactory.

### **9-5.3 Withholding Payment:**

**9-5.3.1 Withholding Payment for Defective Work:** If the Department discovers any defective work or material prior to the final acceptance, or if the Department has a reasonable doubt as to the integrity of any part of the completed work prior to final acceptance, then the Department will not allow payment for such defective or questioned work until the Contractor has remedied the defect and removed any causes of doubt.

**9-5.3.2 Withholding Payment for Failure to Comply:** The Department will withhold progress payments from the Contractor if he fails to comply with any or all of the following within 60 days after beginning work:

1. comply with and submit required paperwork relating to prevailing wage rate provisions, Equal Employment Opportunity, On-The-Job Training, and Affirmative Action;
2. comply with the requirement to all necessary information, including actual payments to DBEs, all other subcontractors and major suppliers, through the Internet based Equal Opportunity Reporting System;
3. comply with or make a good faith effort to ensure employment opportunity for minorities and females in accordance with the required contract provisions for Federal Aid Construction Contracts, and
4. comply with or make a good faith effort to meet On-The-Job Training goals.

The Department will withhold progress payments until the Contractor has satisfied the above conditions.

### **9-5.5 Partial Payments for Delivery of Certain Materials:**

**9-5.5.1 General:** The Department will allow partial payments for new materials that will be permanently incorporated into the project and are stockpiled in approved locations in the project vicinity. Stockpile materials so that they will not be damaged by the elements and in a manner that identifies the project on which they are to be used.

The following conditions apply to all payments for stockpiled materials:

1. There must be reasonable assurance that the stockpiled material will be incorporated into the specific project on which partial payment is made.

2. The stockpiled material must be approved as meeting applicable specifications.

3. The total quantity for which partial payment is made shall not exceed the estimated total quantity required to complete the project.

4. The Contractor shall furnish the Engineer with copies of certified invoices to document the value of the materials received. The amount of the partial payment will be determined from invoices for the material up to the unit price in the Contract.

5. Delivery charges for materials delivered to the jobsite will be included in partial payments if properly documented.

6. Partial payments will not be made for materials which were stockpiled prior to award of the Contract for a project.

**9-5.5.2 Partial Payment Amounts:** The following partial payment restrictions apply:

1. Partial payments less than \$5,000 for any one month will not be processed.

2. Partial payments for structural steel, ITS and signal components, and precast prestressed items will not exceed 85% of the bid price for the item. Partial payments for all other items will not exceed 75% of the bid price of the item in which the material is to be used.

3. Partial payment will not be made for aggregate and base course material received after paving or base construction operations begin except when a construction sequence designated by the Department requires suspension of paving and base construction after the initial paving operations, partial payments will be reinstated until the paving and base construction resumes.

**9-5.5.3 Off Site Storage:** If the conditions of 9-5.5.1 are satisfied, partial payments will be allowed for materials stockpiled in approved in-state locations. Additionally, partial payments for materials stockpiled in approved out-of-state locations will be allowed if the conditions of 9-5.5.1 and the following conditions are met:

1. Furnish the Department a Materials Bond stating the supplier guarantees to furnish the material described in the Contract to the Contractor and Department. Under this bond, the Obligor shall be the material supplier and the Obligees shall be the Contractor and the Florida Department of Transportation. The bond shall be in the full dollar amount of the bid price for the materials described in the contract.

2. The following clauses must be added to the construction Contract between the Contractor and the supplier of the stockpiled materials:

“Notwithstanding anything to the contrary, <supplier> will be liable to the Contractor and the Florida Department of Transportation should <supplier> default in the performance of this agreement.”

“Notwithstanding anything to the contrary, this agreement, and the performance bond issued pursuant to this agreement, does not alter, modify, or otherwise change the Contractor’s obligation to furnish the materials described in this agreement to the Florida Department of Transportation.”

3. The agreement between the Contractor and the supplier of the stockpiled materials must include provisions that the supplier will store the materials and that such materials are the property of the Contractor.

**9-5.6 Certification of Payment to Subcontractors:** The term “subcontractor,” as used herein, includes persons or firms furnishing materials or equipment incorporated into the work or stockpiled for which the Department has made partial payment and firms working under equipment-rental agreements. The Contractor is required to pay all subcontractors for satisfactory performance of their Contracts before the Department will make a further progress (partial) payment. The Contractor shall also return all retainage withheld to the subcontractors within 30 days after the subcontractor’s work is satisfactorily complete, as determined by the Department. Prior to receipt of any progress (partial) payment, the prime contractor shall certify that all subcontractors having an interest in the Contract were paid for satisfactory performance of their Contracts and that the retainage is returned to subcontractors within 30 days after satisfactory completion of the subcontractor’s work. Provide this certification in the form designated by the Department.

Within 30 days of the Contractor’s receipt of the final progress payment or any other payments thereafter, except the final payment, the Contractor shall pay all subcontractors and suppliers having an interest in the Contract for all work completed and materials furnished. The Department will honor an exception to the above when the Contractor demonstrates good cause for not making any required payment and furnishes written notification of any such good cause to both the Department and the affected subcontractors or suppliers within said 30 day period.


The Contractor shall indemnify and provide defense for the Department when called upon to do so for all claims or suits against the Department, by third parties, pertaining to Contractor payment or performance issues arising out of the Contract. It is expressly understood that the monetary limitation on the extent of the indemnification shall be the approved Contract amount, which shall be the original Contract amount as may be increased by subsequent Supplemental Agreements.

July 26, 2024  
PREPARED BY: Desiree Davis

DIVISION II SPEIFICATIONS  
FINANCIAL PROJECT ID(S).443711-2-58-01  
FEDERAL FUNDS  
DISTRICT SEVEN  
HILLSBOROUGH COUNTY

This item has been digitally signed and sealed by Desiree S. Davis on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Date: July 26, 2024  
State of Florida,  
Professional Engineer, License No.: 43260  
Firm/Agency Name: Faller, Davis & Associates, Inc.  
Firm/Agency Address: 1150 Assembly Drive, Suite 400  
City, State, Zip Code: Tampa, FL 33607-4874  
Page(s): 1-36

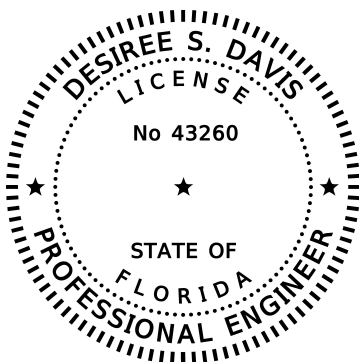

120	EARTHWORK AND RELATED OPERATIONS FOR LAP (Class - D). .....	3
334	ASPHALT CONCRETE FOR LAP (CLASS - D).....	16
344	CONCRETE FOR LOCAL AGENCY PROGRAM (LAP) (CLASS - D). .....	28
	TECHNICAL SPECIAL PROVISIONS. ....	33
	T715 LUMINAIRE BRACKET ARM (GALVANIZED STEEL).....	34

**120 EARTHWORK AND RELATED OPERATIONS FOR LAP (CLASS - D).  
(REV 3-2-22) (FA 7-13-21) (FY 2024-25)**

SECTION 120 is deleted and the following substituted:

**SECTION 120  
EARTHWORK AND RELATED OPERATIONS FOR LAP (CLASS - D)**

**120-1 Description.**

**120-1.1 General:** Perform earthwork and related operations based on the type of work specified in the Contract and the Earthwork Categories as defined below. Meet the applicable requirements for materials, equipment and construction as specified.

Earthwork and related operations consist of excavation for the construction of the roadway, excavation for structures and pipe, constructing backfill around structures and pipe, and constructing embankments as required for the roadway, ditches, and channel changes.

**120-1.2 Earthwork Categories:** Performance of Earthwork Operations will fall into one of the following Earthwork Categories:

**120-1.2.1 Earthwork Category 1:** Includes the earthwork and related operations associated with the construction of sidewalks and bike paths along with any drainage structures associated with these facilities.

**120-1.2.2 Earthwork Category 2:** Includes the earthwork and related operations associated with the construction of turn lanes and other non-mainline traffic lanes, widening, roadway shoulders, concrete box culverts, retaining walls, and other drainage structures on the non-mainline pavement.

**120-1.2.3 Earthwork Category 3:** Includes the earthwork and related operations associated with the construction of new mainline pavement, along with concrete box culverts, retaining walls, and other drainage structures on the mainline pavement.

**120-1.3 Unidentified Areas of Contamination:** When encountering or exposing any abnormal condition indicating the presence of contaminated materials, cease operations immediately in the vicinity and notify the Engineer. The presence of tanks or barrels; discolored earth, metal, wood, ground water, etc.; visible fumes; abnormal odors; excessively hot earth; smoke; or other conditions that appear abnormal may indicate the presence of contaminated materials and must be treated with extreme caution.

Make every effort to minimize the spread of contamination into uncontaminated areas. Immediately provide for the health and safety of all workers at the job site and make provisions necessary for the health and safety of the public that may be exposed to any potentially hazardous conditions. Ensure provisions adhere to all applicable laws, rules or regulations covering potentially hazardous conditions and will be in a manner commensurate with the gravity of the conditions.

The Engineer will notify the Department of a contamination assessment/remediation process plan to determine the course of action necessary for site security and the steps necessary under applicable laws, rules, and regulations for additional assessment and/or remediation work to resolve the contamination issue.

## **120-2 Classifications of Excavation.**

**120-2.1 General:** The Engineer may classify excavation specified under this Section for payment as any of the following: regular excavation, subsoil excavation, lateral ditch excavation, and channel excavation.

The definition of existing surface is a combination of the following:

1. The original unpaved ground line;
2. The bottom of the existing pavement;
3. The bottom of existing features removed by clearing and grubbing;
4. The bottom of the existing base, if the base is to be removed.

The definition of finished graded surface includes the completed grades of side slopes, unpaved shoulders, and the bottom of the base for flexible or rigid pavement.

**120-2.2 Regular Excavation:** Regular excavation includes roadway excavation and borrow excavation, as defined below for each.

: Roadway excavation consists of the excavation and the utilization or disposal of all materials necessary for the construction of the roadway, ditches, channel changes, etc., except as may be specifically shown to be paid for separately and that portion of the lateral ditches within the limits of the roadway right-of-way as shown in the Plans.

Borrow excavation consists of the excavation and utilization of material from authorized borrow pits, including only material that is suitable for the construction of roadway embankments or of other embankments covered by the Contract.

A Cost Savings Initiative Proposal (CSIP) submittal based on using borrow material from within the project limits will not be considered.

**120-2.3 Subsoil Excavation:** Subsoil excavation consists of the excavation and disposal of muck, clay, rock, or any other material that is unsuitable in its original position and that is excavated below the existing surface. For pond and ditches that identify the placement of a blanket material, the existing surface is the bottom of the blanket material. Subsoil excavation also consists of the excavation of all suitable material within the above limits as necessary to excavate the unsuitable material. Consider the limits of subsoil excavation indicated in the Plans as being particularly variable, in accordance with the field conditions encountered.

The quantity of material required to replace the excavated material and to raise the elevation of the roadway to the bottom of the template will be paid for under embankment or borrow excavation (Truck Measure).

**120-2.4 Lateral Ditch Excavation:** Lateral ditch excavation consists of all excavation of inlet and outlet ditches to structures and roadway, and ditches parallel to the roadway right-of-way. Dress lateral ditches to the grade and finished graded surface shown in the Plans.

**120-2.5 Channel Excavation:** Channel excavation consists of the excavation of channels of streams and satisfactory disposal of all materials from the limits of the channel as shown in the Plans.

**120-2.6 Excavation for Structures and Pipe:** Excavation for structures consists of the excavation for bridge foundations, box culverts, pipe culverts, storm sewers and all other pipelines, retaining walls, headwalls for pipe culverts and drains, catch basins, drop inlets, manholes, and similar structures.



**120-3 Preliminary Soils Investigations.**

When the Plans contain the results of a soil survey, do not assume such data is a guarantee of the depth, extent, or character of material present.

**120-4 Excavation Requirements.****120-4.1 Removal of Unsuitable Materials and Existing Roads**

**120-4.1.1 Subsoil Excavation:** Where rock, muck, clay, or other material within the limits of the roadway is unsuitable in its original position, excavate such material to the depth shown in the Plans as the removal limits or as indicated by the Engineer, and backfill with suitable material. Where the removal of plastic soils is required, meet a construction tolerance of  $\pm 0.2$  foot in depth and  $\pm 6$  inches (each side) in width.

**120-4.1.2 Construction over Existing Old Road:** Where a new roadway is to be constructed over an old one, completely remove the existing pavement for the entire limits of the width and depth. If the Plans provide that paving materials may be incorporated into the fill, distribute such material in a manner so as not to create voids. Recompact the old road meeting the requirements of 120-10.2.

**120-4.2 Lateral Ditch Excavation:** Excavate inlet and outlet ditches to structures and roadway, changes in channels of streams and ditches parallel to the roadway. Dress lateral ditches to the grade and finished graded surface shown in the Plans.

**120-4.3 Channel Excavation:** Excavate and dispose of all materials from the limits of the channel as shown in the Plans. Excavate for bridge foundations, box culverts, pipe culverts, storm sewers and all other pipelines, retaining walls, headwalls for pipe culverts and drains, catch basins, drop inlets, manholes, and similar structures.

**120-4.4 Excavation for Structures and Pipe.**

**120-4.4.1 Requirements for all Excavation:** Perform all excavation to foundation materials, satisfactory to the Engineer, regardless of the elevation shown in the Plans. Remove rock, boulders or other hard lumpy or unyielding material to a depth of 12 inches below the bottom of pipes and box culverts elevations. Remove muck or other soft material to the depth indicated in the Plans or as directed by the Engineer.

**120-4.4.2 Earth Excavation:**

**120-4.4.2.1 Foundation Material other than the Rock:** When masonry is to rest on an excavated surface other than rock, take special care to avoid disturbing the bottom of the excavation, and do not remove the final foundation material to grade until just before placing the masonry. In case the foundation material is soft or mucky, the Engineer may require excavation to a greater depth and to backfill to grade with approved material.

**120-4.4.2.2 Foundation Piles:** Where foundation piles are used, complete the excavation of each pit before driving the piles. After the driving is completed, remove all loose and displaced material, leaving a smooth, solid, and level bed to receive the masonry.

**120-4.4.2.3 Removal of Obstructions:** Remove boulders, logs, or any unforeseen obstacles encountered in excavating.

**120-4.4.3 Rock Excavation:** Clean all rock and other hard foundation material, remove all loose material, and cut all rock to a firm surface. Either level, step vertically and horizontally, or serrate the rock, as may be directed by the Engineer. Clean out all seams and fill them with concrete or mortar.

**120-4.4.4 Pipe Trench Excavation:** Excavate trenches for pipes to the elevation of the bottom of the pipe and to a width sufficient to provide adequate working room. Remove

soil not meeting the classification specified as suitable backfill material in 120-8.3.2.2 to a depth of 4 inches below the bottom of the pipe elevation. Remove rock, boulders or other hard lumpy or unyielding material to a depth of 12 inches below the bottom of the pipe elevation. Remove muck or other soft material to a depth necessary to establish a firm foundation. Where the soils permit, ensure that the trench sides are vertical up to at least the mid-point of the pipe.

For pipelines placed above the natural ground line, place and compact the embankment, prior to excavation of the trench, to an elevation at least 2 feet above the top of the pipe and to a width equal to four pipe diameters, and then excavate the trench to the required grade.

For pipe trenches utilizing trench boxes, ensure that the trench box used is of sufficient width to permit thorough tamping of bedding material under and around the pipes as specified in 125-8.1.6.

Do not disturb the installed pipe and its embedment when moving trench boxes. Move the trench box carefully to avoid excavated wall displacement or damage. As the trench box is moved, fill any voids left by the trench box and continuously place and compact the backfill material adjacent to and all along the side of the trench box walls to fill any voids created by the trench box.

## **120-5 Disposal of Surplus and Unsuitable Material.**

**120-5.1 Ownership of Excavated Materials:** Take ownership of the materials and dispose them outside the right-of-way.

**120-5.2 Placement of Muck on Side Slopes:** As an exception to the provisions of 120-5.1, the Contractor may store muck (A-8 material) alongside the roadway, provided there is a clear distance of at least 6 feet between the roadway grading limits and the muck. Do not store such material in a manner which will impede the inflow or outfall of any channel or side ditches. All stored materials that is not used for the final surface material must be disposed of outside the right-of-way.

**120-5.3 Disposal of Paving Materials:** Unless otherwise noted, take ownership of paving materials, such as paving brick, asphalt block, concrete slab, sidewalk, curb and gutter, etc., excavated in the removal of existing pavements, and dispose of them outside the right-of-way. Existing limerock base that is removed may be incorporated in the stabilized portion of the subgrade. If the construction sequence will allow, incorporate all existing limerock base into the project as allowed by the Contract Documents.

**120-5.4 Disposal Areas:** Where the Contract Documents require disposal of excavated materials outside the right-of-way, and the disposal area is not indicated in the Contract Documents, furnish the disposal area without additional compensation.

Provide areas for disposal of removed paving materials out of sight of the project and at least 300 feet from the nearest roadway right-of-way line of any road. If the materials are buried, disregard the 300-foot limitation.

## **120-6 Materials for Embankment.**

**120-6.1 General Requirements for Embankment Materials:** Construct embankments using suitable materials excavated from the roadway or delivered to the jobsite from authorized borrow pits. Embankment material shall not contain muck, stumps, roots, brush, vegetable matter, rubbish, reinforcement bar or other material that does not compact into a suitable and enduring roadbed.

Remove all waste material designated as undesirable. Use material in embankment construction in accordance with Plan details or as the Engineer directs.

Construct the embankment using maximum particle sizes as follows:

1. In top 12 inches: 3-1/2 inches (in any dimension).
2. 12 to 24 inches: 6 inches (in any dimension).
3. In the depth below 24 inches: not to exceed 12 inches (in any dimension) or the compacted thickness of the layer being placed, whichever is less.

Spread all material so that the larger particles are separated from each other to minimize voids between them during compaction. Compact around these rocks in accordance with 120-9.2.

When and where approved by the Engineer, larger rocks (not to exceed 18 inches in any dimension) may be placed outside the 1:2 slope and at least 4 feet or more below the bottom of the base. Compact around these rocks to a firmness equal to that of the supporting soil. Where constructing embankments adjacent to bridge end bents or abutments, do not place rock larger than 3-1/2 inches in diameter within 3 feet of the location of any end-bent piling.

**120-6.2 Use of Materials Excavated from the Roadway and Appurtenances:** Assume responsibility for determining the suitability of excavated material for use on the project in accordance with the applicable Contract Documents. Consider the sequence of work and maintenance of traffic phasing in the determination of the availability of this material.

**120-6.3 Authorization for Use of Borrow:** Use borrow pit only when sufficient quantities of suitable material are not available from roadway and drainage excavation, to properly construct the embankment, subgrade, and shoulders, and to complete the backfilling of structures and pipe. Do not use borrow material until so ordered by the Engineer, and then only use material from approved borrow pits.

**120-6.3.1 Haul Routes for Borrow Pits:** Provide and maintain, at no expense to the Agency, all necessary roads for hauling the borrow material. Where borrow area haul roads or trails are used by others, do not cause such roads or trails to deteriorate in condition.

Arrange for the use of all non-public haul routes crossing the property of any railroad. Incur any expense for the use of such haul routes. Establish haul routes which will direct construction vehicles away from developed areas when feasible and keep noise from hauling operations to a minimum. Advise the Engineer in writing of all proposed haul routes.

**120-6.3.2 Borrow Material for Shoulder Build-up:** When so indicated in the Plans, furnish borrow material with a specific minimum bearing value, for building up of existing shoulders. Blend materials as necessary to achieve this specified minimum bearing value prior to placing the materials on the shoulders. Take samples of this borrow material at the pit or blended stockpile. Include all costs of providing a material with the required bearing value in the Contract unit price for borrow material.

**120-6.4 Materials Used at Pipes, Culverts, etc.:** Construct embankments over and around pipes, culverts, and bridge foundations with selected materials.

## **120-7 Embankment Construction.**

**120-7.1 General:** Construct embankments in sections of not less than 300 feet in length or for the full length of the embankment. Do not construct another LOT over an untested LOT without the Engineer's approval in writing.

For construction of mainline pavement lanes, turn lanes, ramps, parking lots, concrete box culverts and retaining wall systems, a LOT is defined as a single lift of finished embankment not to exceed 500 feet.

For construction of shoulder-only areas, shared use paths, and sidewalks areas, a LOT is defined as a single lift of finished embankment not to exceed 2000 feet.

Isolated compaction operations will be considered as separate LOTs. For multiple phase construction, a LOT shall not extend beyond the limits of the phase.

#### **120-7.2 Dry Fill Method:**

**120-7.2.1 General:** Construct embankments to meet compaction requirements in 120-7 and in accordance with the acceptance program requirements in 120-10.

Construct embankment in the dry whenever normal dewatering equipment and methods can accomplish the needed dewatering.

##### **120-7.2.1.1 Maximum Compacted Lift Thickness Requirements:**

Construct the embankment in successive layers with lifts up to a maximum listed in the table below based on the embankment material classification group.

Table 120-1			
Group	AASHTO Soil Class	Maximum Lift Thickness	Thick Lift Control Test Section Requirements
1	A-3	12 inches	Not Needed
	A-2-4 (No. 200 Sieve $\leq$ 15%)		
2	A-1	6 inches without Control Test Section	Maximum of 12 inches per 120-7.2.1.2
	A-2-4 (No. 200 Sieve $>$ 15%)		
	A-2-5, A-2-6, A-2-7, A-4, A-5, A-6		
	A-7 (Liquid Limit $<$ 50)		

**120-7.2.1.2 Thick Lift Requirements:** For embankment materials classified as Group 2 in Table 120-1 above, the option to perform thick lift construction in successive layers of not more than 12 inches compacted thickness may be used after meeting the following requirements:

1. Demonstrate the possession and control of compacting equipment sufficient to achieve density required by 120-10.5 for the full depth of a thicker lift.
2. Construct a test section of the length of one full LOT of not less than 500 feet.
3. Perform five tests at random locations within the test section.
  - a. All five tests must meet the density required by 120-10.5.
  - b. Identify the test section with the compaction effort and soil classification in the project's records.
4. Obtain Engineer's approval for the compaction effort after completing a successful test section.

In case of a change in compaction effort or soil classification, failing density test, construct a new test section. The Contractor may elect to place material in 6 inches compacted thickness at any time. Construct all layers approximately parallel to the centerline profile of the road.

The Engineer reserves the right to terminate the Contractor's use of thick lift construction. Whenever the Engineer determines that the Contractor is not achieving satisfactory results, revert to the 6-inch compacted lifts.

**120-7.2.1.3 Equipment and Methods:** Provide normal dewatering equipment including, but not limited to, surface pumps, sump pumps and trenching/digging machinery. Provide normal dewatering methods including, but not limited to, constructing shallow surface drainage trenches/ditches, using sand blankets, sumps, and siphons.

When normal dewatering does not adequately remove the water, the Engineer may require the embankment material to be placed in the water or in low swampy ground in accordance with 120-9.2.4.

**120-7.2.2 Placing in Unstable Areas:** When depositing the material in water, or in low swampy ground that will not support the weight of hauling equipment, construct the embankment by dumping successive loads in a uniformly distributed layer of a thickness not greater than necessary to support the hauling equipment while placing subsequent layers. Once sufficient material has been placed so that the hauling equipment can be supported, construct the remaining portion of the embankment in layers in accordance with the applicable provisions of 120-9.2.3 and 120-9.2.6.

**120-7.2.3 Placing on Steep Slopes:** When constructing an embankment on a hillside sloping more than 20 degrees from the horizontal, before starting the fill, deeply plow or cut into steps the surface of the original ground on which the embankment is to be placed.

**120-7.2.4 Placing Outside Standard Minimum Slope:** The standard minimum slope is defined as the plane described by a one (vertical) to two (horizontal) slope downward from the roadway shoulder point or the gutter line, in accordance with Standard Plans, Index 120-001 and 120-002. Where material that is unsuitable for normal embankment construction is to be used in the embankment outside the standard minimum slope, place such material in layers of not more than 18 inches in thickness, measured loose. The Contractor may also place material, which is suitable for normal embankment, outside such standard minimum slope in 18-inch layers. Maintain a constant thickness for suitable material placed within and outside the standard minimum slope, unless placing in a separate operation.

### **120-7.3 Hydraulic Method:**

**120-7.3.1 Method of Placing:** When the hydraulic method is used, as far as practicable, place all dredged material in its final position in the embankment by such method. Place and compact any dredged material that is reworked or moved and placed in its final position by any other method, as specified in 120-9.2. Baffles or any other form of construction may be used if the slopes of the embankments are not steeper than indicated in the Plans. Remove all timber used for temporary bulkheads or baffles from the embankment and fill and thoroughly compact all voids. When placing fill on submerged land, construct dikes prior to beginning of dredging, and maintain the dikes throughout the dredging operation.

**120-7.3.2 Excess Material:** Do not use excess material placed outside the prescribed slopes, below the normal high-water level, to raise the fill. Remove only the portion of this material required for dressing the slopes.

**120-7.3.3 Protection of Openings in Embankment:** Maintain openings in the embankments at the bridge sites. Remove any material which invades these openings or existing channels without additional compensation to provide the same depth of channel as existed before the construction of the embankment. Do not excavate or dredge any material within 200 feet of the toe of the proposed embankment.

**120-8 Backfilling Around Structures and Pipe.****120-8.1 Requirements for Structures and Pipes:**

**120-8.1.1 General:** Backfill around structures and pipe in the dry whenever normal dewatering equipment and methods can accomplish the needed dewatering. A LOT is defined as one lift of backfill material placement, not to exceed 500 feet in length or a single run of pipe connecting two successive structures, whichever is less. Backfill for structures and pipe compacted in one operation will be considered as one LOT within the cover zone. Backfill around structures compacted separately from the pipe will be considered as separate LOTs. Backfill on each side of the pipe for the first lift will be considered a separate LOT. Backfill on opposite sides of the pipe for the remaining lifts will be considered separate LOTs, unless the same compaction effort is applied. Same compaction effort is defined as the same type of equipment (make and model) making the same number of passes on both sides of the pipe. For multiple phases of backfill, a LOT shall not extend beyond the limits of the phase.

When placing backfill within a trench box, each lift of backfill is considered a LOT. Placement of backfill within a trench box limits will be considered a complete operation before trench box is moved for next backfill operation. When the trench box is moved for next backfill operation this will start new LOTs for each lift. Follow the density testing frequency in 125-9.3.1.

**120-8.1.2 Equipment and Methods:** Provide normal dewatering equipment including, but not limited to, surface pumps, sump pumps, wellpoints and header pipe and trenching/digging machinery. Provide normal dewatering methods including, but not limited to, constructing shallow surface drainage trenches/ditches, using sand blankets, perforated pipe drains, sumps, and siphons.

**120-8.1.3 Backfill Materials:** Backfill to the original ground surface or subgrade surface of openings made for structures, with a sufficient allowance for settlement. The Engineer may require that the material used for this backfill be obtained from a source entirely apart from the structure.

Do not allow heavy construction equipment to cross over culvert or storm sewer pipes until placing and compacting backfill material to the finished earthwork grade or to an elevation at least 4 feet above the crown of the pipe.

**120-8.1.4 Use of A-7 Material:** In the backfilling of trenches, A-7 material may be used from a point 12 inches above the top of the pipe up to the elevation shown in the Standard Plans as the elevation for undercutting of A-7 material.

**120-8.1.5 Time of Placing Backfill:** Do not place backfill against any masonry or concrete abutment, wingwall, or culvert until the Engineer has given permission to do so, and in no case until the masonry or concrete has been in place seven days or until the specified 28-day compressive strength occurs.

**120-8.1.6 Placement and Compaction:** Place the material in horizontal layers not exceeding 6 inches compacted thickness in depth above water level, behind abutments, wingwalls and end bents or end rest piers, under the haunches of the pipes, around box culverts, and all structures including pipe culverts. When the backfill material is deposited in water, compact as specified in 125-8.2.5 and 125-8.3.4.

**120-8.1.6.1 Thick Lift Requirements:** The Contractor may elect to place material in thicker lifts of no more than 12 inches compacted thickness above the Soil Envelope if the embankment material is classified as Group 1 in the table below. If the embankment material is classified as Group 2 in the table below and the Contractor chooses to place material

in thicker lifts of no more than 12 inches compacted thickness above the soil envelope, then the Contractor must demonstrate with a successful test section that density can be achieved. Thick lift around structures is only allowed above the soil envelope of the connecting pipe. Notify the Engineer in writing prior to beginning construction of a test section. Construct a test section of the length of one LOT. Perform five quality control tests at random locations within the test section. All five tests must meet the density required by 120-9.2. Identify the test section with the compaction effort and soil classification in the project's records. In case of a change in compaction effort or soil classification, construct a new test section. When a test fails the requirements of 120-9.2, construct a new test section. The Contractor may elect to place material in 6 inches compacted thickness at any time.

Table 120-2					
Group	AASHTO Soil Class	Maximum Lift Thickness		Thick Lift Control Test Section Requirements	
		Within Cover Zone	Above Soil Envelope	Within Cover Zone	Above Soil Envelope
1	A-3	6 inches	12 inches	N/A	Not Needed
	A-2-4 (No. 200 Sieve ≤ 15%)				
2	A-1	6 inches without control test section		N/A	Maximum of 12 inches per 120-7.2.1.2
	A-2-4 (No. 200 Sieve > 15%)				
	A-2-5, A-2-6, A-2-7, A-4, A-5, A-6				
	A-7 (Liquid Limit < 50)				

### 120-8.2 Additional Requirements for Structures Other than Pipe:

**120-8.2.1 Density:** Where the backfill material is deposited in water, obtain a 12 inch layer of comparatively dry material, thoroughly compacted by tamping, before the Engineer verifies layer and density requirements. Meet the requirements of the density Acceptance Criteria.

**120-8.2.2 Box Culverts:** For box culverts over which pavement is to be constructed, compact around the structure to an elevation not less than 12 inches above the top of the structure, using rapid-striking mechanical tampers.

**120-8.2.3 Other Limited Areas:** Compact in other limited areas using mechanical tampers or approved hand tampers, until the cover over the structure is at least 12 inches thick. When hand tampers are used, deposit the materials in layers not more than 4 inches thick using hand tampers suitable for this purpose with a face area of not more than 100 in<sup>2</sup>. Take special precautions to prevent any wedging action against the masonry, and step or terrace the slope bounding the excavation for abutments and wingwalls if required by the Engineer.

**120-8.2.4 Culverts and Piers:** Backfill around culverts and piers on both sides simultaneously to approximately the same elevation.

**120-8.2.5 Compaction Under Wet Conditions:** Where wet conditions do not permit the use of mechanical tampers, compact using hand tampers. Use only A-3 material for the hand tamped portions of the backfill. When the backfill has reached an elevation and

condition such as to make the use of the mechanical tampers practical, perform mechanical tamping in such manner and to such extent as to transfer the compaction force into the sections previously tamped by hand.

**120-8.3 Additional Requirements for Pipe Greater than 12 Inches Inside Diameter:**

**120-8.3.1 General:** Trenches for pipe may have up to four zones that must be backfilled.

**Lowest Zone:** The lowest zone is backfilled for deep undercuts up to within 4 inches of the bottom of the pipe.

**Bedding Zone:** The zone above the Lowest Zone is the Bedding Zone. Usually, it will be the backfill which is the 4 inches of soil below the bottom of the pipe. When rock or other hard material has been removed to place the pipe, the Bedding Zone will be the 12 inches of soil below the bottom of the pipe.

**Cover Zone:** The next zone is the backfill that is placed after the pipe has been laid and will be called the Cover Zone. This zone extends to 12 inches above the top of the pipe. The Cover Zone and the Bedding Zone are considered the Soil Envelope for the pipe.

**Top Zone:** The Top Zone extends from 12 inches above the top of the pipe to the base or final grade.

**120-8.3.2 Material:**

**120-8.3.2.1 Lowest Zone:** Backfill areas undercut below the Bedding Zone of a pipe with coarse sand, or other suitable granular material, obtained from the grading operations on the project, or a commercial material if no suitable material is available.

**120-8.3.2.2 Soil Envelope:** In both the Bedding Zone and the Cover Zone of the pipe, backfill with materials classified as A-1, A-2, or A-3. Material classified as A-4 may be used if the pipe is concrete pipe.

**120-8.3.2.3 Top Zone:** Backfill the area of the trench above the soil envelope of the pipe with materials allowed on Standard Plans, Index 120-001.

**120-8.3.3 Compaction:**

**120-8.3.3.1 Lowest Zone:** Compact the soil in the Lowest Zone to approximately match the density of the soil in which the trench was cut.

**120-8.3.3.2 Bedding Zone:** If the trench was not undercut below the bottom of the pipe, loosen the soil in the bottom of the trench immediately below the approximate middle third of the outside diameter of the pipe.

If the trench was undercut, place the bedding material and leave it in a loose condition below the middle third of the outside diameter of the pipe. Compact the outer portions to meet the density requirements of the Acceptance Criteria. Place the material in lifts no greater than 6 inches (compacted thickness).

**120-8.3.3.3 Cover Zone:** Place the material in 6 inches layers (compacted thickness), evenly deposited on both sides of the pipe, and compact with mechanical tampers suitable for this purpose. Hand tamp material below the pipe haunch that cannot be reached by mechanical tampers. Meet the requirements of the density Acceptance Criteria.

**120-8.3.3.4 Top Zone:** Place the material in layers not to exceed 12 inches in compacted thickness. Meet the requirements of the density acceptance criteria.

**120-8.3.4 Backfill Under Wet Conditions:** Where wet conditions are such that dewatering by normal pumping methods would not be effective, the procedure outlined below may be used when specifically authorized by the Engineer in writing.



Granular material may be used below the elevation at which mechanical tampers would be effective, but only material classified as A-3. Place and compact the material using timbers or hand tampers until the backfill reaches an elevation such that its moisture content will permit the use of mechanical tampers. When the backfill has reached such elevation, use normally acceptable backfill material. Compact the material using mechanical tampers in such manner and to such extent as to transfer the compacting force into the material previously tamped by hand.

The Engineer may permit the use of coarse aggregate below the elevation at which mechanical tampers would be effective. Use coarse aggregate from approved sources for Aggregate Size Number 89, 8, 78, 7, 68, 6, or 57. Place the coarse aggregate such that it will be stable and firm. Fully wrap the aggregate with an appropriate geosynthetic filter fabric, as specified by the Engineer. Do not place coarse aggregate within 4 feet of the ends of the trench or ditch. Use normally accepted backfill material at the ends.

## **120-9 Compaction Requirements.**

**120-9.1 Moisture Content:** Compact the materials at a moisture content such that the specified density can be attained. If necessary, add water to the material, or lower the moisture content by manipulating the material or allowing it to dry, as is appropriate, to attain the specified density.

### **120-9.2 Compaction of Embankments:**

**120-9.2.1 Earthwork Category 1 and 2 Density Requirements:** The Engineer will accept a minimum density of 95% of the maximum density as determined by FM 1-T099 for all earthwork items requiring densities.

**120-9.2.2 Earthwork Category 3 Density Requirements:** The Engineer will accept a minimum of 100% of the maximum density as determined by FM 1-T099 for all densities required under category 3. Except for embankments constructed by the hydraulic method as specified in 120-7.3, and for the material placed outside the standard minimum slope as specified in 120-7.2.4, and for other areas specifically excluded herein, compact each layer of the material used in the formation of embankments to the required density stated above. Uniformly compact each layer using equipment that will achieve the required density, and as compaction operations progress, shape and manipulate each layer as necessary to ensure uniform density throughout the embankment.

**120-9.2.3 Compaction Over Unstable Foundations:** Where the embankment material is deposited in water or on low swampy ground, and in a layer thicker than 12 inches (as provided in 120-7.2.2), compact the top 6 inches (compacted thickness) of such layer to the density as specified in 120-10.5.

**120-9.2.4 Compaction Where Plastic Material Has Been Removed:** Where unsuitable material is removed and the remaining surface is of soil classifications A-4, A-5, A-6, or A-7 per AASHTO M145, as determined by the Engineer, compact the surface of the excavated area by rolling with a sheepfoot roller exerting a compression of at least 250 psi on the tamper feet, for the full width of the roadbed (subgrade and shoulders). Perform rolling before beginning any backfill and continue until the roller feet do not penetrate the surface more than 1 inch. Do not perform such rolling where the remaining surface is below the normal water table and covered with water. Vary the procedure and equipment required for this operation at the discretion of the Engineer.

**120-9.2.5 Compaction for Pipes, Culverts, etc.:** Compact the backfill of trenches to the densities specified for embankment or subgrade, as applicable, and in accordance with the requirements of this section.

Thoroughly compact embankments over and around pipes, culverts, and bridges in a manner which will not place undue stress on the structures, and in accordance with the requirements of this section.

**120-9.2.6 Compaction of Grassed Shoulder Areas:** For the upper 6-inch layer of all shoulders which are to be grassed, since no specific density is required, compact only to the extent needed for planting.

**120-9.2.7 Compaction of Grassed Embankment Areas:** For the outer layer of all embankments where plant growth will be established, do not compact. Leave this layer in a loose condition to a minimum depth of 6 inches for the subsequent seeding or planting operations.

**120-9.3 Compaction of Subgrade:** If the plans do not provide for stabilizing, compact the subgrade in both cuts and fills to the density specified in 120-10.5. For cut areas, determine Standard Proctor Maximum Density in accordance with FM 1-T099 at a frequency of one per mile or when there is a change in soil type, whichever occurs first. For undisturbed soils, do not apply density requirements where constructing paved shoulders is 5 feet or less in width.

Where trenches for widening strips are not of sufficient width to permit the use of standard compaction equipment, perform compaction using vibratory rollers, trench rollers, or other type compaction equipment approved by the Engineer.

Maintain the required density until the base or pavement is placed on the subgrade.

## **120-10 Acceptance Program.**

**120-10.1 Density over 105%:** When a computed dry density results in a value greater than 105% of the applicable Proctor maximum dry density, the Engineer will perform a second density test within 5 feet. If the second density results in a value greater than 105%, investigate the compaction methods, examine the applicable Maximum Density and material description. If necessary, the Engineer will test an additional sample for acceptance in accordance with FM 1-T099.

**120-10.2 Maximum Density Determination:** The Engineer will determine the maximum density and optimum moisture content by sampling and testing the material in accordance with the specified test method listed in 120-10.3.

**120-10.3 Density Testing Requirements:** Compliance with the requirements of 120-10.5 will be determined in accordance FM 1-T 238. The in-place moisture content will be determined for each density in accordance with FM 5-507 (Determination of Moisture Content by Means of a Calcium Carbide Gas Pressure Moisture Tester), or ASTM D 4643 (Laboratory Determination of Moisture Content of Granular Soils by Use of a Microwave Oven).

**120-10.4 Soil Classification and Organic Content:** The Engineer will perform soil classification tests in accordance with AASHTO T88, T89, T90, and FM 1-T267. The Engineer will classify soils in accordance with AASHTO M-145 in order to determine compliance with embankment utilization requirements. The Engineer will verify the organic content test with the criteria specified in Standard Plans, Index 120-001.

**120-10.5 Acceptance Criteria:** The Engineer will accept a minimum density in accordance with 120-9.2 with the following exceptions:

- 1) embankment constructed by the hydraulic method as specified in 120-7.3;
- 2) material placed outside the standard minimum slope as specified in 120-7.2.4;
- 3) other areas specifically excluded herein.

**120-10.6 Frequency:** The Engineer will conduct sampling and testing at a minimum frequency listed in the table below.

Test Name	Frequency
Proctor Maximum Density	One per soil type
Density	1 per LOT (Alternate Lift)
Soil Classification and Organic Content	One per Maximum Density

### **120-11 Maintenance and Protection of Work.**

While construction is in progress, always maintain adequate drainage for the roadbed. Maintain a shoulder at least 3 feet wide adjacent to all pavement or base construction to provide support for the edges.

Maintain and protect all earthwork construction throughout the life of the Contract and take all reasonable precautions to prevent loss of material from the roadway due to the action of wind or water. Repair any slides, washouts, settlement, subsidence, or other mishap which may occur prior to final acceptance of the work. Maintain all channels excavated as a part of the Contract work against natural shoaling or other encroachments to the lines and grades shown in the Plans, until final acceptance of the project.

### **120-12 Construction.**

**120-12.1 Construction Tolerances:** Shape the surface of the earthwork to conform to the lines and grades shown in the Plans. In final shaping of the surface of earthwork, maintain a tolerance of 0.3 foot above or below the finished graded surface with the following exceptions:

1. Shape the surface of shoulders to within 0.1 foot of the finished graded surface.
2. Shape the earthwork to match adjacent pavement, curb, sidewalk, structures, etc.
3. Shape the bottom of ditches so that the ditch impounds no water.
4. When the work does not include construction of base or pavement, shape the entire roadbed (shoulder point to shoulder point) to within 0.1 foot above or below the Plan finished graded surface.

Ensure that the shoulder lines do not vary horizontally more than 0.3 foot from the true lines shown in the Plans.

**120-12.2 Operations Adjacent to Pavement:** Carefully dress areas adjacent to pavement areas to avoid damage to such pavement. Complete grassing of shoulder areas prior to placing the final wearing course. Do not manipulate any embankment material on a pavement surface.

When shoulder dressing is underway adjacent to a pavement lane being used to maintain traffic, exercise extreme care to avoid interference with the safe movement of traffic.

### **120-13 Method of Measurement.**

**120-13.1 Excavation:** Excavation will be paid for by volume, in cubic yards, calculated by the method of average end areas, unless the Engineer determines that another method of calculation will provide a more accurate result. The material will be measured in its original

position by field survey or by photogrammetric means as designated by the Engineer. Measurement for payment will include the excavation of unsuitable material, lateral ditch excavation, channel excavation, and excavation for structures and pipe. Payment will not be made for excavation or embankment beyond the limits shown in the plans or authorized by the Engineer.

**120-13.2 Embankment:** Measurement will be made on a loose volume basis, as measured in trucks or other hauling equipment at the point of dumping on the road. Payment will not be made for embankment beyond the limits shown in the plans or authorized by the Engineer.

#### **120-14 Basis of Payment.**

**120-14.1 General:** Prices and payments for the work items included in this Section will be full compensation for all work described herein, including excavating, dredging, pumping, hauling, placing, and compacting; dressing the surface of the earthwork; and maintaining and protecting the complete earthwork.

**120-14.2 Excavation:** The total quantity of all excavation specified under this Section will be paid for at the Contract unit price for Excavation. No payment will be made for the excavation of any materials which are used for purposes other than those shown in the plans or designated by the Engineer. No payment will be made for materials excavated outside the lines and grades given by the Engineer, unless specifically authorized by the Engineer.

**120-14.3 Embankment:** The total quantity of embankment specified in this Section will be paid for at the Contract unit price for embankment. No payment will be made for materials which are used for purposes other than those shown in the plans or designated by the Engineer. No payment will be made for materials placed outside the lines and grades given by the Engineer.

### **334 ASPHALT CONCRETE FOR LAP (CLASS - D). (REV 3-2-22) (FA 7-2-21) (FY 2024-25)**

SECTION 334 is deleted and the following substituted:

#### **SECTION 334 ASPHALT CONCRETE FOR LAP (OFF-SYSTEM)**

##### **334-1 Description.**

**334-1.1 General:** Construct an Asphalt Concrete pavement based on the type of work specified in the Contract and the Asphalt Work Categories as defined below. Meet the applicable requirements for plants, equipment, and construction requirements as defined below. Use an asphalt concrete mix that meets the requirements of this specification.

**334-1.2 Asphalt Work Mix Categories:** Construction of Asphalt Concrete Pavement will fall into one of the following work categories:

**334-1.2.1 Asphalt Work Category 1:** Includes the construction of bike paths and miscellaneous asphalt.

**334-1.2.2 Asphalt Work Category 2:** Includes the construction of new turn lanes, paved shoulders and other non-mainline pavement locations.

**334-1.2.3 Asphalt Work Category 3:** Includes the construction of new mainline pavement lanes, milling and resurfacing.

**334-1.3 Mix Types:** Use the appropriate mix type as shown in Table 334-1.

Table 334-1 Mix Types			
Asphalt Work Category	Mix Types	Traffic Level	ESALs (millions)
1	Type SP-9.5 <sup>(1)</sup>	A	<0.3
2	Structural Mixes: Types SP-9.5 or SP-12.5 <sup>(1)</sup> Friction Mixes: Types FC-9.5 or FC-12.5 <sup>(1)</sup>	B	0.3 to <3
3	Structural Mixes: Types SP-9.5 or SP-12.5 Friction Mixes: Types FC-9.5 or FC-12.5	C	≥3
(1) Equivalent mixes may be approved as determined by the Engineer. For example, Marshall S-III mixture type is equivalent to Superpave SP-9.5, Marshall S-I is equivalent to Superpave SP-12.5, and Marshall FC-3 is equivalent to Superpave FC-9.5.			

For a Traffic Level A mixture, meet the mix design criteria for a Traffic Level B mixture and for a Traffic Level D mixture meet the mix design criteria for a Traffic Level E mixture.

At no additional cost to the Department, for a Type SP mix the following Traffic Level substitutions are allowed:

Traffic Level E can be substituted for Traffic Level D.

Traffic Level D or E can be substituted for Traffic Level C.

Traffic Level C can be substituted for Traffic Level B.

Traffic Level B or C can be substituted for Traffic Level A.

**334-1.4 Gradation Classification:** Asphalt concrete mixtures are classified as fine and are defined in Standard Specification 334-3.2.2.

The equivalent AASHTO nominal maximum aggregate size Superpave mixes are as follows:

Type SP-9.5, FC-9.5 ..... 9.5 mm

Type SP-12.5, FC-12.5 ..... 12.5 mm

**334-1.5 Thickness:** The total pavement thickness of the asphalt concrete pavement layers will be the plan thickness as shown in the Contract Documents. Before paving, propose a thickness for each individual layer meeting the requirements of this specification, which when combined with other layers (as applicable) will equal the plan thickness. For construction purposes, the plan thickness and individual layer thickness will be converted to spread rate using the following equation:

$$\text{Spread rate (lbs/yd}^2\text{)} = t \times G_{\text{mm}} \times 43.3$$

where:  $t$  = Thickness (in.) (Plan thickness or individual layer thickness)  
 $G_{\text{mm}}$  = Maximum specific gravity from the mix design

For target purposes only, spread rate calculations shall be rounded to the nearest whole number.

**334-1.5.1 Layer Thicknesses:** Unless otherwise called for in the Contract Documents, the allowable layer thicknesses for asphalt concrete mixtures are as follows:

Type SP-9.5, FC-9.5 ..... 1 to 1-1/2 inches

Type SP-12.5 ..... 1-1/2 to 3 inches

Type FC-12.5 ..... 1-1/2 to 2-1/2 inches

**334-1.5.2 Additional Requirements:** The following requirements also apply to asphalt Concrete mixtures:

1. When construction includes the paving of adjacent shoulders (less than or equal to 5 feet wide), the layer thickness for the upper pavement layer and shoulder shall be the same and paved in a single pass, unless otherwise called for in the Contract Documents.

2. For overbuild layers, use the minimum and maximum layer thicknesses as specified above unless called for differently in the Contract Documents. On variable thickness overbuild layers, the minimum and maximum allowable thicknesses will be as specified below, unless called for differently in the Contract Documents.

Type SP-9.5 ..... 3/8 to 2 inches

Type SP-12.5 ..... 1/2 to 3 inches

Type SP-19.0 ..... 1-1/2 to 4 inches

3. Variable thickness overbuild layers constructed using a Type SP-9.5 or SP-12.5 mixtures may be tapered to zero thickness provided the contract documents require a minimum of 1-1/2 inches of dense-graded mix placed over the variable thickness overbuild layer.

**334-1.6 Weight of Mixture:** The weight of the mixture shall be determined as provided in 320-3.2 of the Florida Department of Transportation (FDOT) specifications.

## **334-2 Materials.**

**334-2.1 Superpave Asphalt Binder:** Unless specified elsewhere in the Contract Documents, use an asphalt binder grade as determined from Table 334-2. If the Contract calls for an alternative binder, meet the requirements of FDOT Specification 916.

**334-2.2 Aggregate:** Use aggregate capable of producing a quality pavement. Size, grade and combine the aggregate fractions to meet the grading and physical properties of the mix design. Aggregates from various sources may be combined.

For Type FC mixes, use an aggregate blend that consists of approved friction course aggregates that consists of crushed granite, crushed granitic gneiss, crushed limestone, crushed shell rock, or a combination of the above. As an exception, mixes that contain a minimum of 60% of approved friction course aggregates of crushed granite and/or crushed gneiss may either contain: up to 40% fine aggregate from other sources of aggregate not approved for friction courses or a combination of up to 20% RAP and the remaining fine aggregate from other sources of aggregate not approved for friction courses. Mixtures utilizing High Polymer (HP) binder are not allowed to contain RAP.

A list of aggregates approved for use in friction courses may be available on the FDOT's State Materials Office website. The URL for obtaining this information, if available, is: <https://mac.fdot.gov/>.

### **334-2.3 Reclaimed Asphalt Pavement (RAP) Material:**

**334-2.3.1 General requirements:** RAP may be used as a component of the asphalt mixture subject to the following requirements:

1. Limit the amount of RAP material used in the mix to a maximum of 50% by weight of total aggregate.

2. Assume full responsibility for the design, production and construction of asphalt mixes which incorporate RAP as a component material.

3. Provide stockpiled RAP material that is reasonably consistent in characteristics and contains no aggregate particles which are soft or conglomerates of fines.

4. Provide RAP material having a minimum average asphalt content of 4.0% by weight of total mix. As an exception, when using fractionated RAP, the minimum average asphalt binder content for the coarse portion of the RAP shall be 2.5% by weight of the coarse portion of the RAP. The coarse portion of the RAP shall be the portion of the RAP retained on the No. 4 sieve. The Engineer may sample the stockpile to verify that this requirement is met.

4. When using RAP as a component material, prevent any oversized RAP from being incorporated into the completed mixture by the use of a grizzly or grid over the RAP bin; in-line roller or impact crusher; screen; or other suitable means. If oversized RAP material appears in the completed recycled mix, take the appropriate corrective action immediately. If the appropriate corrective actions are not immediately taken, stop plant operations.

**334-2.3.2 Material Characterization:** Assume responsibility for establishing the asphalt binder content, gradation, viscosity and bulk specific gravity ( $G_{sb}$ ) of the RAP material based on a representative sampling of the material.

**334-2.3.3 Asphalt Binder for Mixes with RAP:** Select the appropriate asphalt binder grade based on Table 334-2

Table 334-2 Asphalt Binder Grade for Mixes Containing RAP	
Percent RAP	Asphalt Binder Grade
0 - 15	PG 67-22
16 - 30	PG 58-22
≥ 30	PG 52-28

### 334-3 Composition of Mixture.

**334-3.1 General:** Compose the asphalt mixture using a combination of aggregate (coarse, fine or mixtures thereof), mineral filler, if required, and asphalt binder material. Size, grade and combine the aggregate fractions to meet the grading and physical properties of the mix design. Aggregates from various sources may be combined.

#### 334-3.2 Mix Design:

**334-3.2.1 General:** Design the asphalt mixture in accordance with AASHTO R 35, except as noted herein. Submit the proposed mix design with supporting test data indicating compliance with all mix design criteria to the Engineer. Prior to the production of any asphalt mixture, obtain the Engineer's conditional approval of the mix design. If required by the Engineer, send representative samples of all component materials, including asphalt binder to a laboratory designated by the Engineer for verification. As an exception to these requirements, use a currently approved FDOT Mix Design.

The Engineer will consider any marked variations from original test data for a mix design or any evidence of inadequate field performance of a mix design as sufficient

evidence that the properties of the mix design have changed, and at his/her discretion, the Engineer may no longer allow the use of the mix design.

**334-3.2.2 Mixture Gradation Requirements:** Combine the coarse and fine aggregate in proportions that will produce an asphalt mixture meeting all of the requirements defined in this specification and conform to the gradation requirements at design as defined in AASHTO M 323. Aggregates from various sources may be combined.

**334-3.2.2.1 Mixture Gradation Classification:** Plot the combined mixture gradation on an FHWA 0.45 Power Gradation Chart. Include the Control Points from AASHTO M, as well as the Primary Control Sieve (PCS) Control Point from AASHTO M. Fine mixes are defined as having a gradation that passes above the primary control sieve control point and above the maximum density line for all sieve sizes smaller than the primary control sieve and larger than the No. 30 sieve. Use only fine mixes.

**334-3.2.3 Gyratory Compaction:** Compact the design mixture in accordance with AASHTO T 312, with the following exception: use the number of gyrations at  $N_{\text{design}}$  as defined in Standard Specification Table 334-4. Measure the inside diameter of gyratory molds in accordance with AASHTO T 312.

**334-3.2.4 Design Criteria:** Meet the requirements for nominal maximum aggregate size as defined in AASHTO M, as well as for relative density, VMA, VFA, and dust-to-binder ratio as specified in AASHTO M 323.  $N_{\text{initial}}$  and  $N_{\text{maximum}}$  requirements are not applicable.

**334-3.2.5 Moisture Susceptibility:**

1. For all traffic levels, use a liquid anti-strip agent listed on the APL at the specified dosage rate. Hydrated lime may be used instead of the liquid anti-strip agent.
2. Provide a mixture having a retained tensile strength ratio of at least 0.80 and a minimum tensile strength (unconditioned) of 100 psi in accordance with FM 1-T 283.

**334-3.2.6 Additional Information:** In addition to the requirements listed above, provide the following information on each mix design:

1. The design traffic level and the design number of gyrations ( $N_{\text{design}}$ ).
2. The source and description of the materials to be used.
3. The Department source number and the FDOT product code of the aggregate components furnished from an FDOT approved source (if required).
4. The gradation and proportions of the raw materials as intended to be combined in the paving mixture. The gradation of the component materials shall be representative of the material at the time of use. Compensate for any change in aggregate gradation caused by handling and processing as necessary.
5. A single percentage of the combined mineral aggregate passing each specified sieve. Degradation of the aggregate due to processing (particularly material passing the No. 200 sieve) should be accounted for and identified.
6. The bulk specific gravity ( $G_{\text{sb}}$ ) value for each individual aggregate and RAP component, as identified in the Department's aggregate control program.
7. A single percentage of asphalt binder by weight of total mix intended to be incorporated in the completed mixture, shown to the nearest 0.1%.
8. A target temperature for the mixture at the plant (mixing temperature) and a target temperature for the mixture at the roadway (compaction temperature). Do not exceed a target temperature of 340°F for High Polymer asphalt binders, 330°F for PG 76-22 asphalt binders, and 315°F for unmodified asphalt binders.



9. Provide the physical properties at the optimum asphalt content, which must conform to all specified requirements.
10. The name of the Construction Training Qualification Program (CTQP) mix designer.
11. The ignition oven and maximum specific gravity (Gmm) calibration factors.
12. The warm mix technology, if used.

### 334-4 Producer Process Control (PC).

Assume full responsibility for controlling all operations and processes such that the requirements of these Specifications are met at all times. Perform any tests necessary at the plant and roadway for process control purposes.

### 334-5 General Construction Requirements.

**334-5.1 Weather Limitations:** Do not transport asphalt mix from the plant to the roadway unless all weather conditions are suitable for the laying operations.

#### 334-5.2 Limitations of Paving Operations:

**334-5.2.1 General:** Place the mixture only when the surface upon which it is to be placed has been previously prepared, is intact, firm, dry, clean, and the tack or prime coat, with acceptable spread rate, is properly broken or cured. Do not place friction course until the adjacent shoulder area has been dressed and grassed.

**334-5.2.2 Ambient Air Temperature:** Place the mixture only when the air temperature in the shade and away from artificial heat meets the requirements of Table 334-3. The minimum ambient temperature requirement may be reduced by 5°F when using warm mix technology, if mutually agreed to by both the Engineer and the Contractor.

Table 334-3 Ambient Air Temperature Requirements for Paving	
Layer Thickness or Asphalt Binder Type	Minimum Temperature (°F)
≤ 1 inch	50
Any mixture > 1 inch containing a PG asphalt binder with a high temperature designation ≥ 76°C	45
Any mixture > 1 inch containing a PG asphalt binder with a high temperature designation < 76°C	40
FC-5 <sup>(1)</sup>	65
<sup>(1)</sup> As an exception, place the mixture at temperatures no lower than 60°F, only when approved by the Engineer based on the Contractor's demonstrated ability to achieve a satisfactory surface texture and appearance of the finished surface. For mixtures containing PG 76-22 binder, the minimum ambient temperature may be further reduced to 55°F when using warm mix technology, if agreed to by both the Engineer and the Contractor.	

**334-5.3 Mix Temperature:** Heat and combine the ingredients of the mix in such a manner as to produce a mixture with a temperature at the plant and at the roadway, within a range of plus or minus 30°F from the target temperature as shown on the mix design. Reject all loads outside of this range. Reject any load or portion of a load of asphalt mix at the plant or at the roadway with a temperature outside of its respective master range shown in Table 334-4. Notify the Engineer of the rejection immediately.

Table 334-4	
Mix Temperature Master Range Tolerance	
Location	Acceptable Temperature Tolerance
Plant	Mixing Temperature $\pm 30^\circ\text{F}$
Roadway (mix in truck)	Compaction Temperature $\pm 30^\circ\text{F}$

**334-5.4 Transportation of the Mixture:** Transport the mixture in trucks of tight construction, which prevents the loss of material and the excessive loss of heat and previously cleaned of all foreign material. After cleaning, thinly coat the inside surface of the truck bodies with soapy water or an asphalt release agent as needed to prevent the mixture from adhering to the beds. Do not allow excess liquid to pond in the truck body. Do not use a release agent that will contaminate, degrade, or alter the characteristics of the asphalt mix or is hazardous or detrimental to the environment. Petroleum derivatives (such as diesel fuel), solvents, and any product that dissolves asphalt are prohibited. Provide each truck with a tarpaulin or other waterproof cover mounted in such a manner that it can cover the entire load when required. When in place, overlap the waterproof cover on all sides so that it can be tied down. Cover each load during cool and cloudy weather and at any time it appears rain is likely during transit with a tarpaulin or waterproof cover. Cover and tie down all loads of friction course mixtures.

**334-5.5 Surface Preparation:**

**334-5.5.1 Cleaning:** Before placing the mixture, clean the surface of the base or underlying pavement of all loose and deleterious material by the use of power brooms or blowers, supplemented by hand brooming where necessary.

**334-5.5.2 Patching and Leveling Courses:** As shown in the plans, bring the existing surface to proper grade and cross-section by the application of patching or leveling courses.

**334-5.5.3 Application over Surface Treatment:** Where an asphalt mix is to be placed over a surface treatment, sweep and dispose of all loose material from the paving area.

**334-5.5.4 Tack Coat:** Use a rate of application as defined in Table 334-5. Control application rate within plus or minus 0.01 gallon per square yard of the target application rate. The target application rate may be adjusted by the Engineer to meet specific field conditions. Determine the rate of application as needed to control the operation. When using PG 52-28, multiply the target rate of application by 0.6.

Table 300-2 Tack Coat Application Rates		
Asphalt Mixture Type	Underlying Pavement Surface	Target Tack Rate (gal/yd <sup>2</sup> ) <sup>1</sup>
Base Course, Structural Course, Dense-Graded Friction Course, Open-Graded Friction Course	Newly Constructed Asphalt Layers	0.06
	Milled Asphalt Pavement Surface, Oxidized and Cracked Asphalt Pavement, Concrete Pavement	0.09
Note 1: Target tack application rates greater than those specified may be used upon approval of the Engineer.		

When using a meter to control the tack or prime application rate, manually measure the volume in the tank at the beginning and end of the application area for a specific target application rate. Perform this operation at a minimum frequency of once per production shift. Resolve any differences between the manually measured method and the meter to ensure the target application rate is met in accordance with this Section. Adjust the application rate if the manually measured application rate is greater than plus or minus 0.01 gallons per square yard when compared to the target application rate.

**334-5.5.5 Curing and Time of Application:** Apply tack coat sufficiently in advance of placing bituminous mix to permit drying, but do not apply tack coat so far in advance that it might lose its adhesiveness as a result of being covered with dust or other foreign material.

**334-5.5.6 Protection:** Keep the tack coat surface free from traffic until the subsequent layer of bituminous hot mix has been laid.

### **334-6 Placing Mixture:**

**334-6.1 Alignment of Edges:** Place all asphalt mixtures by the stringline method to obtain an accurate, uniform alignment of the pavement edge. As an exception, pavement edges adjacent to curb and gutter or other true edges do not require a stringline. Control the unsupported pavement edge to ensure that it will not deviate from the stringline more than plus or minus 1.5 inches.

**334-6.2 Rain and Surface Conditions:** Immediately cease transportation of asphalt mixtures from the plant when rain begins at the roadway. Do not place asphalt mixtures while rain is falling, or when there is water on the surface to be covered. Once the rain has stopped, standing water has been removed from the tacked surface to the satisfaction of the Engineer, and the temperature of the mixture caught in transit still meets the requirements as specified in 334-5.3, the Contractor may then place the mixture caught in transit.

**334-6.3 Checking Depth of Layer:** Check the depth of each layer at frequent intervals to ensure a uniform spread rate that will meet the requirements of the Contract.

**334-6.4 Hand Work:** In limited areas where the use of the paver is impossible or impracticable, the Contractor may place the mixture by hand.

**334-6.5 Spreading and Finishing:** Upon arrival, dump the mixture in the approved paver, and immediately spread and strike-off the mixture to the full width required, and to such loose depth for each course that, when the work is completed, the required weight of mixture per square yard, or the specified thickness, is secured. Carry a uniform amount of mixture ahead of the screed at all times.

**334-6.6 Thickness Control:** Ensure the spread rate is within 5% of the target spread rate, as indicated in the Contract. When determining the spread rate, use, at a minimum, an average of five truckloads of mix and at a maximum, an average of 10 truckloads of mix. When the average spread rate is beyond plus or minus 5% of the target spread rate, monitor the thickness of the pavement layer closely and adjust the construction operations.

When the average spread rate for two consecutive days is beyond plus or minus 5% of the target spread, stop the construction operation at any time until the issue is resolved.

The Engineer will allow a maximum deficiency from the specified spread rate for the total thickness as follows:

1. For pavement of a specified thickness of 2-1/2 inches or more: 50 pounds per

square yard.

2. For pavement of a specified thickness of less than 2-1/2 inches: 25 pounds per square yard.

Address the unacceptable pavement in accordance with 334-5.10.4, unless an alternative approach is agreed upon by the Engineer.

### **334-6.7 Leveling Courses:**

**334-6.7.1 Patching Depressions:** Before spreading any leveling course, fill all depressions in the existing surface as shown in the plans.

**334-6.7.2 Spreading Leveling Courses:** Place all courses of leveling with an asphalt paver or by the use of two motor graders, one being equipped with a spreader box. Other types of leveling devices may be used upon approval by the Engineer.

**334-6.7.3 Rate of Application:** When using Type SP-9.5 (fine graded) for leveling, do not allow the average spread of a layer to be less than 50 pounds per square yard or more than 75 pounds per square yard. The quantity of mix for leveling shown in the plans represents the average for the entire project; however, the Contractor may vary the rate of application throughout the project as directed by the Engineer. When leveling in connection with base widening, the Engineer may require placing all the leveling mix prior to the widening operation.

**334-6.8 Compaction:** For each paving or leveling train in operation, furnish a separate set of rollers, with their operators.

When density testing for acceptance is required, select equipment, sequence, and coverages of rolling to meet the specified density requirement. Regardless of the rolling procedure used, complete the final rolling before the surface temperature of the pavement drops to the extent that effective compaction may not be achieved or the rollers begin to damage the pavement.

No vibratory compaction in the vertical direction will be allowed for layers one inch or less in thickness or, if the Engineer or Contract Documents limit compaction to the static mode only. Compact these layers in the static mode only. Other non-vertical vibratory modes of compaction will be allowed, if approved by the Engineer; however, no additional compensation, cost or time, will be made.

When density testing for acceptance is not required, use a rolling pattern approved by the Engineer.

Use hand tamps or other satisfactory means to compact areas which are inaccessible to a roller, such as areas adjacent to curbs, headers, gutters, bridges, manholes, etc.

### **334-6.9 Joints.**

**334-6.9.1 Transverse Joints:** Construct smooth transverse joints, which are within 3/16 inch of a true longitudinal profile when measured with a 15 foot manual straightedge. The Engineer may waive straightedge requirements for transverse joints at the beginning and end of the project, at the beginning and end of bridge structures, at manholes, and at utility structures if the deficiencies are caused by factors beyond the control of the Contractor such as no milling requirement, as determined by the Engineer. When smoothness requirements are waived, construct a reasonably smooth transitional joint.

**334-6.9.2 Longitudinal Joints:** Place each layer of pavement so all longitudinal construction joints are offset 6 to 12 inches laterally between successive layers. Plan offsets in advance so the longitudinal joints of the friction course are not in wheel path areas. The longitudinal joints for friction course layers should be within 6 inches of the lane edge or at the

center of the lane. The Engineer may waive these requirements where offsetting is not feasible due to the sequence of construction.

**334-6.10 Surface Requirements:** Construct a smooth pavement with good surface texture and the proper cross-slope.

**334-6.10.1 Texture of the Finished Surface of Paving Layers:** Produce a finished surface of uniform texture and compaction with no pulled, torn, raveled, crushed or loosened portions and free of segregation, bleeding, flushing, sand streaks, sand spots, or ripples. Correct any area of the surface that does not meet the foregoing requirements in accordance with 334-6.10.4.

**334-6.10.2 Cross Slope:** Construct a pavement surface with cross slopes in compliance with the requirements of the Contract Documents. Furnish a four-foot-long electronic level accurate to 0.1 degree, approved by the Engineer for the control of cross slope. Make this electronic level available at the jobsite at all times during paving operations.

**334-6.10.3 Pavement Smoothness:** Construct a smooth pavement meeting the requirements of this Specification. Furnish a 15 foot manual and a 15 foot rolling straightedge meeting the requirements of FM 5-509. Obtain a smooth surface on all pavement courses placed, and then straightedge all layers as required by this Specification.

**334-6.10.3.1 Straightedge Testing:**

**334-6.10.3.1.1 Acceptance Testing:** Using a rolling straightedge, test the final (top) layer of the pavement. Test all pavement lanes where the width is constant using a rolling straightedge and document all deficiencies on a form approved by the Engineer. Notify the Engineer of the location and time of all straightedge testing a minimum of 48 hours before beginning testing.

**334-6.10.3.1.2 Final (Top) Pavement Layer:** At the completion of all paving operations, straightedge the final (top) layer either behind the final roller of the paving train or as a separate operation. Address all deficiencies in excess of 3/16 inch in accordance with 334-5.10.4, unless waived by the Engineer. Retest all corrected areas.

**334-6.10.3.1.3 Straightedge Exceptions:** Straightedge testing will not be required in the following areas: shoulders, intersections, tapers, crossovers, sidewalks, bicycle/shared use paths, parking lots and similar areas, or in the following areas when they are less than 250 feet in length: turn lanes, acceleration/deceleration lanes and side streets. The limits of the intersection will be from stop bar to stop bar for both the mainline and side streets.

As an exception, in the event the Engineer identifies an objectional surface irregularity in the above areas, straightedge and address all deficiencies in excess of 3/8 inch in accordance with 334-5.10.4.

**334-6.10.4 Correcting Unacceptable Pavement:** Correct deficiencies in the pavement layer by removing and replacing the full depth of the layer, extending a minimum of 50 feet on both sides (where possible) of the defective area for the full width of the paving lane, at no additional cost.

**334-7 Acceptance of the Mixture.**

**334-7.1 General:** The asphalt mixture will be accepted based on the Asphalt Work Category as defined below:

1. Asphalt Work Category 1 – Certification by the Contractor as defined in 334-7.2.

2. Asphalt Work Category 2 – Certification and process control testing by the Contractor as defined in 334-7.3

3. Asphalt Work Category 3 – Process control testing by the Contractor and acceptance testing by the Engineer as defined in 334-7.4.

**334-7.2 Certification by the Contractor:** On Asphalt Work Category 1 construction, the Engineer will accept the mix on the basis of visual inspection. Submit a Notarized Certification of Specification Compliance letter on company letterhead to the Engineer stating that all material produced and placed on the project meets the requirements of the Specifications. The Engineer may run independent tests to determine the acceptability of the material.

**334-7.3 Certification and Process Control Testing by the Contractor:** On Asphalt Work Category 2 construction, submit a Notarized Certification of Specification Compliance letter on company letterhead to the Engineer stating that all material produced and placed on the project meets the requirements of the Specifications, along with supporting test data documenting all process control testing as described in 334-6.3.1. If required by the Contract, utilize an Independent Laboratory as approved by the Engineer for the process control testing. The mix will also require visual acceptance by the Engineer. In addition, the Engineer may run independent tests to determine the acceptability of the material. Material failing to meet these acceptance criteria will be addressed as directed by the Engineer such as but not limited to acceptance at reduced pay, delineation testing to determine the limits of the questionable material, removal and replacement at no cost to the agency, or performing an Engineering analysis to determine the final disposition of the material.

**334-7.3.1 Process Control Sampling and Testing Requirements:** Perform process control testing at a frequency of once per day. Obtain the samples in accordance with FDOT Method FM 1-T 168. Test the mixture at the plant for gradation ( $P_{-8}$  and  $P_{-200}$ ) and asphalt binder content ( $P_b$ ). Measure the roadway density with 6 inch diameter roadway cores at a minimum frequency of once per 1,500 feet of pavement with a minimum of three cores per day.

Determine the asphalt binder content of the mixture in accordance with FM 5-563. Determine the gradation of the recovered aggregate in accordance with FM 1-T 030. Determine the roadway density in accordance with FM 1-T 166. The minimum roadway density will be based on the percent of the maximum specific gravity ( $G_{mm}$ ) from the approved mix design. If the Contractor or Engineer suspects that the mix design  $G_{mm}$  is no longer representative of the asphalt mixture being produced, then a new  $G_{mm}$  value will be determined from plant-produced mix with the approval of the Engineer. Roadway density testing will not be required in certain situations as described in 334-7.4.1. Assure that the asphalt binder content, gradation and density test results meet the criteria in Table 334-6.

Table 334-6 Process Control and Acceptance Values	
Characteristic	Tolerance
Asphalt Binder Content (percent)	Target $\pm$ 0.55
Passing No. 8 Sieve (percent)	Target $\pm$ 6.00
Passing No. 200 Sieve (percent)	Target $\pm$ 1.50
Roadway Density (daily average)	Minimum 91.5% of $G_{mm}$
Roadway Density (any single core)	Minimum 88.0 % of $G_{mm}$

**334-7.4 Process Control Testing by the Contractor and Acceptance Testing by the Engineer:** On Asphalt Work Category 3, perform process control testing as described in 334-6.3.1. In addition, the Engineer will accept the mixture at the plant with respect to gradation ( $P_{.8}$  and  $P_{200}$ ) and asphalt binder content ( $P_b$ ). The mixture will be accepted on the roadway with respect to density. The Engineer will sample and test the material as described in 334-7.3.1. The Engineer will randomly obtain at least one set of samples per day. Assure that the asphalt content, gradation and density test results meet the criteria in Table 334-6. Material failing to meet these acceptance criteria will be addressed as directed by the Engineer such as but not limited to acceptance at reduced pay, delineation testing to determine the limits of the questionable material, removal and replacement at no cost to the agency, or performing an Engineering analysis to determine the final disposition of the material.

**334-7.4.1 Acceptance Testing Exceptions:** When the total quantity of any mix type in the project is less than 500 tons, the Engineer will accept the mix on the basis of visual inspection. The Engineer may run independent tests to determine the acceptability of the material.

Density testing for acceptance will not be performed on widening strips or shoulders with a width of 5 feet or less, open-graded friction courses, variable thickness overbuild courses, leveling courses, any asphalt layer placed on subgrade (regardless of type), miscellaneous asphalt pavement, bike/shared use paths, crossovers, gore areas, or any course with a specified thickness less than 1 inch or a specified spread rate less than 100 lb per square yard. Density testing for acceptance will not be performed on asphalt courses placed on bridge decks or approach slabs; compact these courses in static mode only. In addition, density testing for acceptance will not be performed on the following areas when they are less than 500 feet (continuous) in length: turning lanes, acceleration lanes, deceleration lanes, shoulders, parallel parking lanes, or ramps. Do not perform density testing for acceptance in situations where the area requiring density testing is less than 50 tons. Density testing for acceptance will not be performed in intersections. The limits of the intersection will be from stop bar to stop bar for both the mainline and side streets. A random core location that occurs within the intersection shall be moved forward or backward from the intersection at the direction of the Engineer. Compact these courses in accordance with a standard rolling procedure approved by the Engineer. In the event that the rolling procedure deviates from the approved procedure, placement of the mix will be stopped.

### **334-8 Method of Measurement.**

For the work specified under this Section, the quantity to be paid for will be the weight of the mixture, in tons.

The bid price for the asphalt mix will include the cost of the liquid asphalt and the tack coat application as specified in 334-5.5.4. There will be no separate payment or unit price adjustment for the asphalt binder material in the asphalt mix.

### **334-9 Basis of Payment.**

**334-.1 General:** Price and payment will be full compensation for all the work specified under this Section.

**344 CONCRETE FOR LOCAL AGENCY PROGRAM (LAP) (CLASS - D).**  
**(REV 6-9-2021) (FA 7-2-21) (FY 2024-25)**

SECTION 344 is deleted and the following substituted:

**SECTION 344**  
**CONCRETE FOR LAP (OFF-SYSTEM)**

**344-1 Description.**

**344-1 General:** Construct concrete structures and other concrete members, based on the type of work as described in the Contract Documents and the concrete work categories as defined below.

**344-1.2 Work Categories:** Construction will fall into one of the following concrete work categories:

**344-1.2.1 Concrete Work Category 1:** Includes the construction of cast-in-place nonstructural concrete; including sidewalks, curb and gutter, ditch and slope pavement, or other non-reinforced cast-in-place elements.

**344-1.2.2 Concrete Work Category 2:** Includes the construction of precast and prestressed concrete products.

**344-1.2.2.1 Precast Concrete Drainage Structures:** Includes but are not limited to reinforced and non-reinforced concrete pipes, french drains, underdrains, inlets, manholes, junction boxes, endwalls, pipe culverts, storm sewers, and box culverts.

**344-1.2.2.1 Incidental Precast/Prestressed Concrete Structures:** Includes the fabrication, storage, transportation, and erection of prestressed concrete poles, concrete bases for light poles, highway sign foundations, retaining wall systems, traffic separators, sound barriers or other structural precast elements.

**344-1.2.3 Concrete Work Category 3:** Includes the work associated with the placement and/or construction of structural cast-in-place concrete meeting the requirements of this section.

**344-2 Materials.**

**344-2.1 General:** Use concrete composed of a mixture of portland cement, aggregates, and water, with or without chemical or mineral admixtures and supplementary cementitious materials that meet the following requirements:

**344-2.1.1 Portland Cement:** Portland cements meeting the requirements of AASHTO M 85 or ASTM C150 is required. Different brands of cement, cement of the same brand from different facilities or different types of cement shall be stored separately and shall not be mixed.

**344-2.1.2 Coarse and Fine Aggregates:** Aggregates shall meet ASTM C33.

**344-2.1.3 Water:** Water shall meet the requirements of ASTM C 1602.

**344-2.1.4 Chemical Admixtures:** Use chemical admixtures shall be listed on the FDOT Approved Products List (APL). Admixtures may be added at the dosage rates recommended by the manufacturer.

**344-2.1.5 Types of Cement:** Unless a specific type of cement is designated in the Contract Documents, use Type I, Type IL, Type IP, Type IS, Type II, Type II (MH) or Type III cement in all classes of concrete. Use Type IL or Type II (MH) for all mass concrete elements.



**344-2.1.6 Supplementary Cementitious Materials:** Supplementary Cementitious Materials shall meet the requirements of ASTM C618 and ASTM C 989, respectively. Fly ash shall not include the residue resulting from the burning of municipal garbage or any other refuse with coal, or the burning of industrial or municipal garbage in incinerators.

**344-3 Production, Mixing and Delivery of Concrete.**

**344-3.1 Concrete Production Requirements:**

**344-3.1.1 Category 1:** Use a concrete production facility that is certified by the National Ready Mixed Concrete Association (NRMCA) or listed on the FDOT list of non-structural concrete producers. Concrete production facilities listed on the FDOT Producers with Accepted QC Programs list for structural concrete may also be used for Category 1.

**344-3.1.2 Category 2:** Obtain precast concrete products from plants that are currently on the FDOT's Production Facility Listing for the types of products that they are producing.

**344-3.1.3 Category 3:** Obtain structural concrete from a plant that is currently on the FDOT's Production Facility Listing for structural concrete.

**344-3.2 Classes of Concrete:** Meet the requirements of Table 344-1.

Table 344-1 Master Proportion Table <sup>(7)</sup>				
Class of Concrete	28-day Specified Minimum Compressive Strength ( $f_c'$ ) (psi)	Maximum Water to Cementitious Materials Ratio (pounds per pounds)	Minimum Total Cementitious Materials Content (lb/yd <sup>3</sup> )	Target Slump Value (inches) <sup>(3)</sup>
Category 1				
Class NS	2,500	N/A	N/A	N/A
Category 3				
I <sup>(1)</sup>	3,000	0.53	470	3 <sup>(2)</sup>
I (Pavement)	3,000	0.50	470	1.5 or 3 <sup>(5)</sup>
II <sup>(1)</sup>	3,400	0.53	470	3 <sup>(2)</sup>
II (Bridge Deck)	4,500	0.44	600 <sup>(8)</sup>	3 <sup>(2)</sup>
III <sup>(4)</sup>	5,000	0.44	600 <sup>(8)</sup>	3 <sup>(2)</sup>
III (Seal)	3,000	0.53	600 <sup>(8)</sup>	8
IV	5,500	0.41 <sup>(6)</sup>	600 <sup>(8)</sup>	3 <sup>(2)</sup>
IV (Drilled Shaft)	4,000	0.41	600 <sup>(8)</sup>	8.5
V (Special)	6,000	0.37 <sup>(6)</sup>	600 <sup>(8)</sup>	3 <sup>(2)</sup>
V	6,500	0.37 <sup>(6)</sup>	600 <sup>(8)</sup>	3 <sup>(2)</sup>
VI	8,500	0.37 <sup>(6)</sup>	600 <sup>(8)</sup>	3 <sup>(2)</sup>
VII	10,000	0.37 <sup>(6)</sup>	600 <sup>(8)</sup>	3 <sup>(2)</sup>
Notes: (1) For precast three-sided culverts, box culverts, endwalls, inlets, manholes and junction boxes, the target slump value and air content will not apply. The maximum allowable slump is 6 inches, except as noted in (2). The Contractor is permitted to use concrete meeting the requirements of ASTM C478 (4,000 psi) in lieu of the specified Class I or Class II concrete for precast endwalls, inlets, manholes and junction boxes. (2) The Engineer may allow a maximum target slump of 7 inches when a Type F, G, I or II admixture is used. When flowing concrete is used, meet the requirements of Section 8.6 of the FDOT Materials Manual. (3) For a reduction in the target slump for slip-form operations, submit a revision to the mix design to the Engineer. The target slump for slip-form mix is 1.50 inches. (4) When precast three-sided culverts, box culverts, endwalls, inlets, manholes or junction boxes require a Class III concrete, the minimum cementitious materials content is 470 pounds per cubic yard. Do not apply the air content range and the maximum target slump shall be 6 inches, except as allowed in (2). (5) Meet the requirements of Section 350 of FDOT Specifications. (6) When silica fume or metakaolin is required, the maximum water to cementitious material ratio will be 0.35. When ultrafine fly ash is used, the maximum water to cementitious material ratio will be 0.30. (7) Tolerance for slump is $\pm 1.5$ inches and Air Content range is 0.0% to 6.0%. (8) The minimum total amount of cementitious materials content of 600 pounds per cubic yard is required for extremely aggressive environment. For moderately and slightly aggressive environments, the required amounts are 550 lb/yd <sup>3</sup> and 510 lb/yd <sup>3</sup> , respectively.				

**344-3.3 Contractors Quality Control:** For Categories 1 and 2, assume full responsibility for controlling all operations and processes such that the requirements of these Specifications are always met.

For Category 3, furnish a Quality Control (QC) plan to identify to the Engineer how quality will be ensured at the project site. During random inspections, the Engineer will use this document to verify that the construction of the project agrees with the QC plan.

**344-3.4 Concrete Mix Design:** Before producing any Category 1 or Category 2 concrete, submit the proposed mix designs to the Engineer. For Category 3, submit to the Engineer for

approval, FDOT approved mix designs. Do not use concrete mix designs without prior approval of the Engineer.

Materials may be adjusted provided that the theoretical yield requirement of the approved mix design is met. Show all required original approved design mix data and batch adjustments on an Engineer approved concrete delivery ticket.

**344-3.5 Delivery:** For Category 3, the maximum allowable transit time of concrete is 90 minutes. For critical placements, with the Engineer's approval, the transit time may be extended to the allowable mixing time shown in the mix design.

Furnish a delivery ticket on a form approved by the Engineer with each batch of concrete before unloading at the placement site. Record material quantities incorporated into the mix on the delivery ticket. Ensure that the Batchers responsible for producing the concrete signs the delivery ticket certifying that the batch was produced and delivered in accordance with these requirements. Sign the delivery ticket certifying that the concrete was placed in accordance with these requirements.

#### **344-3.6 Placing Concrete:**

**344-3.6.1 Concreting in Cold Weather:** Do not mix or place concrete when the air temperature at placement is below 40°F.

During the curing period, if the National Oceanic and Atmospheric Administration (NOAA) predicts the ambient temperature to fall below 35°F for 12 hours or more or to fall below 30°F for more than 4 hours, enclose the structure in such a way that the air temperature within the enclosure can be kept above 50°F for a period of 3 days after placing the concrete or until the concrete reaches a minimum compressive strength of 1,500 psi.

Assume all risks connected with the placing and curing of concrete. Although the Engineer may give permission to place concrete, the Contractor is responsible for satisfactory results. If the placed concrete is determined to be unsatisfactory, remove, dispose of, and replace the concrete at no expense to the Agency.

**344-3.6.2 Concreting in Hot Weather:** For Category 3, hot weather concreting is defined as the production, placing and curing of concrete when the concrete temperature at placing exceeds 86°F but is less than 100°F.

Spray reinforcing bars and metal forms with cool fresh water just prior to placing the concrete in a method approved by the Engineer.

Assume all risks associated with the placing and curing of concrete. Although the Engineer may give permission to place concrete, the Contractor is responsible for satisfactory results. If the placed concrete is determined to be unsatisfactory, remove, dispose of, and replace the concrete at no expense to the Agency.

Unless the specified hot weather concreting measures are in effect, reject concrete exceeding 85°F at the time of placement. Regardless of special measures taken, reject concrete exceeding 100°F. Predict the concrete temperatures at placement time and implement hot weather measures to avoid production shutdown.

**344-3.7 Mixers:** For Category 3 concrete, do not place concrete from a truck mixer that does not have a current FDOT mixer identification card.

**344-3.8 Small Quantities of Concrete:** With approval of the Engineer, small quantities of concrete, less than 3 cubic yards placed in one day and less than 0.5 cubic yards placed in a single placement may be accepted using a pre-bagged mixture. The Engineer may verify that the pre-bagged mixture is prepared in accordance with the manufacturer's recommendations and will meet the requirements of this Specification.

**344-3.9 Sampling and Testing:**

**344-3.9.1 Category 1:** The Engineer may sample and test the concrete to verify its quality. The minimum 28 day compressive strength requirement for this concrete is 2,500 psi.

**344-3.9.2: Category 2:** No sampling and testing is required by the Engineer for category 2.

**344-3.9.3 Category 3:** The Engineer will randomly select a sample from each LOT to determine its plastic properties and to make three 4 x 8 inch cylinders for testing by the Engineer at 28 days to ensure that the design compressive strength has been met for the class of concrete as specified in Table 344-1. A LOT is defined as the concrete placement of 200 cubic yards or one day's production, whichever is less.

**344-3.10 Records:** Ensure the following records are available for review for at least 3 years after final acceptance of the project:

1. Accepted concrete Plant QC Plan.
2. Approved concrete mix designs.
3. Materials source (delivery tickets, certifications, certified mill test reports).
4. A copy of the scale company or testing agency report showing the signature of the scale company representative, date of inspection, observed deviations from quantities checked during calibration of the scales and meters.
5. A copy of the documentation certifying the admixture weighing/measuring devices.
6. Aggregate moisture control records including date and time of test.
7. Manufacturer's mixer information.
8. Certification documents for admixture weighing and measuring dispensers.
9. A daily record of all concrete batched for delivery to the projects, including respective mix design numbers and quantities of batched concrete.

**344-4 Acceptance of the Work.**

**344-4.1 Category 1 Work:** Category 1 work will be accepted based on certification by the batcher and contractor on the delivery ticket.

**344-4.2 Category 2 Work:** Certify that the precast elements were produced by production facilities that are currently on the FDOT's Production Facility Listing for the types of products that they are producing. In addition, the producer's logo shall be stamped on the element. The producer shall not use the Florida Department of Transportation QC stamp on elements used on this project. Provide a statement of certification from the manufacturer of the precast element that the element meets the requirements of this Specification.

**344-4.3 Category 3 Work:** Category 3 concrete will be accepted based on the Engineer's test results for plastic properties and compressive strength requirements for the class of concrete as defined in Table 344-2. In addition, a Delivery Ticket as described in 344-3.5 will be required for acceptance of the material at the project site.

**344-4.4 Small Quantities of Concrete:** Category 3 concrete meeting the definition of 344-3.8 will be accepted in accordance with 344-4.3 based on test results for plastic properties and compressive strength.

**344-5 Method of Measurement.**

The quantities to be paid for will be the items shown in the plans, completed and accepted.

**344-6 Basis of Payment.**

Prices and payments will be full compensation for all work and materials specified in this Section.

**TECHNICAL SPECIAL PROVISIONS.**

The following Technical Special Provision is individually signed and sealed but is included as part of this Specifications Package.

T715 LUMINAIRE BRACKET ARM (GALVANIZED STEEL)

TECHNICAL SPECIAL PROVISION

FOR

T715 LUMINAIRE BRACKET ARM (GALVANIZED STEEL)

FINANCIAL PROJECT ID 443711-2-58-01

*This item has been digitally signed and sealed by Patricia T. Christie, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.*

Date:	<u>January 24, 2022</u>
Fla. License No.:	<u>60049</u>
Firm Name:	<u>Faller, Davis and Associates, Inc.</u>
Firm Address:	<u>4200 W. Cypress Street, Suite 500</u>
City, State, Zipcode:	<u>Tampa, Florida 33607</u>
Pages:	<u>1-3</u>



## **T715 - LUMINAIRE BRACKET ARM (GALVANIZED STEEL)**

### **T715-1 Description.**

The work in this Technical Special Provision consists of furnishing and installing galvanized steel luminaire bracket arm intended for use with galvanized steel signal poles, mast arm structures or other galvanized steel structures utilized to accommodate luminaires for highway lighting in accordance with the details shown in the Contract Documents, subject to a five year warranty period as defined herein. The warranty will only apply when the luminaire bracket arm is painted as called for in the Contract Documents.

### **T715-2 Material.**

Obtain steel bracket arms from a fabrication facility that is listed on the Department's Production Facility Listing. Producers seeking inclusion on the list shall meet the requirements of Section 105. Use coating products meeting the requirements of FDOT Standard Specification Section 975. Signed and sealed shop drawings (including calculations) for the Luminaire arm and bracket assembly shall be provided. Shop drawings and calculations shall be signed and sealed by a professional engineer licensed in the state of Florida. The luminaire arm to upright connection shall be a bracket/clamp type connection. Strap type bracket arm connections shall not be permitted.

### **T715-3 Fabrication.**

Fabricate steel luminaire bracket arm and miscellaneous hardware in accordance with the Contract Documents. Cut all materials to the final dimensions and complete all welding prior to galvanizing. Obtain all components from the same fabricator. Before shipping, assemble all components to ensure proper fit.

Hole openings in the steel mast arm pole to accommodate wiring for the luminaire head shall be detailed in the shop drawings. Weather tight rubber grommets shall be provided to ensure water proofing of the hole opening.

Ensure all components are protected from damage during shipping and handling by wrapping or other effective methods. Replace any component, which the Engineer determines is damaged beyond repair, at no additional cost to the Department. If components are wrapped for shipment, remove wrappings no later than five days after receipt of components or immediately if the wrappings become saturated. Post these instructions in brightly colored wording on the wrapper. Failure to comply with these instructions may lead to damage of the coating system and will be cause for the rejection of the component.

### **T715-4 Coatings.**

Luminaire, bracket assembly and hardware (nuts, bolts, etc..) shall comply with the coating and warranty requirements outlined in FDOT Standard Specifications 649-4 & 962.

### **T715-5 Installation Requirements.**

Install galvanized luminaire bracket arm in accordance with the manufacturer's recommended installation procedure, the contract documents and shop drawings.

**T715-6 Method of Measurement.**

Measurement for payment shall include all equipment, labor, and materials necessary for a complete and accepted installation.

**T715-7 Basis of Payment.**

Price and payment will be full compensation for all work specified in this Technical Special Provision.

Payment will be made under:

Item No. 715-5-32, Luminaire & bracket arm- F&I, Galvanized Steel - each



CONTRACT PLANS COMPONENTS

ROADWAY PLANS

CITY OF TAMPA

CONTRACT PLANS

INDEX OF ROADWAY PLANS

SHEET NO.	SHEET DESCRIPTION
1	KEY SHEET
2, 2A <sup>1</sup>	SIGNATURE SHEET
3 - 4	SUMMARY OF PAY ITEMS
5	TYPICAL SECTION
6	TYPICAL SECTION DETAILS
7	PROJECT CONTROL
8 - 9	GENERAL NOTES
10	ROADWAY PLAN
11 - 12	CROSS SECTIONS
13 - 15	TEMPORARY TRAFFIC CONTROL PLAN
16	UTILITY ADJUSTMENT
17	SIGNING AND MARKING PLAN
18 - 19	SIGNALIZATION PLAN
20	PEDESTRIAN SIGNAL DETAIL
21	STANDARD MAST ARM TABULATION
22	GUIDE SIGN WORK SHEET
23	STANDARD MAST ARM ASSEMBLIES DATA TABLE
24	REPORT OF CORE BORINGS
25	TABULATION OF QUANTITIES
SQ-1 - SQ-5	SUMMARY OF QUANTITIES

UTV-1 - UTV-2\* VERIFIED UTILITY LOCATE

\* THESE SHEETS ARE INCLUDED IN THE INDEX OF ROADWAY PLANS ONLY TO INDICATE THAT THEY ARE PART OF THE ROADWAY PLANS. THESE SHEETS ARE CONTAINED IN A SEPARATE DIGITALLY SIGNED AND SEALED DOCUMENT.

GOVERNING STANDARD PLANS:

Florida Department of Transportation, FY2024-25 Standard Plans for Road and Bridge Construction and applicable Interim Revisions (IRs).

Standard Plans for Road Construction and associated IRs are available at the following website: <http://www.fdot.gov/design/standardplans>

GOVERNING STANDARD SPECIFICATIONS:

Florida Department of Transportation, FY2024-25 Standard Specifications for Road and Bridge Construction at the following website: <http://www.fdot.gov/programmanagement/Implemented/SpecBooks>


FINANCIAL PROJECT ID 443711-2-58-01

(FEDERAL FUNDS)  
HILLSBOROUGH COUNTY (10190)

W. CLEVELAND STREET AT S. ROME AVENUE



LOCATION OF PROJECT  
<https://goo.gl/maps/xRa32xeFzBEoAnRGA>

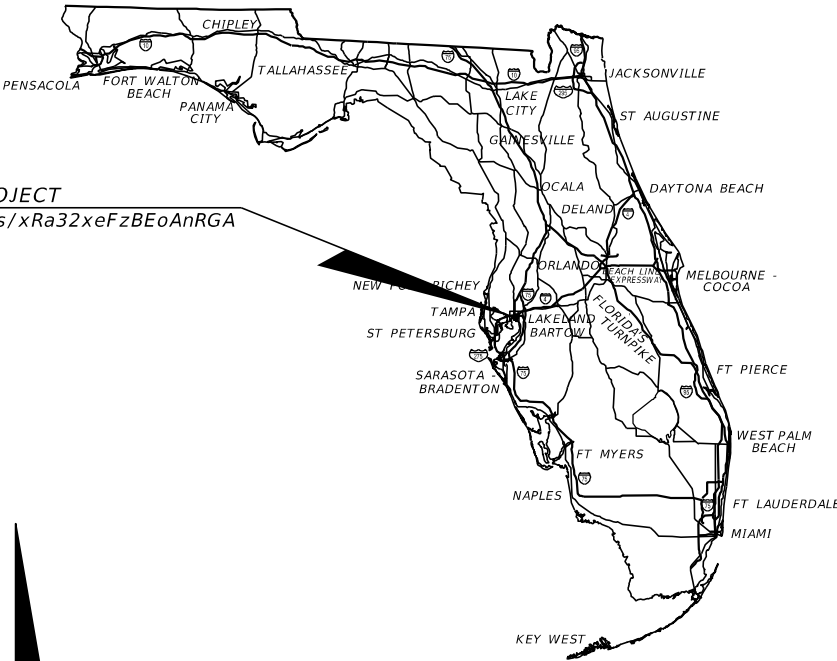

END PROJECT  
STA. 103+10.42  
MP 0.100

KEY SHEET REVISIONS	
DATE	DESCRIPTION
07/23/24	ADDED SHEET 2A

ROADWAY PLANS  
ENGINEER OF RECORD:

KENNETH R. MUZYK, JR., P.E. NO.: 44076  
FALLER, DAVIS & ASSOCIATES, INC.  
1150 ASSEMBLY DRIVE, SUITE 400  
TAMPA, FLORIDA 33607-4874  
(813) 261-5136  
VENDOR NO. F592594956001


PROJECT MANAGER:

JAE-SANG LEE


REVISIONS:

<sup>1</sup> ROADWAY SHEET: 1, 2A (REVISED 07/23/24)

CONSTRUCTION CONTRACT NO.	FISCAL YEAR	SHEET NO.
	25 <sup>1</sup>	1

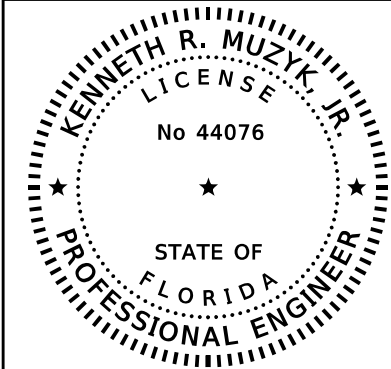

THIS ITEM HAS BEEN DIGITALLY  
SIGNED AND SEALED BY



ON THE DATE ADJACENT TO THE SEAL

PRINTED COPIES OF THIS DOCUMENT ARE  
NOT CONSIDERED SIGNED AND SEALED  
AND THE SIGNATURE MUST BE VERIFIED  
ON ANY ELECTRONIC COPIES.

FALLER, DAVIS & ASSOCIATES, INC  
1150 ASSEMBLY DRIVE, SUITE 400  
TAMPA, FLORIDA 33607-4874  
KENNETH R. MUZYK, JR., P.E. NO.: 44076

THE ABOVE NAMED PROFESSIONAL ENGINEER SHALL BE RESPONSIBLE FOR THE  
FOLLOWING SHEETS IN ACCORDANCE WITH RULE 61G15-23.004, F.A.C.

ROADWAY PLANS

SHEET NO.	SHEET DESCRIPTION
1	KEY SHEET
2A	SIGNATURE SHEET

REVISIONS				FALLER, DAVIS & ASSOCIATES, INC 1150 ASSEMBLY DRIVE, SUITE 400 TAMPA, FLORIDA 33607-4874 KENNETH R. MUZYK, JR., P.E. NO.: 44076	CITY OF TAMPA			SIGNATURE SHEET	SHEET NO.
DATE	DESCRIPTION	DATE	DESCRIPTION		ROAD NO.	COUNTY	FINANCIAL PROJECT ID		2A
07/23/24	1 ADDED NEW SHEET					HILLSBOROUGH	443711-2-58-01		