### The Enclosed Document Is Provided For Your Convenience.

## Please Email ALL Questions:


MailTo:ContractAdministration@TampaGov.net


City of Tampa
Contract Administration Department
306 E. Jackson St. #280A4N
Tampa, FL 33602
(813)274-8456

# CITY OF TAMPA

# CORDELIA AND GRECO PUMP STATION REHABILITATION

100% PLANS CONTRACT NO. 18-C-00042

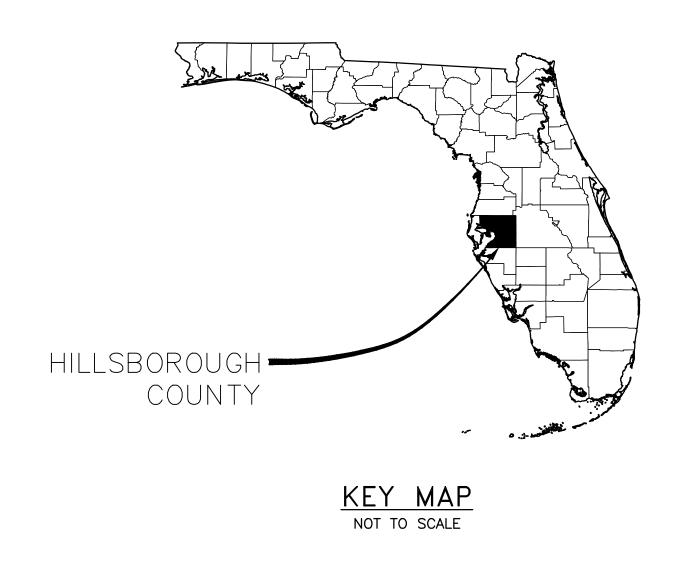

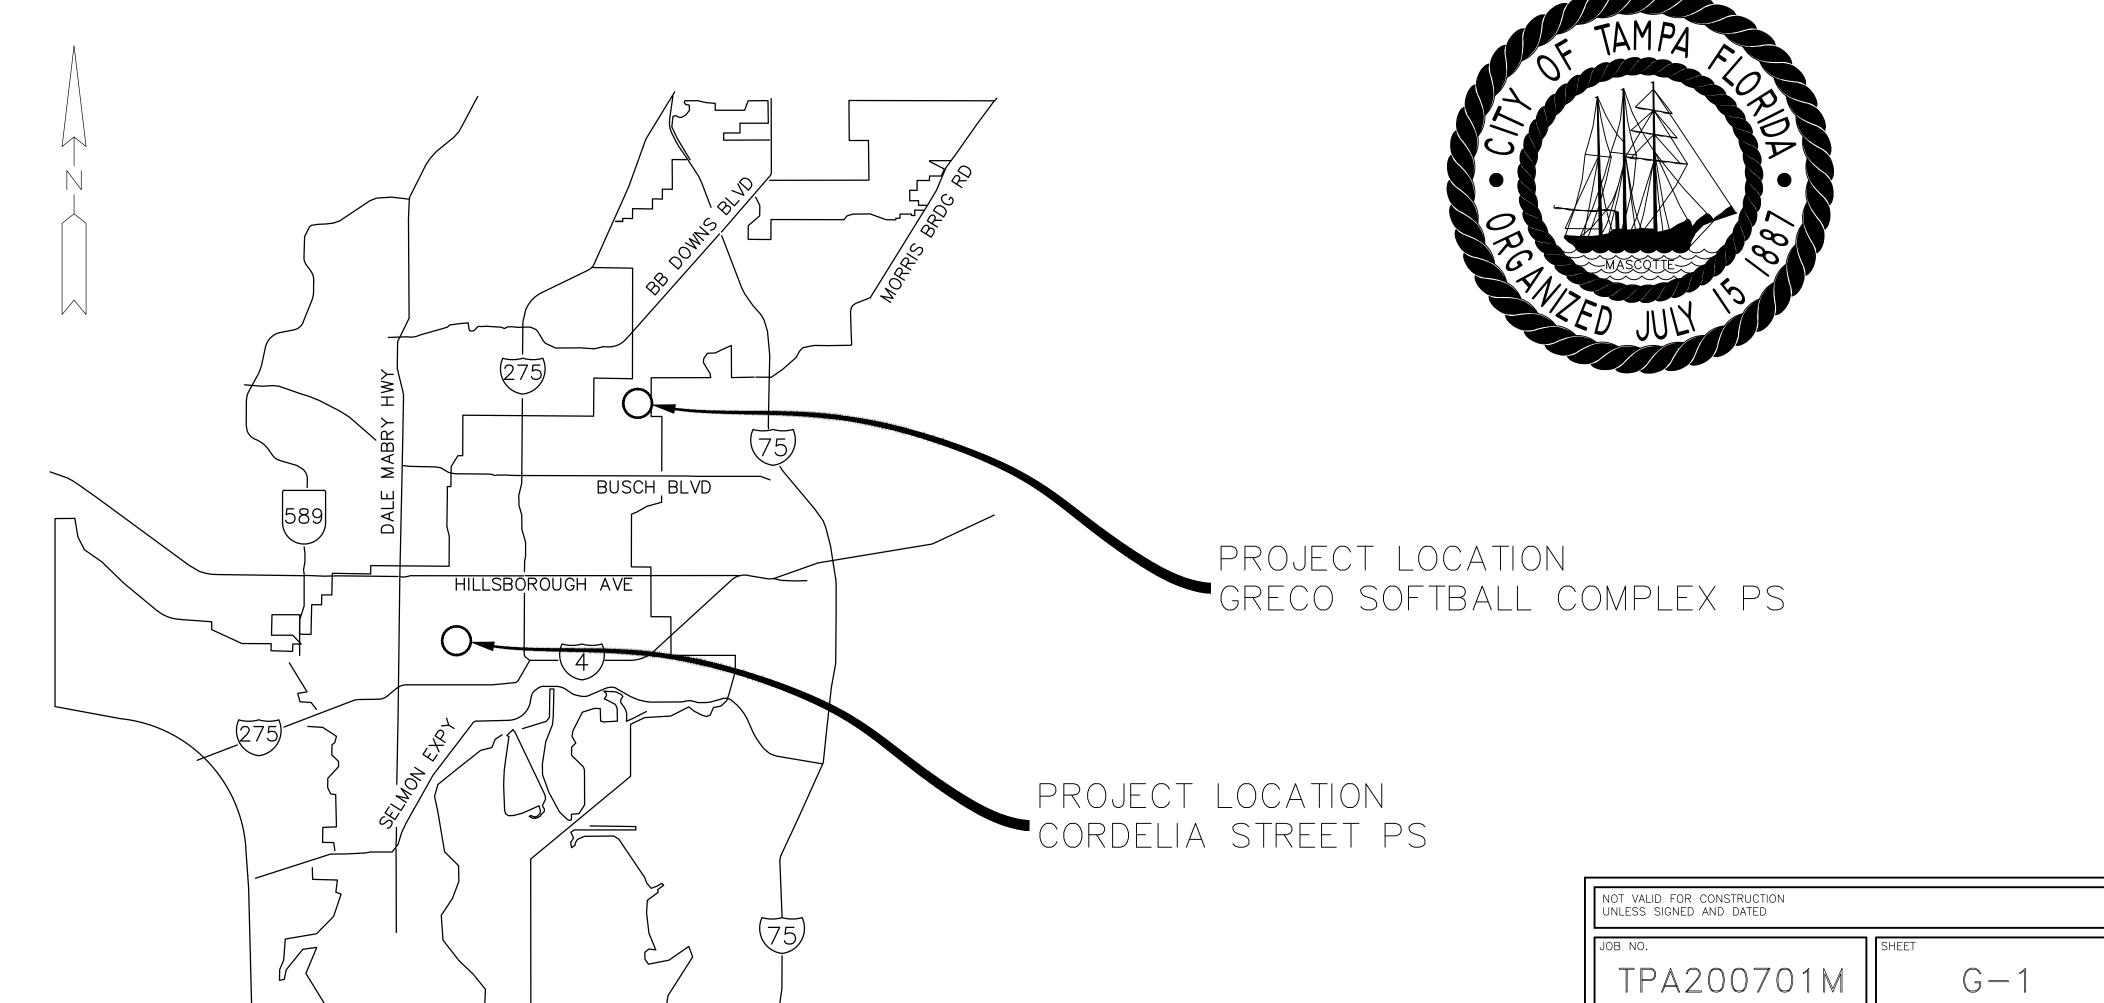



Ricardo G Borromeo, P.E.

LICENSE NO.


<u>ISSUED FOR:</u> 100% DESIGN


11-20-2018

# CITY OF TAMPA

# CORDELIA STREET PUMP STATION REHABILITATION


100% PLANS CONTRACT NO. 18-C-00042

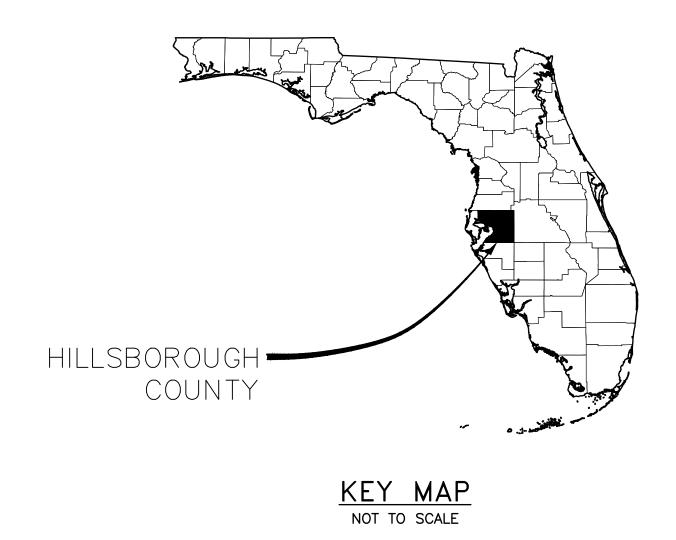


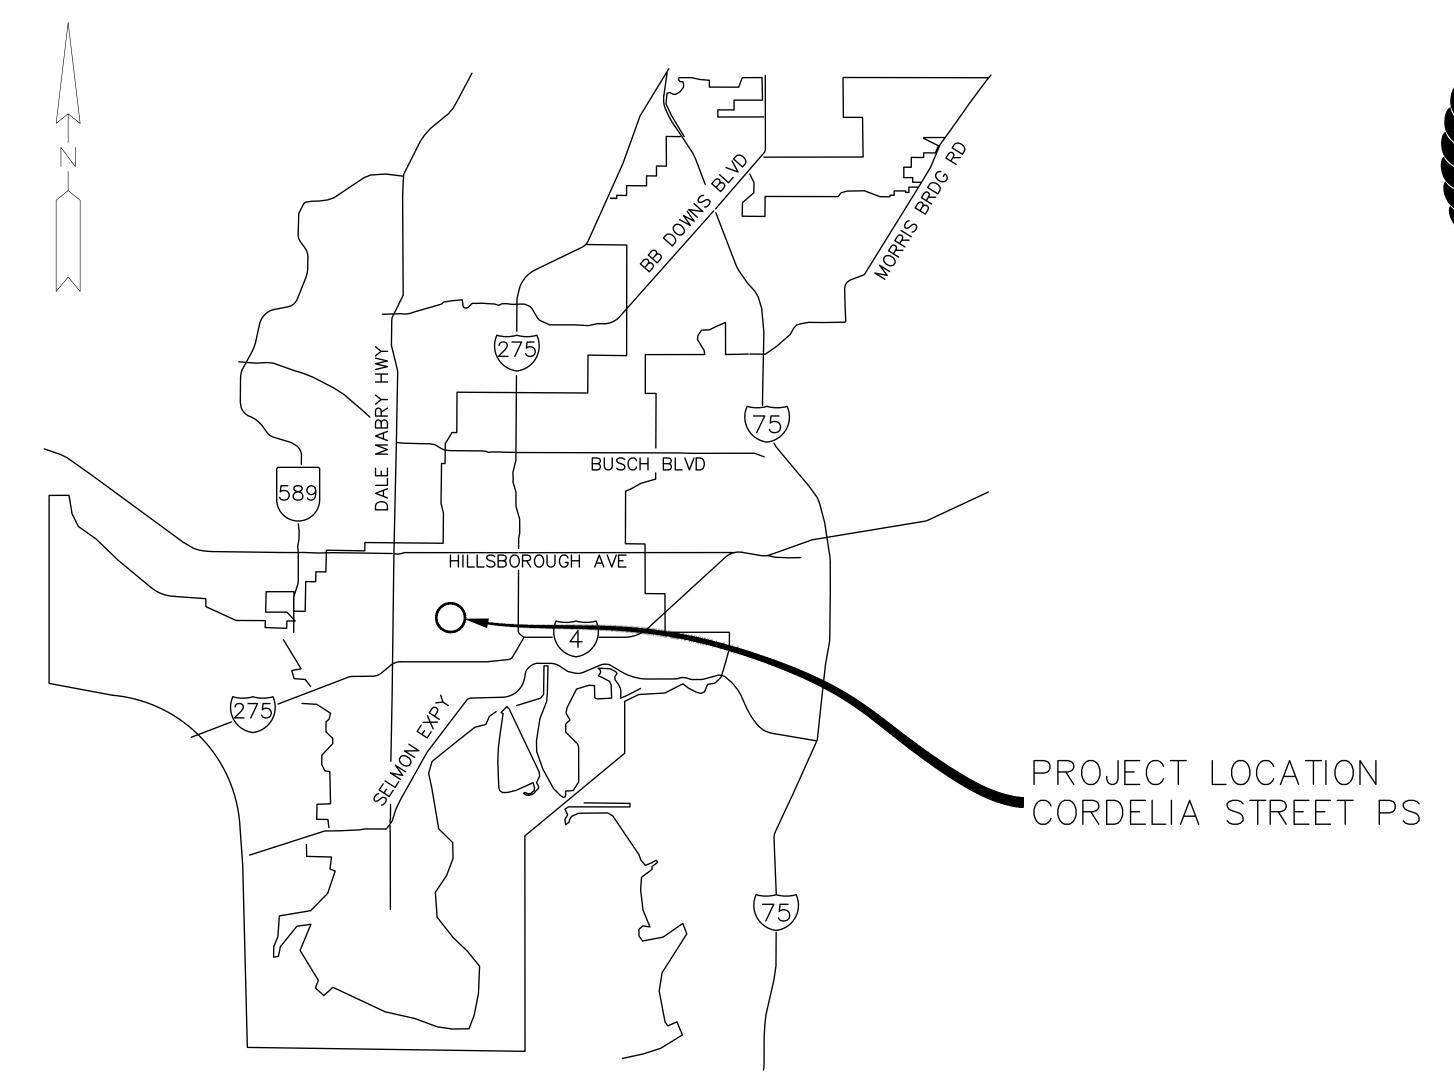







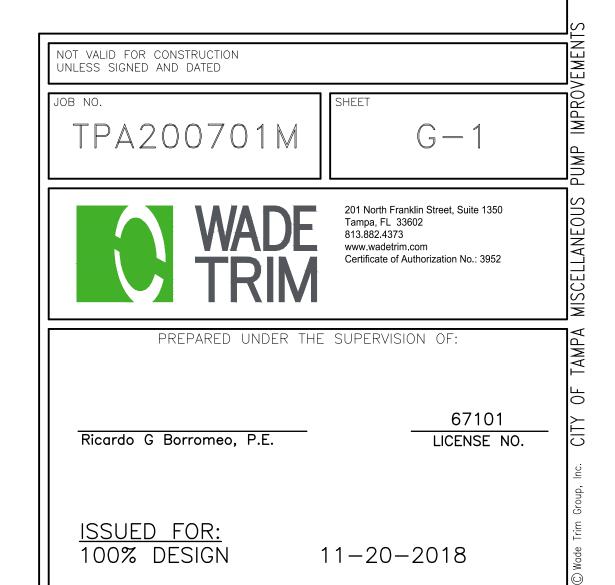

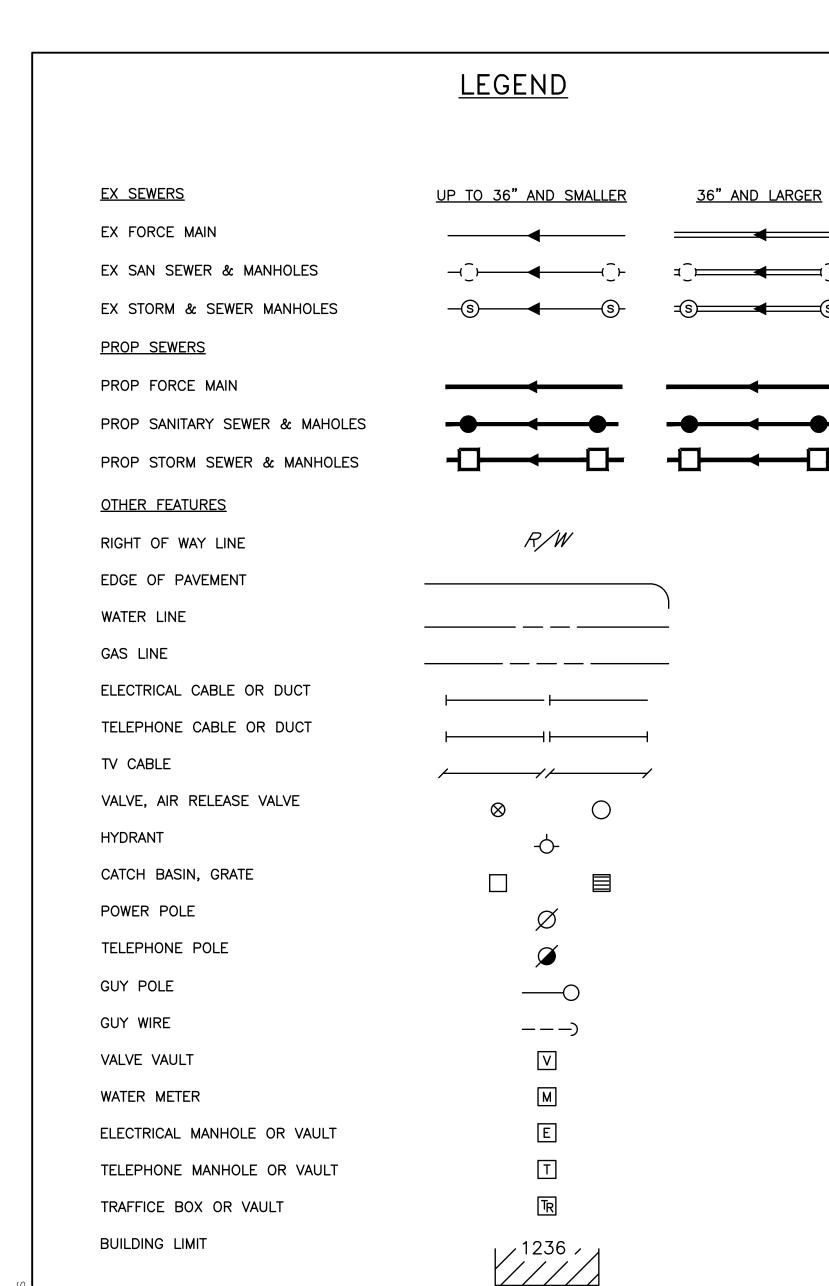


x-----x

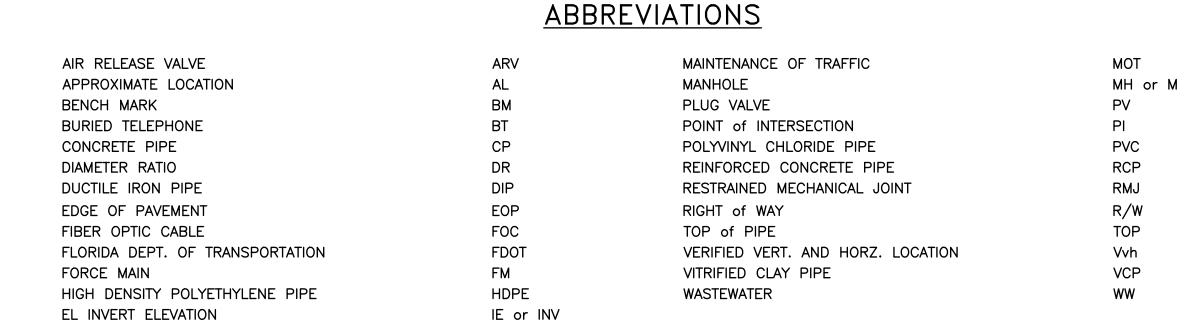

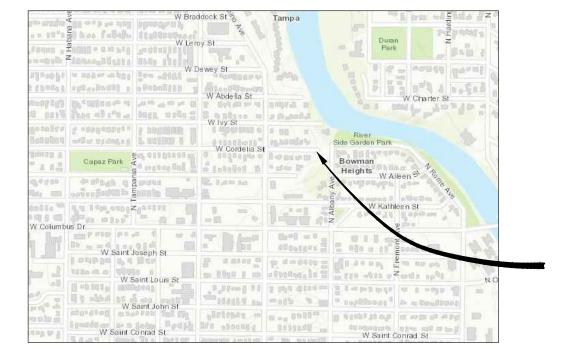

CORDELIA STREET PS LOCATION MAP

### PAGE INDEX OF PLANS SHEET NO. SHEET DESCRIPTION COVER SHEET 1 2 LEGEND, INDEX AND LOCATION GENERAL NOTES EXISTING AND PROPOSED SITE PLANS - CORDELIA STREET DEMOLITION PLAN AND SECTION VIEW — CORDELIA STREET DEMOLITION PLAN AND SECTION VIEW 2102 IVY STREET (JOE'S PLACE) PROPOSED PLAN VIEW - CORDELIA STREET PROPOSED SECTION VIEW - CORDELIA STREET DETAIL SHEET (1 OF 3) 9 DETAIL SHEET (2 OF 3) 10 11 DETAIL SHEET (3 OF 3) E1 ELECTRICAL SYMBOL LEGEND (SHT. 1 OF 2) E2 ELECTRICAL SYMBOL LEGEND (SHT. 2 OF 2) E3 GENERAL NOTES AND SCOPE OF WORK NOT USED E4 E5 CORDELIA STREET PUMP STATION SITE PLAN E6 NOT USED E7 CORDELIA STREET PUMP STATION ONE LINE DIAGRAM E8 ELECTRICAL SCHEMATIC (1 OF 4) MOTOR CONTROL PANEL E9 ELECTRICAL SCHEMATIC (2 OF 4) PUMP CONTROL PANEL E10 ELECTRICAL SCHEMATIC (3 OF 4) MOTOR CONTROL PANEL E10A ELECTRICAL SCHEMATIC (4 OF 4) MOTOR CONTROL PANEL E11 MCP TO PCP INTERCONNECTION WIRING DIAGRAM E12 ELECTRICAL SCHEMATIC LEGEND (SHT. 1 OF 2) E13 ELECTRICAL SCHEMATIC LEGEND (SHT. 2 OF 2) E14 PARTS SCHEDULE (SHT. 1 OF 2) E15 PARTS SCHEDULE (SHT. 2 OF 2) E16 ELECTRICAL DETAILS (SHT. 1 OF 5) E17 ELECTRICAL DETAILS (SHT. 2 OF 5) ELECTRICAL DETAILS (SHT. 3 OF 5) E18 E18A ELECTRICAL DETAILS (SHT. 4 OF 5) E18B ELECTRICAL DETAILS (SHT. 5 OF 5) E18C ELECTRICAL KEYNOTES E19 PUMP CONTROL PANEL DETAILS E20 MOTOR CONTROL PANEL DETAILS E21 PM1 ENCLOSURE DETAIL

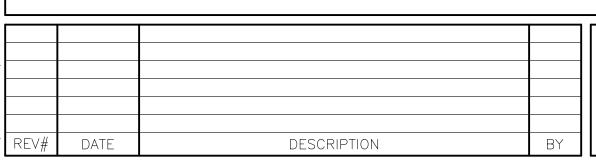

PROPERTY OWNERSHIP

**FENCE** 

CONIFER

PALM

OTHER

SHRUB

HEDGE

IRON PIPE

RAILROAD TRACKS

CONTROL POINT


OPEN DITCHES

EXISTING WYE

PROPOSED WYE

CLEAN OUT

CONCRETE MONUMENT







CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

CORDELIA STREET PS

PROJECT LOCATION

2108 CORDELIA ST

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB LEGEND, INDEX AND LOCATION

TPA2007-01M

### DEMOLITION NOTES

- D-1 SALVAGEABLE MATERIAL, AS DETERMINED BY DEPARTMENT PERSONNEL, SHALL BE DELIVERED TO A LOCATION DESIGNATED BY THE CITY. NON-SALVAGEABLE MATERIALS ARE TO BE REMOVED FROM THE SITE AND PROPERLY DISPOSED OF AT THE CONTRACTORS EXPENSE.
- D-2 THE CONSTRUCTION SITES SHALL BE MAINTAINED IN AS NEAT AND ORDERLY CONDITION AS POSSIBLE DURING CONSTRUCTION OPERATIONS. SITES SHALL BE SECURED WITH TEMPORARY FENCING AND STRUCTURES DURING HOURS WHEN CONTRACTOR IS NOT PRESENT TO ENSURE SAFETY OF CITY EMPLOYEES AND THE PUBLIC.

### GENERAL NOTES

- G-1 CONTRACTOR SHALL COORDINATE ALL CONSTRUCTION ACTIVITIES WITH THE WASTEWATER INSPECTOR, WASTEWATER PERSONNEL AND PUMPING STATION OPERATIONS.
- G-2 CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL NECESSARY RIGHT-OF-WAY PERMITS AND BUILDING PERMITS FOR THE PUMP STATION WORK.
- G-3 THE CITY WILL OBTAIN ALL NECESSARY FDEP WASTEWATER PERMITS.
- G-4 CONTRACTOR SHALL CALL SUNSHINE (1-800-432-4770) AT LEAST 48 HOURS PRIOR TO ANY CONSTRUCTION ACTIVITY.
- G-5 AFTER WET WELL IS DEWATERED, THE CONTRACTOR SHALL CLEAN WET WELL OF ALL DEBRIS. DEBRIS MAY BE DELIVERED AND DISPOSED OF AT THE CITY OF TAMPA HOWARD F. CURREN AWTP, 2700 MARITIME BOULEVARD, TAMPA, FL 33605
- G-6 TWO NEW PUMPS PER STATION SHALL BE SUPPLIED FOR THIS PROJECT. PROPOSED PUMPS ARE FLYGT PUMPS, AS SHOWN ON THE SHEETS HEREIN. ALL PROPOSED PUMP BASES SHALL BE 4-INCH DIAMETER DISCHARGE ELBOWS.
- G-7 IT IS THE ENGINEERS INTENT THAT CONTINUOUS SERVICE WILL BE MAINTAINED THROUGHOUT THE PROJECT.
- G-8 CONTRACTOR SHALL VERIFY QUANTITIES OF ALL NECESSARY PIPES, REDUCERS, FITTINGS, SUPPORTS, AND ANY MISCELLANEOUS BRACKETS.
- G-9 DIMENSIONS SHOWN ARE NOT NECESSARILY ACCURATE TO THE DEGREE REQUIRED FOR FABRICATION. EXISTING DIMENSIONS AND VIEWS ARE SHOWN BASED ON THE BEST INFORMATION AVAILABLE. CONTRACTOR SHALL FIELD VERIFY ALL PERTINENT DIMENSIONS AND REFLECT THEM ON DETAILED SHOP DRAWINGS FOR APPROVAL BEFORE ANY FABRICATION.
- G-10 SHOP DRAWINGS SHALL BE SUBMITTED AND APPROVED BY THE CITY FOR ALL PROPOSED ITEMS. ALL SUBMITTALS AND SHOP DRAWINGS SHALL BE ORIGINALS OR HIGH QUALITY COPIES (CLEARLY LEGIBLE). NO FAXED SHEETS OR POOR QUALITY COPIES WILL BE ACCEPTED FOR SUBMITTAL REVIEW.
- G-11 PUMP DISCHARGE PIPING IN THE WET WELL SHALL BE 4-INCH DIAMETER HDPE, SDR-11, GREEN STRIPE, DIPS-OD HDPE JOINTS SHALL BE FLANGED WITH 316SS BACK UP RINGS.
- G-12 PLUG VALVES SHALL BE DEZURIK, PEF 100% PORT, ECCENTRIC PLUG VALVES OR APPROVED EQUAL. ALL ABOVE GROUND PLUG VALVES SHALL BE PROVIDED WITH 2" NUTS AND NO HANDWHEELS.
- G-13 CHECK VALVES SHALL BE DEZURIK APCO RUBBER FLAPPER SWING CHECK VALVES, SERIES 100, MODEL 104P3. THIS EQUIPMENT IS A STANDARDIZED ITEM AT THIS FACILITY AND NO "OR EQUAL" SUBMITTALS WILL BE CONSIDERED.
- G-14 ALL HARDWARE, UNLESS OTHERWISE NOTED, SHALL BE TYPE 316 STAINLESS STEEL.
- G-15 PIPE SUPPORTS SHALL BE CONSTRUCTED AS SHOWN IN THE PIPE SUPPORT DETAIL.
- G-16 ALL CEMENTITIOUS CONCRETE AND GROUT, UNLESS OTHERWISE NOTED, SHALL BE CLASS "B", 4000 PSI COMPRESSIVE STRENGTH AT 28 DAYS. ALL REINFORCING STEEL SHALL BE GRADE 60.
- G-17 OSHA STANDARD SAFETY EQUIPMENT SUCH AS SAFETY HARNESSES, GAS MONITORS, LOWER EXPLOSIVE LIMIT (LEL) DETECTORS, BREATHING APPARATUS, ETC. SHALL BE UTILIZED WHERE THE WORK DICTATES THEIR USE.

- G-18 BACKFILL (NO CLAY OR CLAYEY MATERIAL) SHALL BE COMPACTED IN 6-INCH LAYERS (MAX.) TO 98% MAXIMUM DRY DENSITY OF MODIFIED PROCTOR IN CONFORMANCE WITH AASHTO T-180, METHOD A.
- G-19 ALL STAINLESS STEEL PARTS TO BE WELDED SHALL BE THE LOW-CARBON VERSION OF THE GRADE OF STAINLESS STEEL THAT IS CALLED FOR, SUCH AS: T-316L OR T-304L.
- G-20 ALL CONCRETE PAVEMENT, UNLESS OTHERWISE NOTED, SHALL BE MIN 8" THICK CONCRETE WITH 4X4 W6 x W6 WWF. CONCRETE SHALL BE CONSTRUCTED ON COMPACTED SUBBASE (MINIMUM 98% MODIFIED PROCTOR) WITH 1.5" DEEP CONTROL JOINTS SAWCUT @ 15' MAX, CUT WITHIN 12 HRS OF CONCRETE PLACEMENT.
- G-21 CONTRACTOR TO SUBMIT METHOD FOR 100% WATERTIGHT SEALING AT PIPE PENETRATIONS THROUGH STRUCTURES. PROPOSED LINK SEAL OR APPROVED EQUAL.
- G-22 CONTRACTOR SHALL PROVIDE A REDUCED PRESSURE BACKFLOW-PREVENTION DEVICE IN WATER SERVICE LINE, AS SHOWN IN DETAILS, AT A PLACE TO BE SPECIFIED DURING CONSTRUCTION. BACKFLOW PREVENTION DEVICE SHALL BE 1" WILKINS, MODEL #975 XL, OR EQUAL.
- G-23 ALL DIP PIPE AND FITTING SHALL BE CLASS 53 WITH PROTECTO 401 INTERIOR COATING.
- G-24 REMOVE ALL REMNANTS OF COAL TAR EPOXY IN EXISTING WET WELLS PRIOR TO LINING.
- G-25 ALL METAL PIPE, FITTINGS, VALVES, ETC. SHALL RECIEVE:
  - 1) SHOP COAT ONE COAT, 4-6 MILS (DRY) TNEMEC N140-1211 EPOXY PRIMER
  - 2) FIELD COAT ONE COAT, 5-7 MILS (DRY) TNEMEC SERIES 446 PERMA-SHIELD MCU
  - 3) FIELD COAT
  - A) ABOVE GRADE: ONE COAT, 4-6 MILS (DRY) TNEMEC 1074U ENDURASHIELD (WITH FACTORY ADDED UV BLOCKER)
    B) BELOW GRADE: ONE COAT, 5-7 MILS (DRY) TNEMEC SERIES 446 PERMA-SHIELD MCU
- G-26 ALL CONCRETE TOP SLABS AND RISER EXTENSIONS SHALL BE 4,000 PSI, CLASS B, CAST IN PLACE CONCRETE. REBAR REINFORCEMENT SHALL BE #6 AT 6" EW. TWO (2) #5 DIAGONAL BARS, EACH 3-FT LONG, SHALL BE PLACED AT EACH CORNER OF EVERY TOP SLAB OPENING.

### BUILDING CODE REFERENCES:

FLORIDA BUILDING CODE, 6TH EDITION, 2017

CITY OF TAMPA CODE OF ORDINANCES, CHAPTER 5 BUILDING CODE

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), SERIES 70

NATIONAL ELECTRICAL CODE (NEC), 2014 EDITION

REV# DATE DESCRIPTION BY

RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 67101





201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952


CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

Y: JOB NO.
TPA2007-01M

EET **7** 

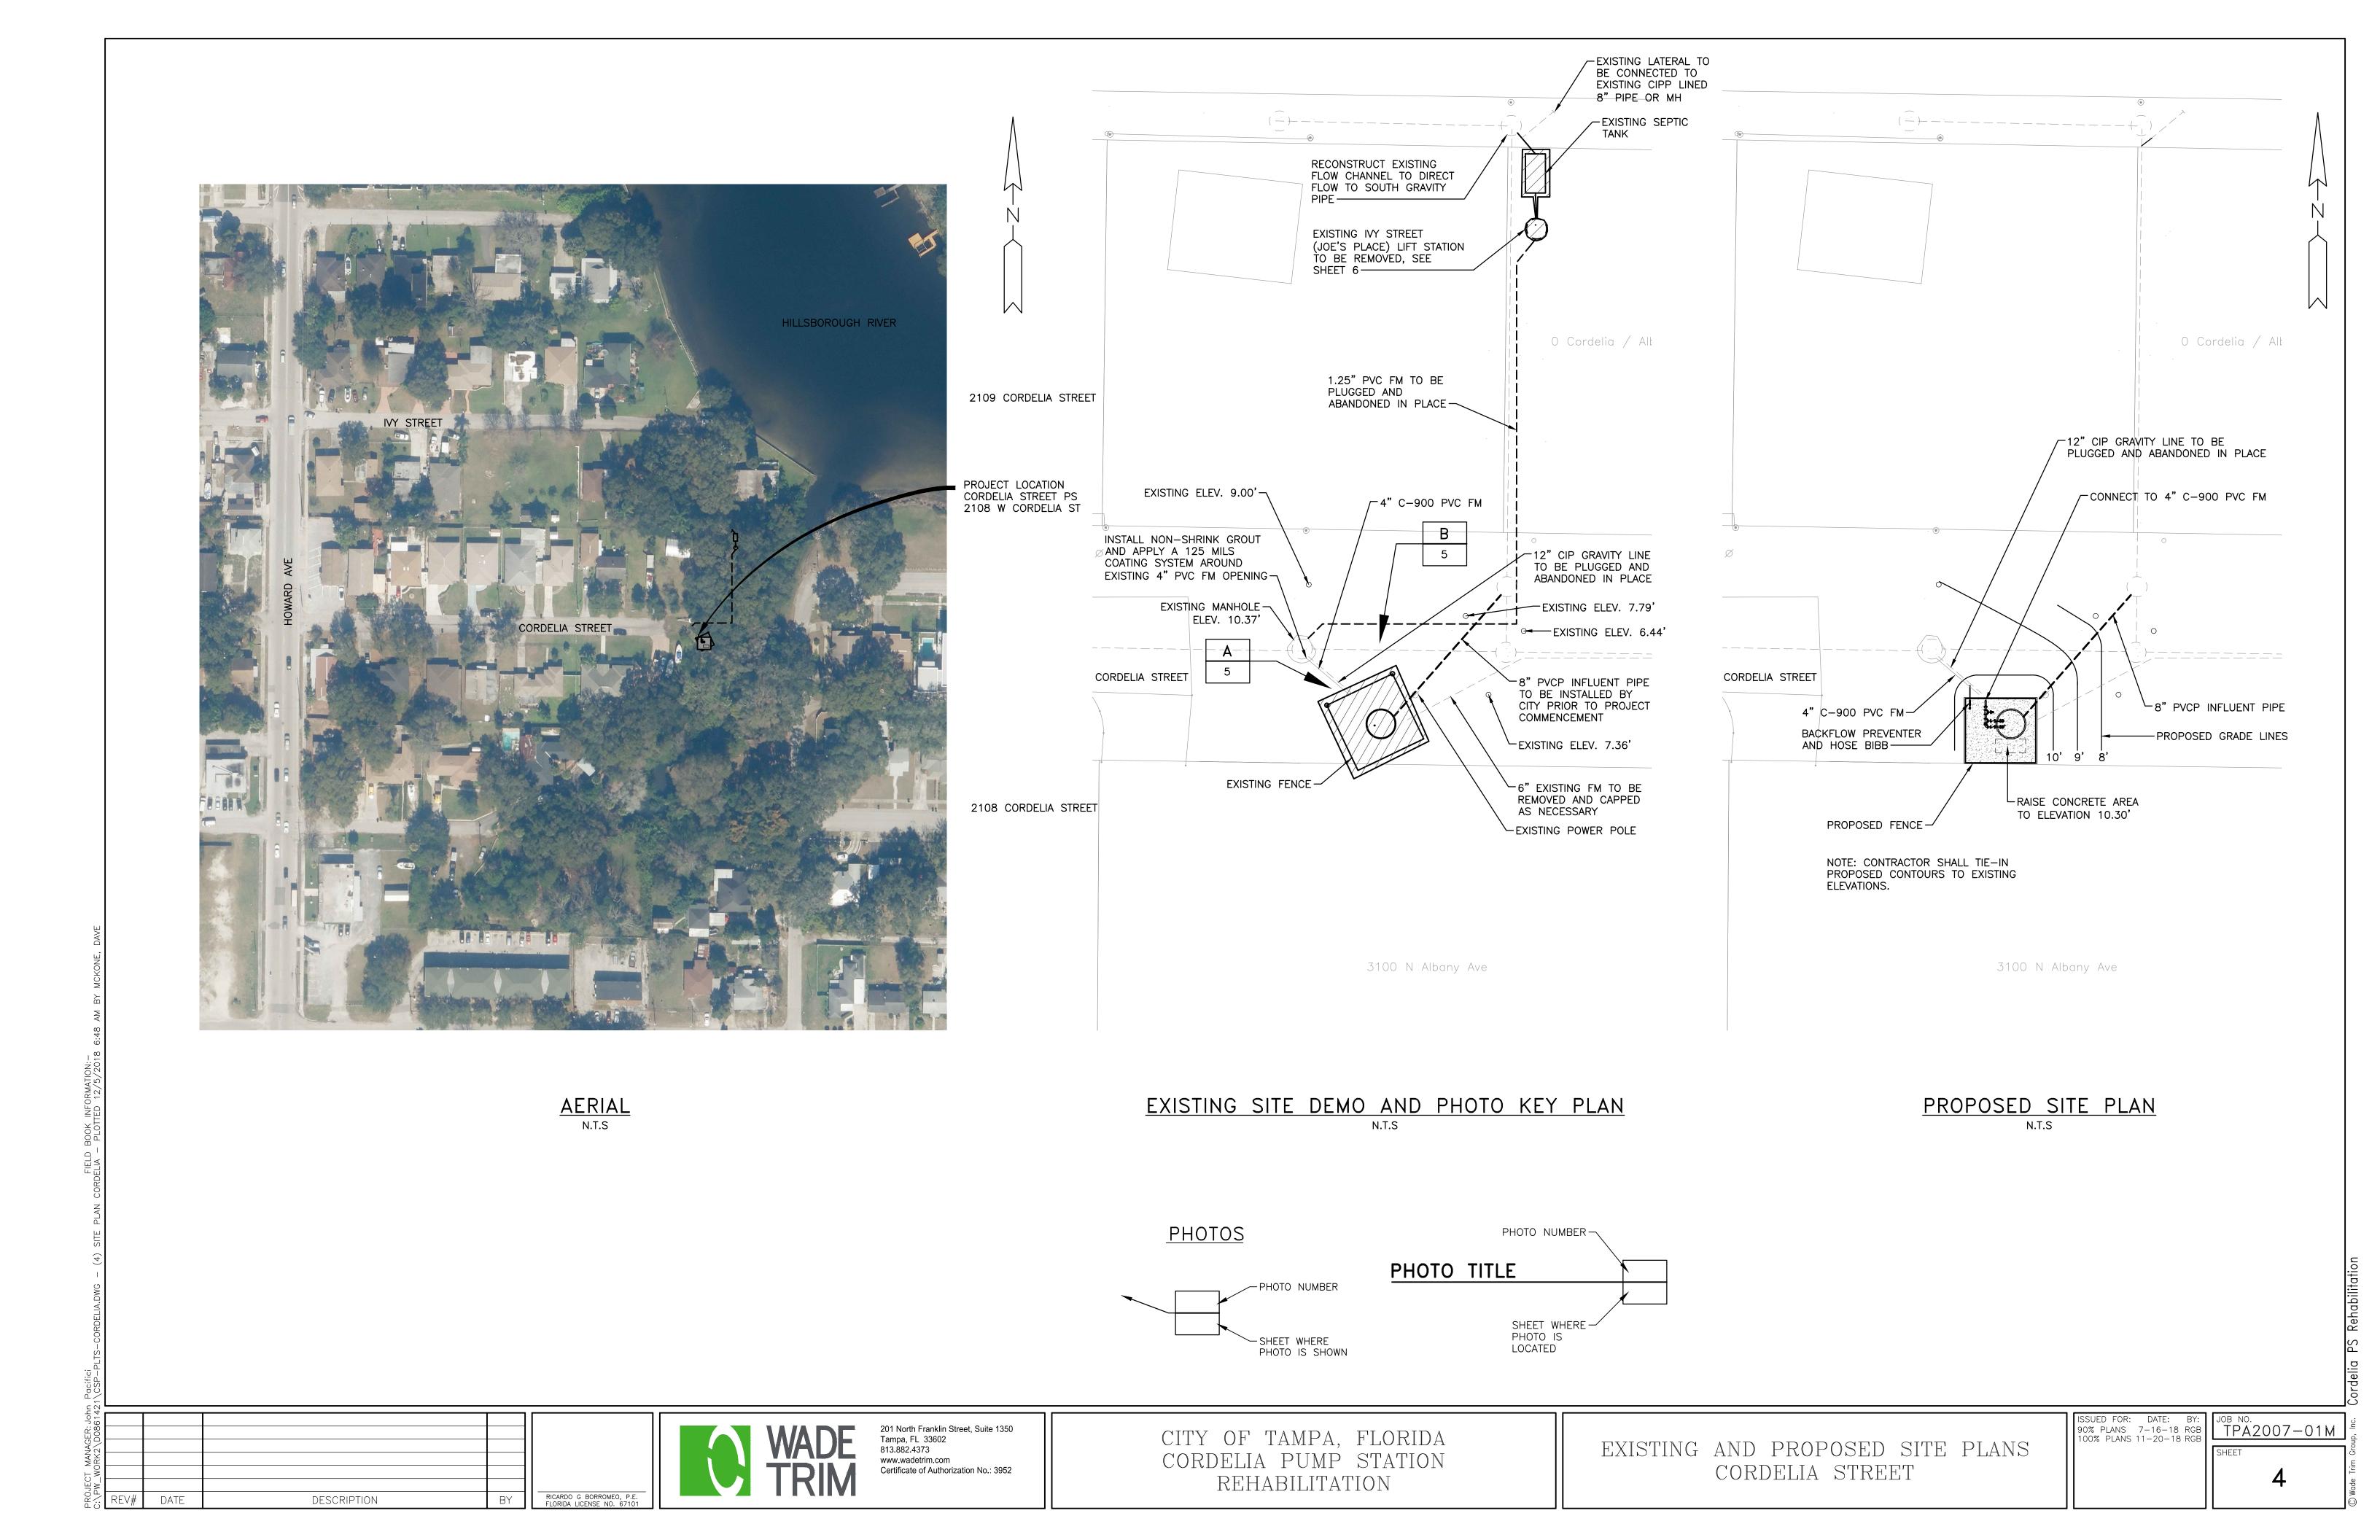

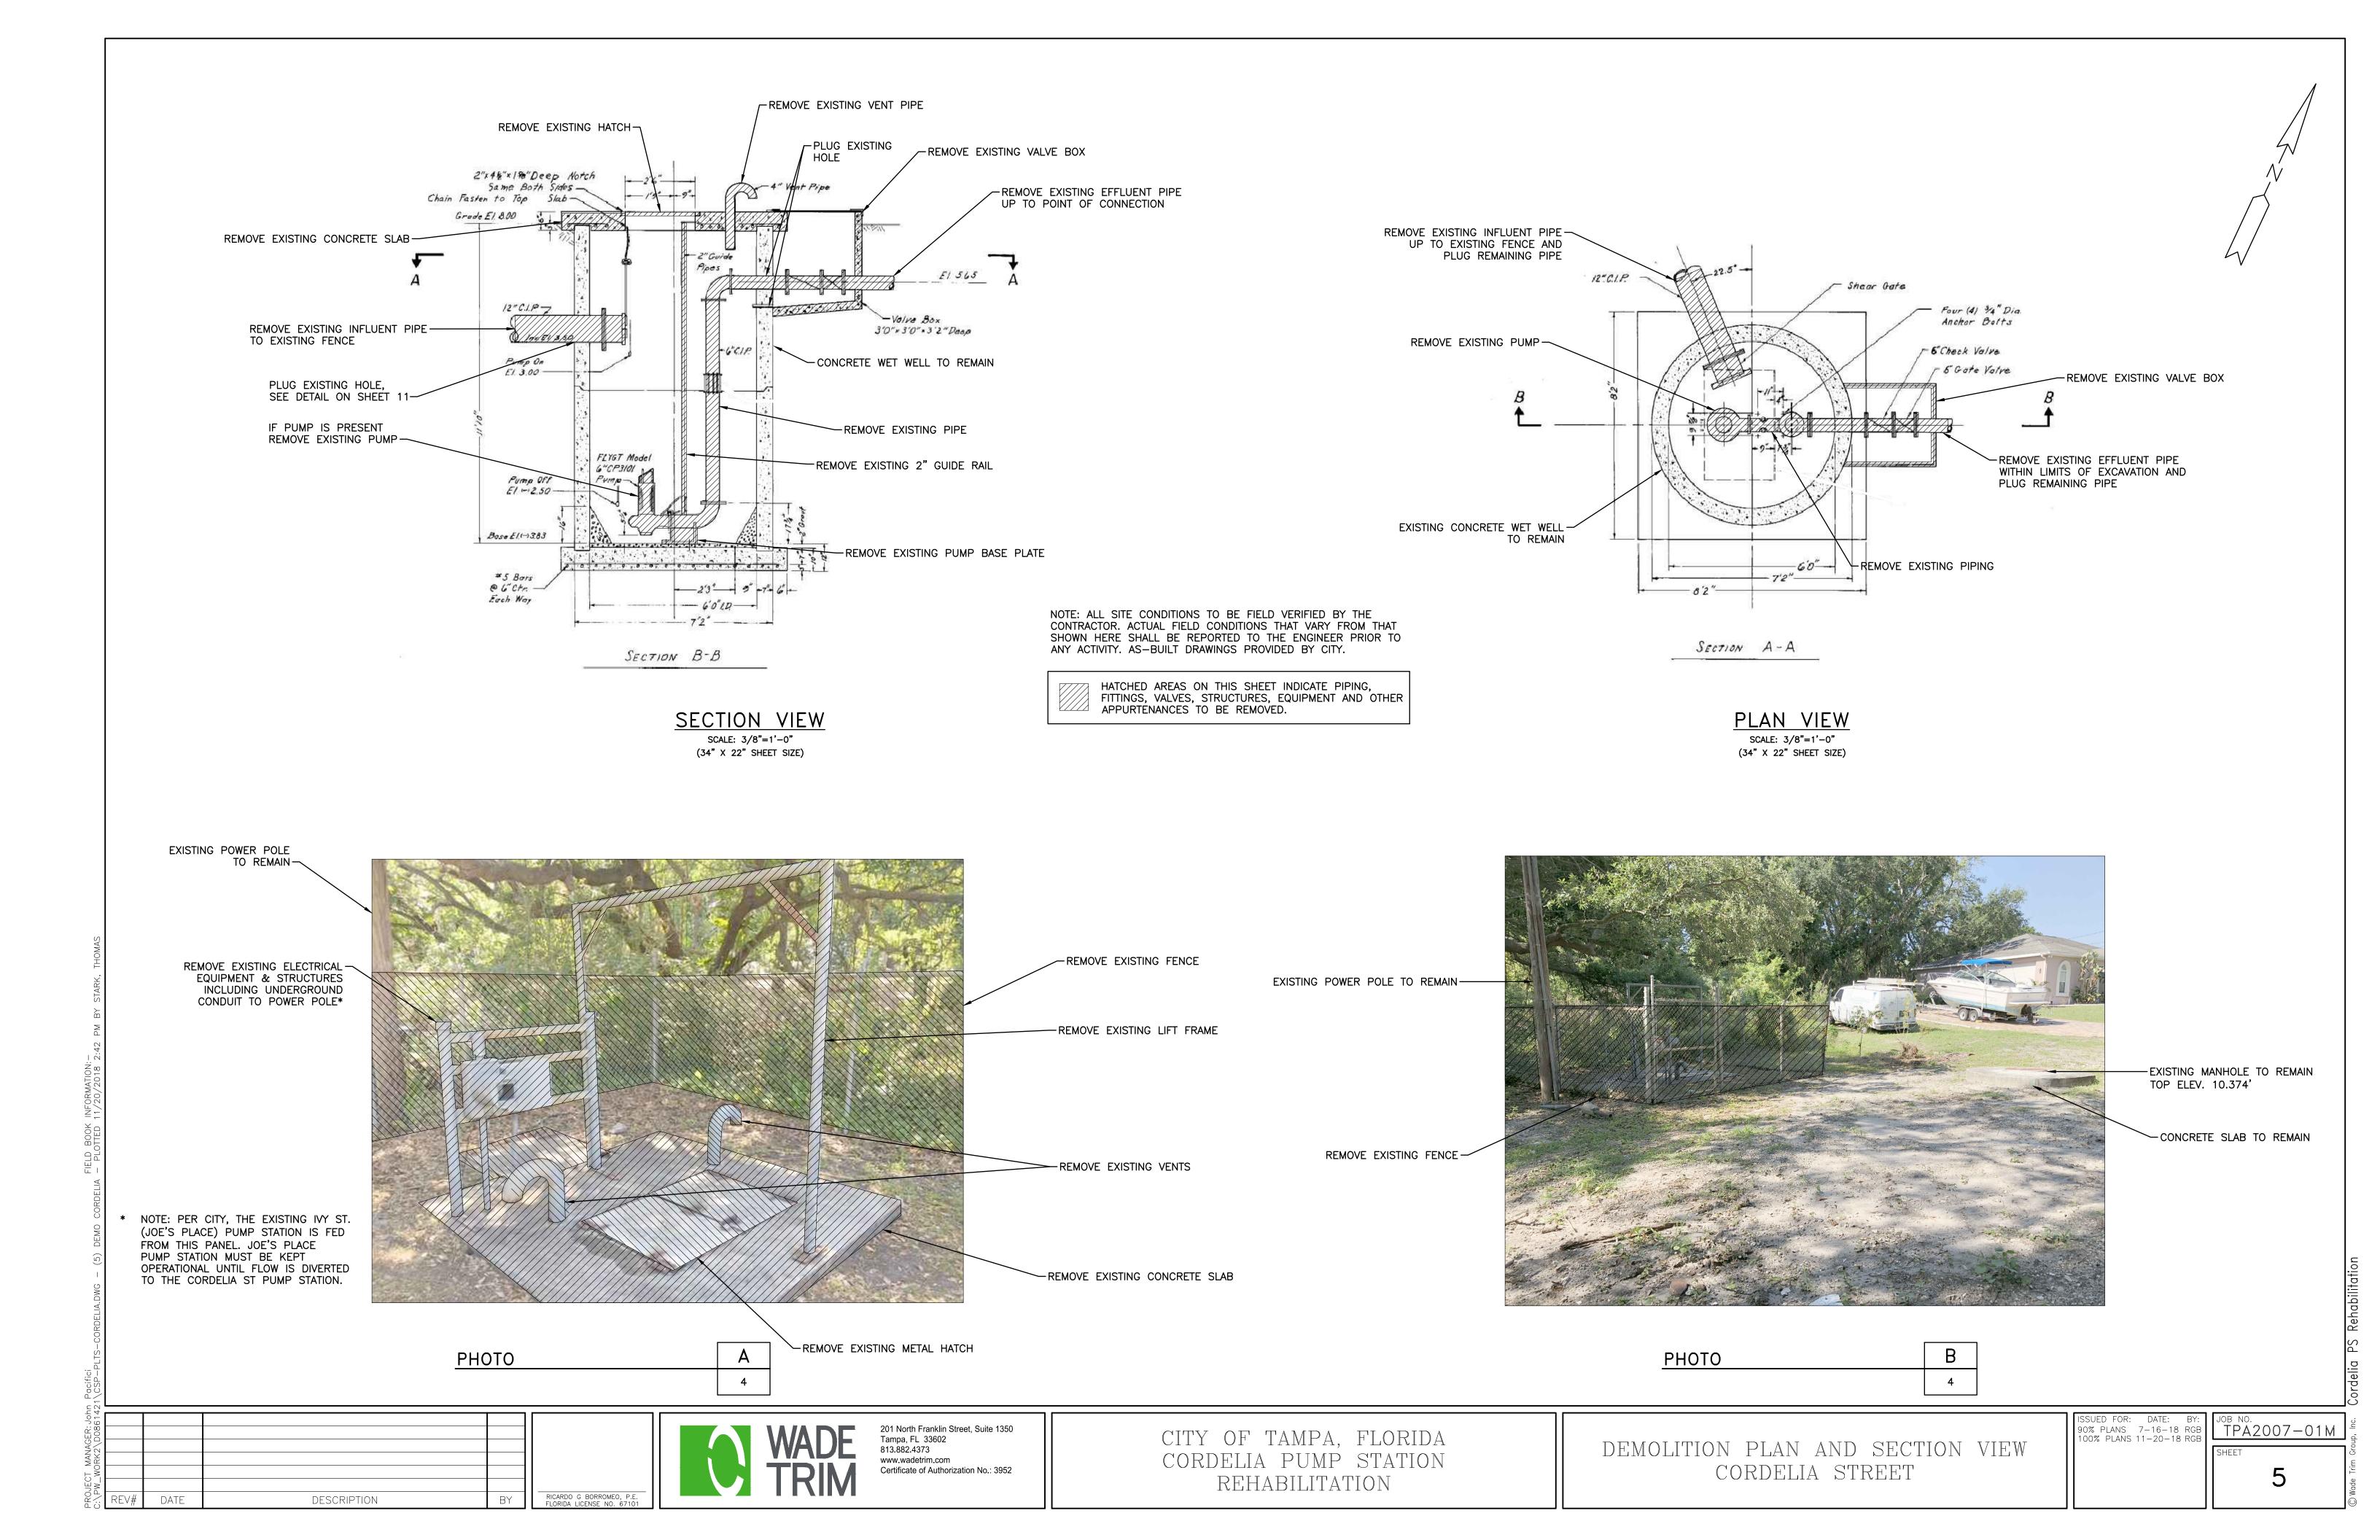

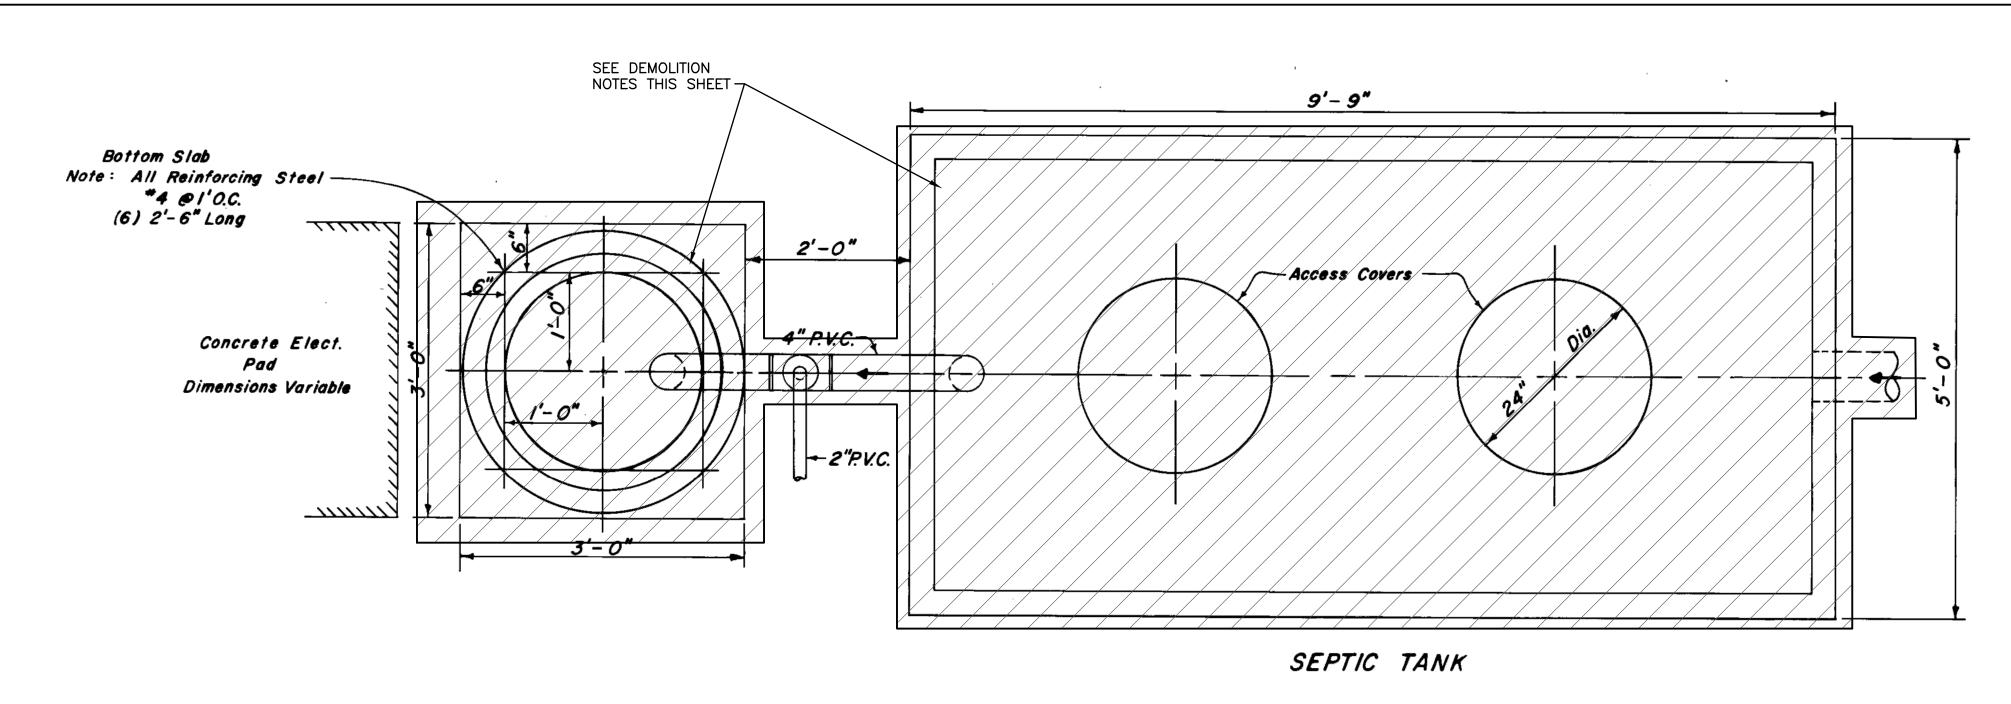


# **DEMOLITION PLAN**

NOTES:

1. CONTRACTOR SHALL COORDINATE WITH CITY PRIOR TO THE DEMOLITION OF THIS PUMP STATION.

- 2. THE PROPOSED CORDELIA PUMP STATION MUST BE SUCCESSFULLY STARTED AND OPERATING PRIOR TO THE START OF DEMOLITION.
- 3. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ALL TEMPORARY FACILITIES NECESSARY TO MAINTAIN OPERATIONS AT ALL TIMES.
- 4. ALL EXISTING ELECTRICAL BOXES AND CONDUITS SHALL BE REMOVED.

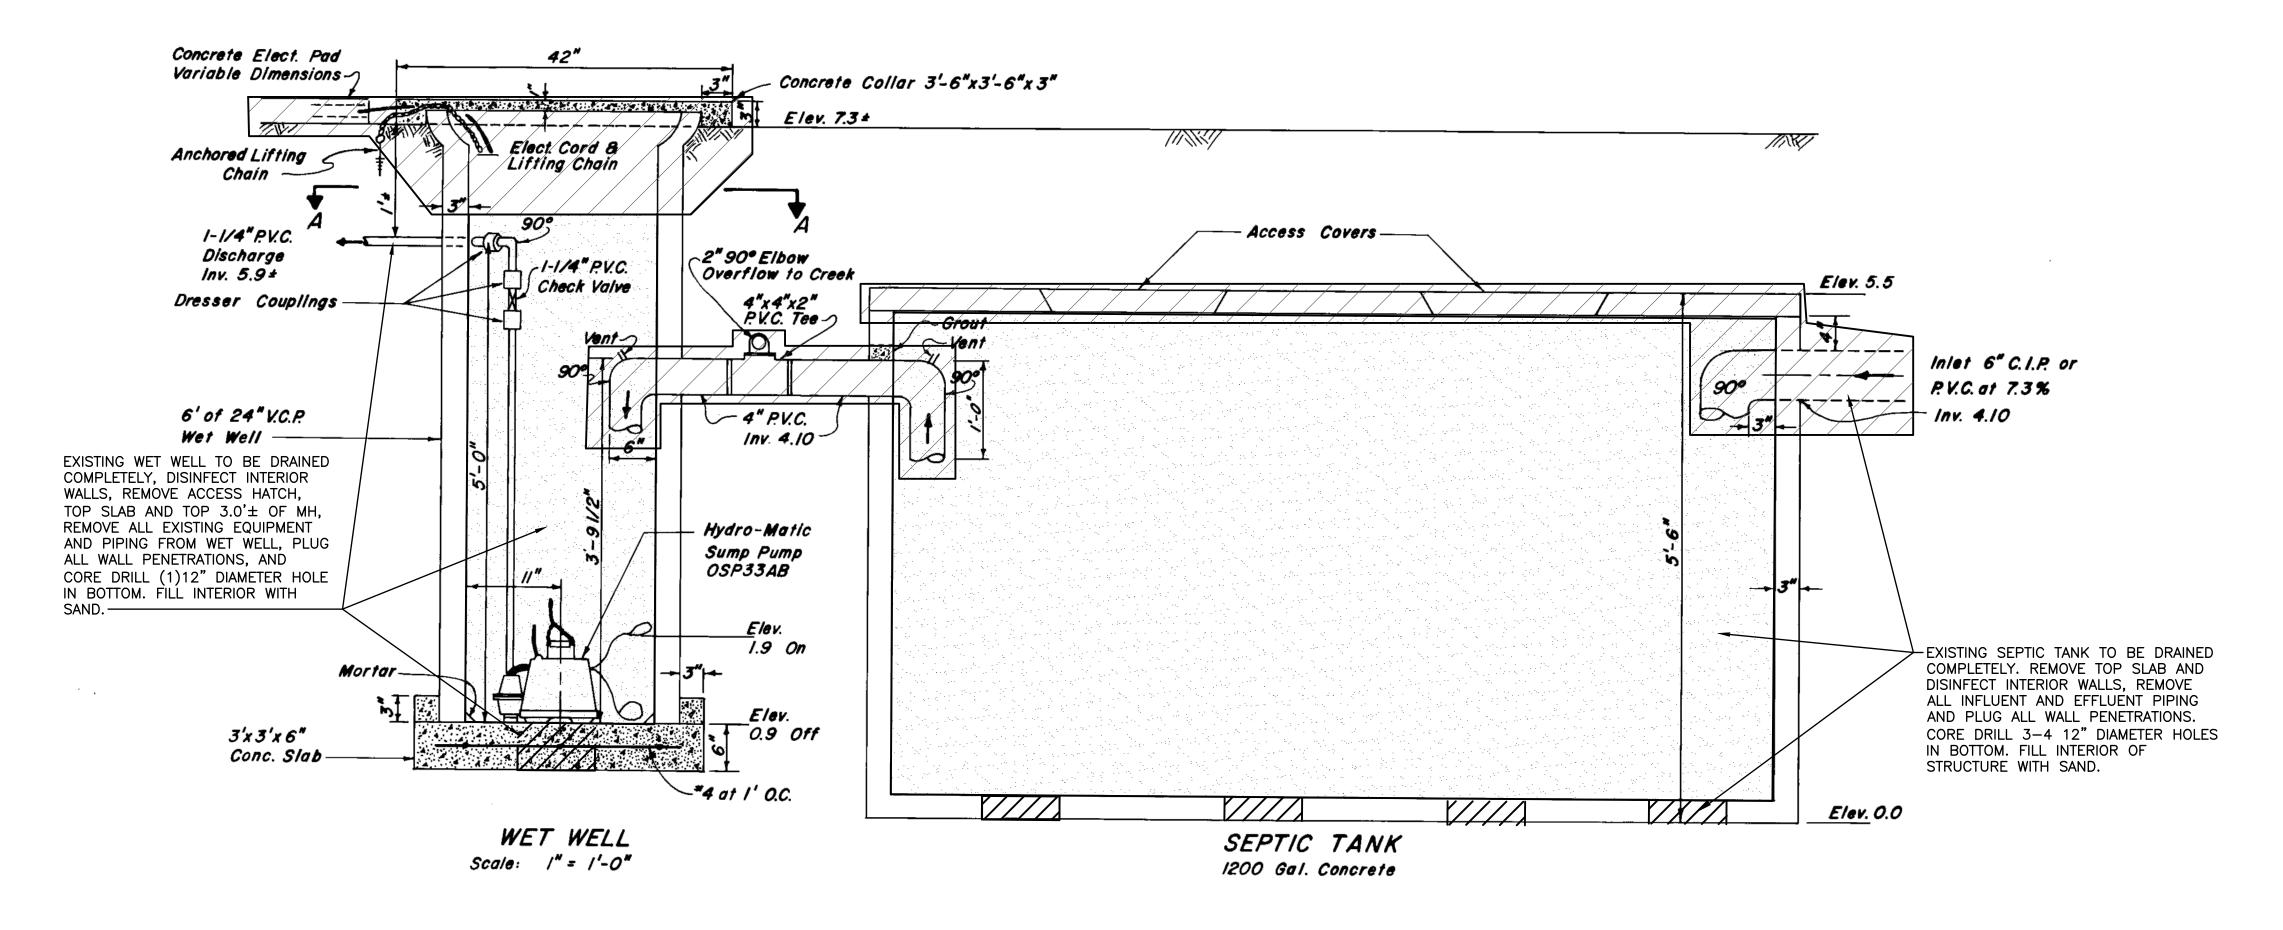

# **DEMOLITION SECTION**

REV# DATE DESCRIPTION BY

RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 67101



201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952


CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION


DEMOLITION PLAN AND SECTION VIEW 2102 IVY STREET (JOE'S PLACE)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO.
TPA2007-01M

6

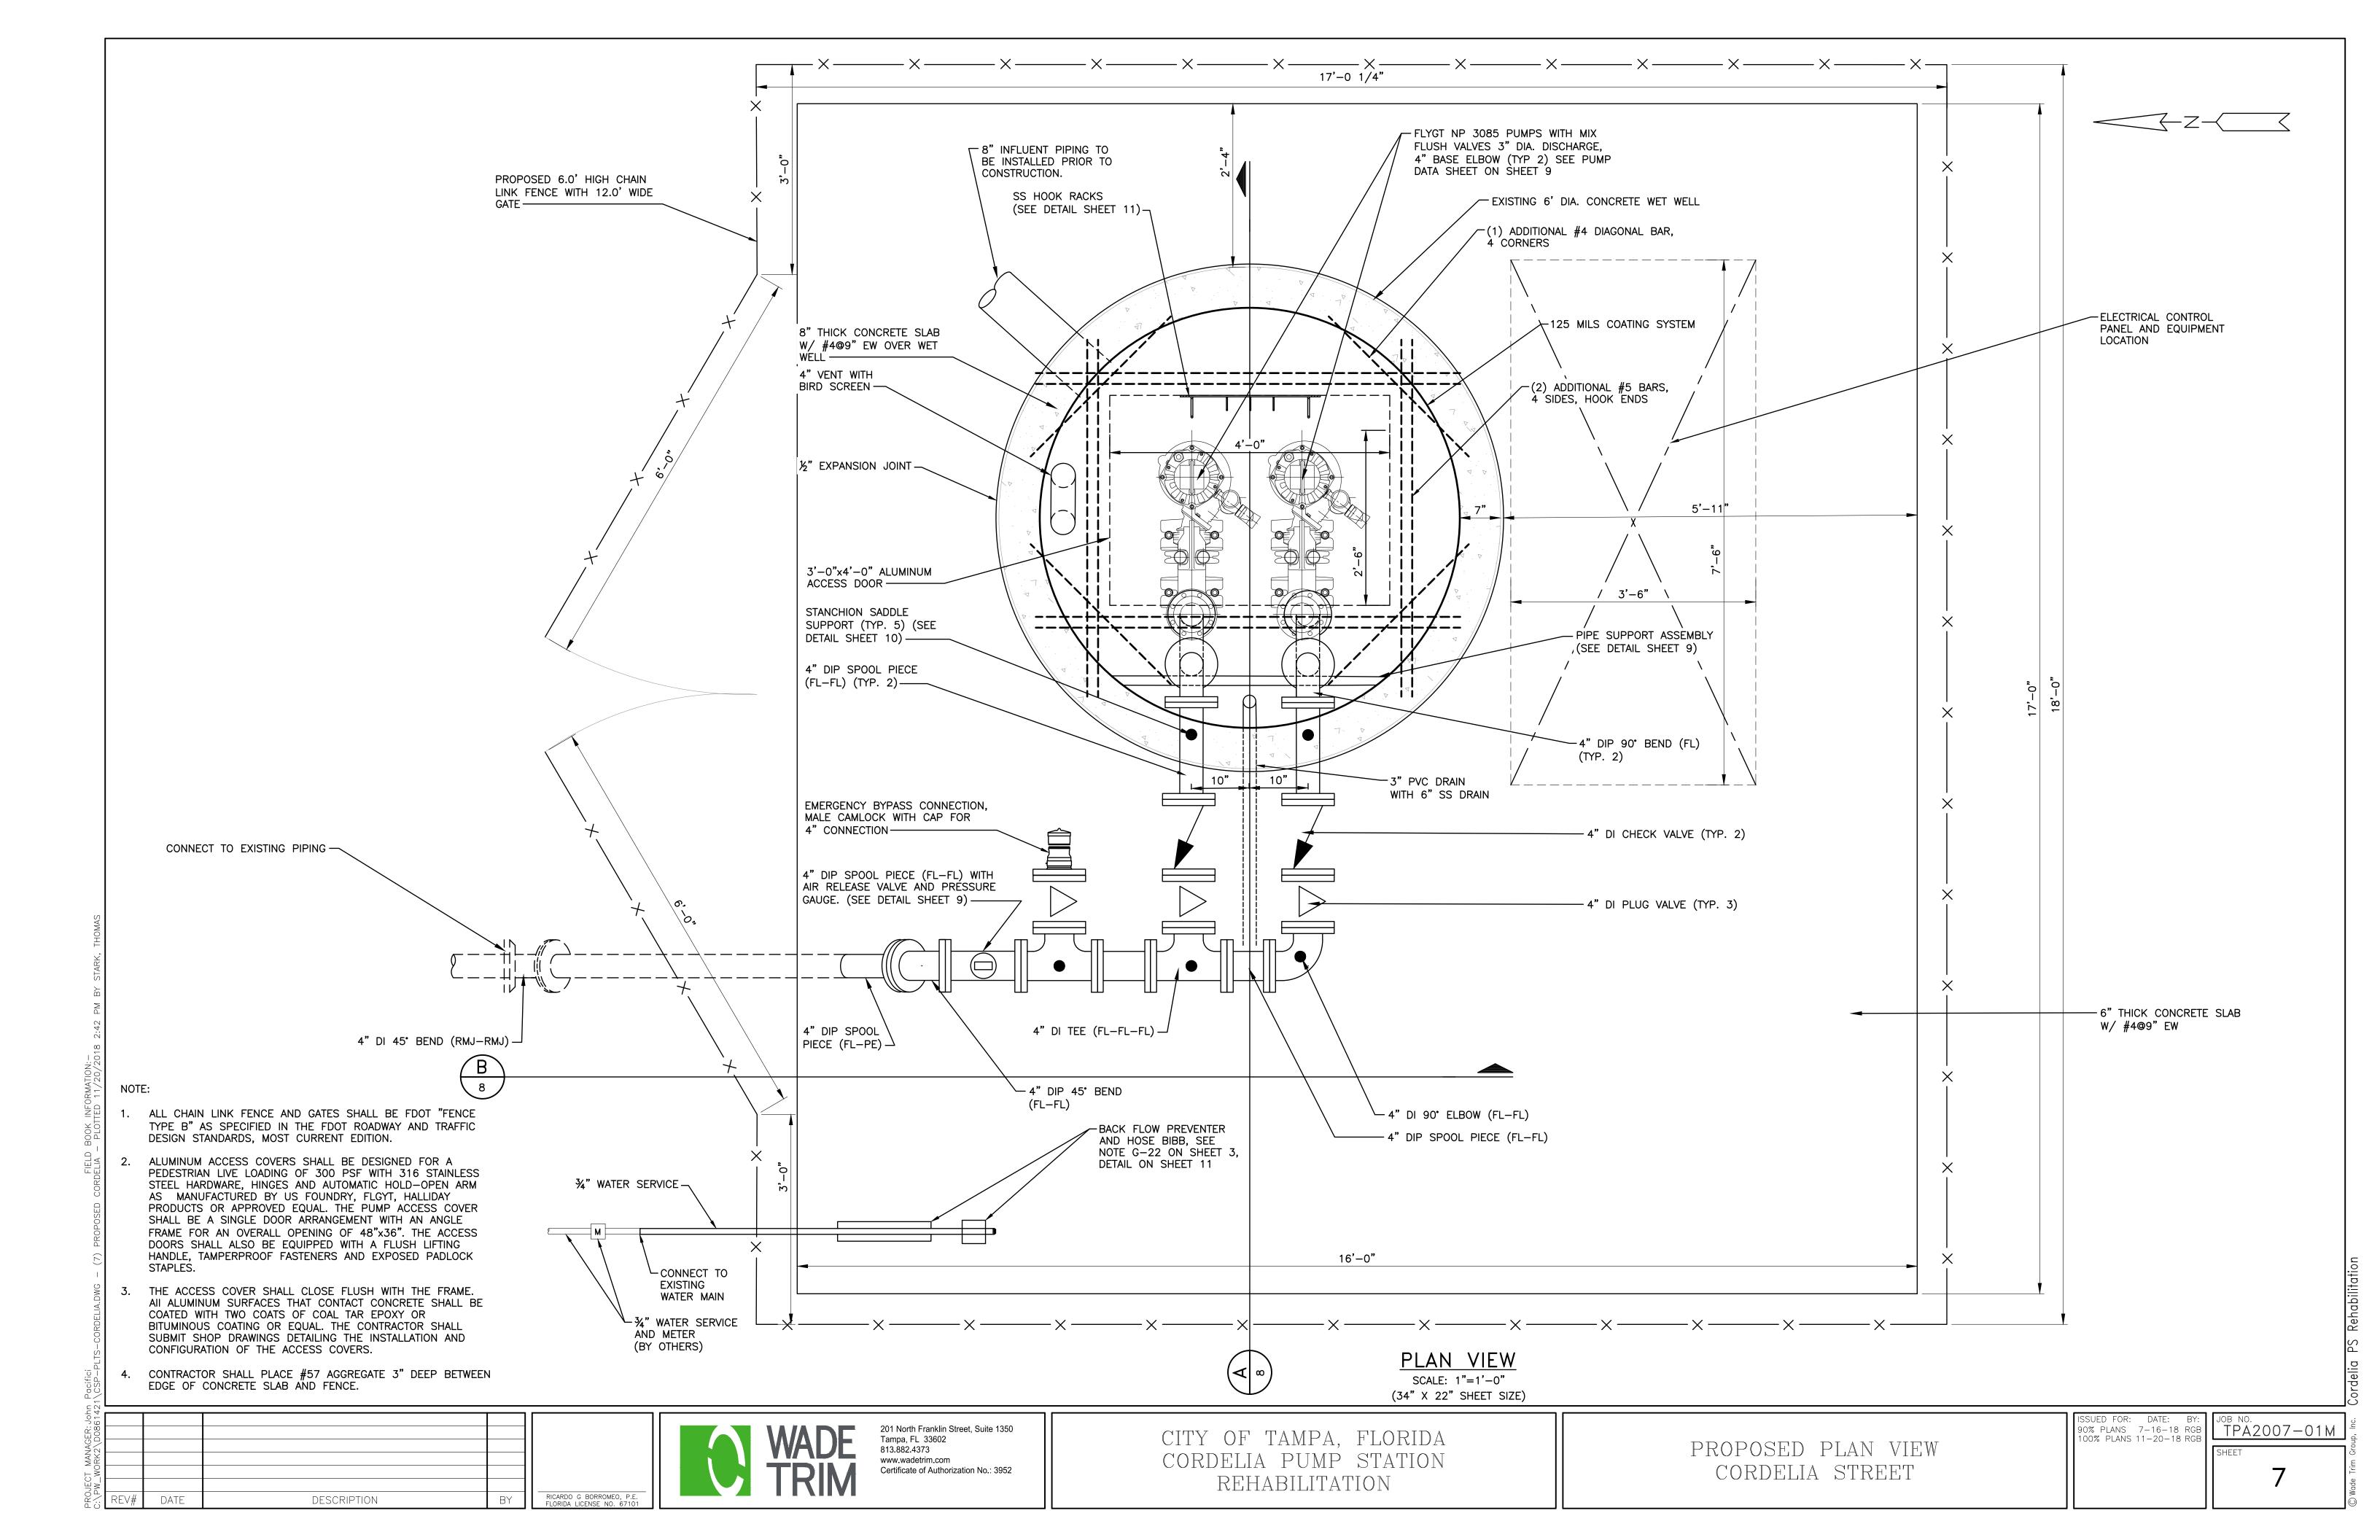


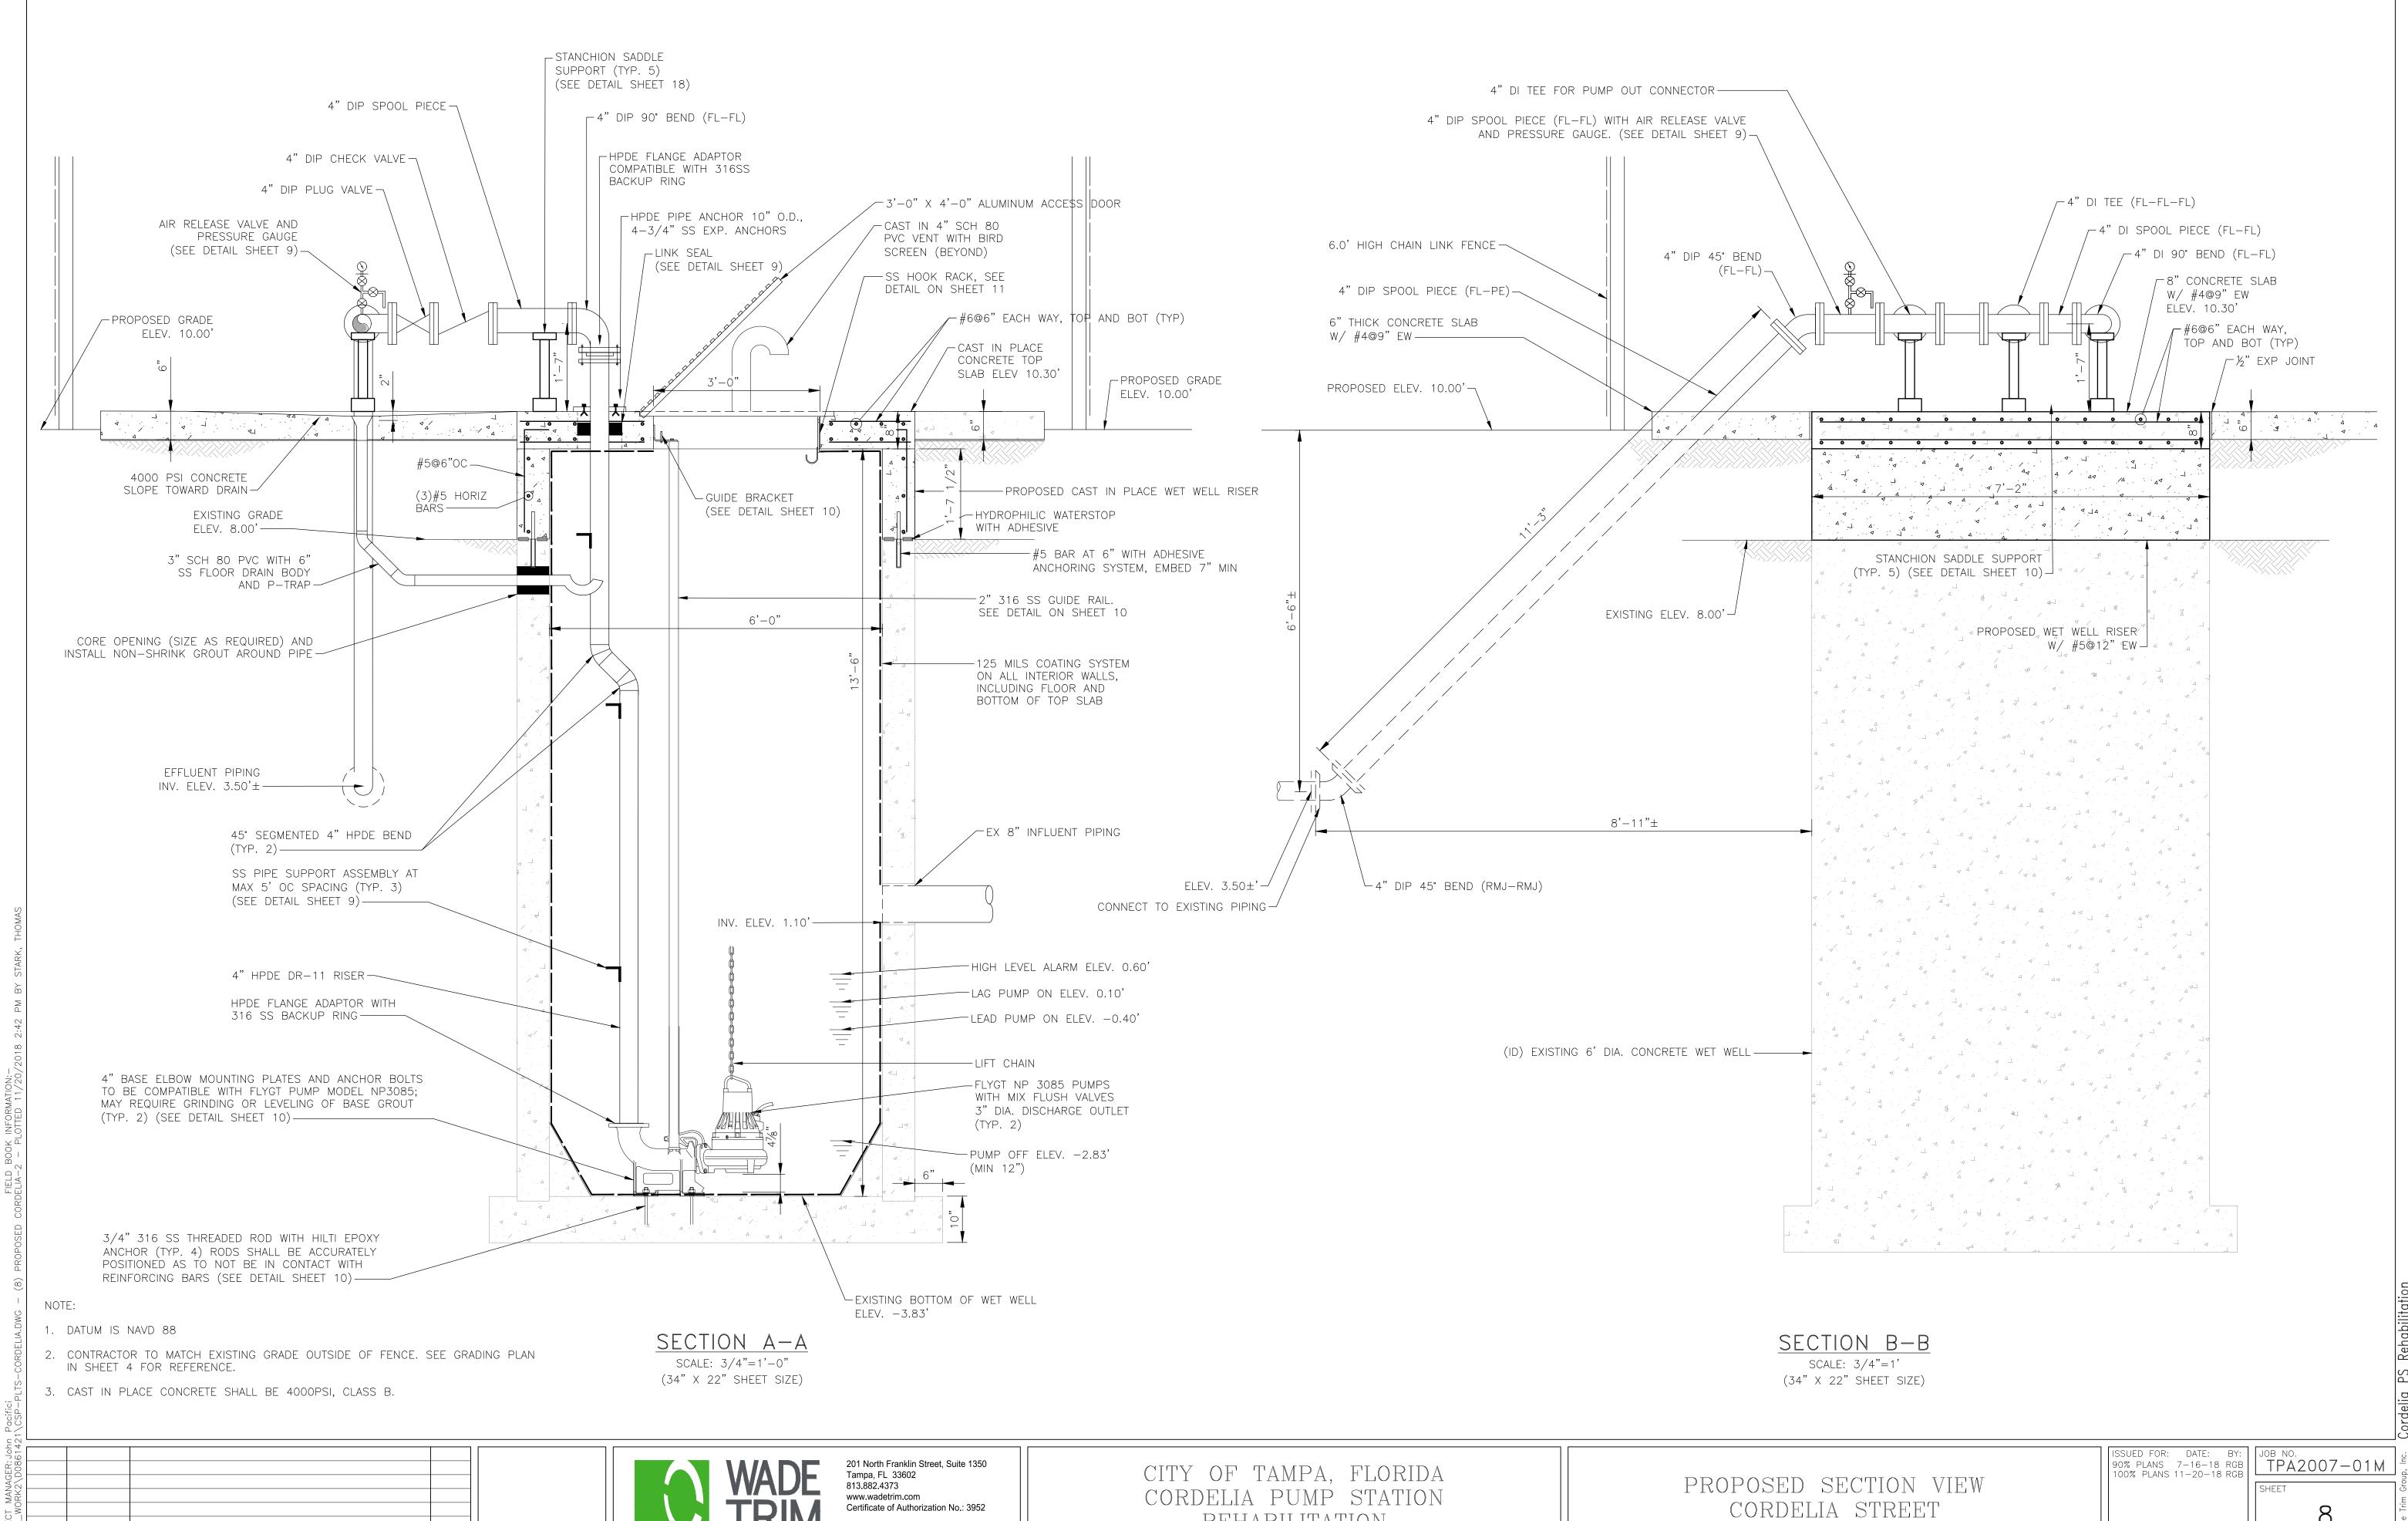


RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 67101 REV# DATE DESCRIPTION




REHABILITATION

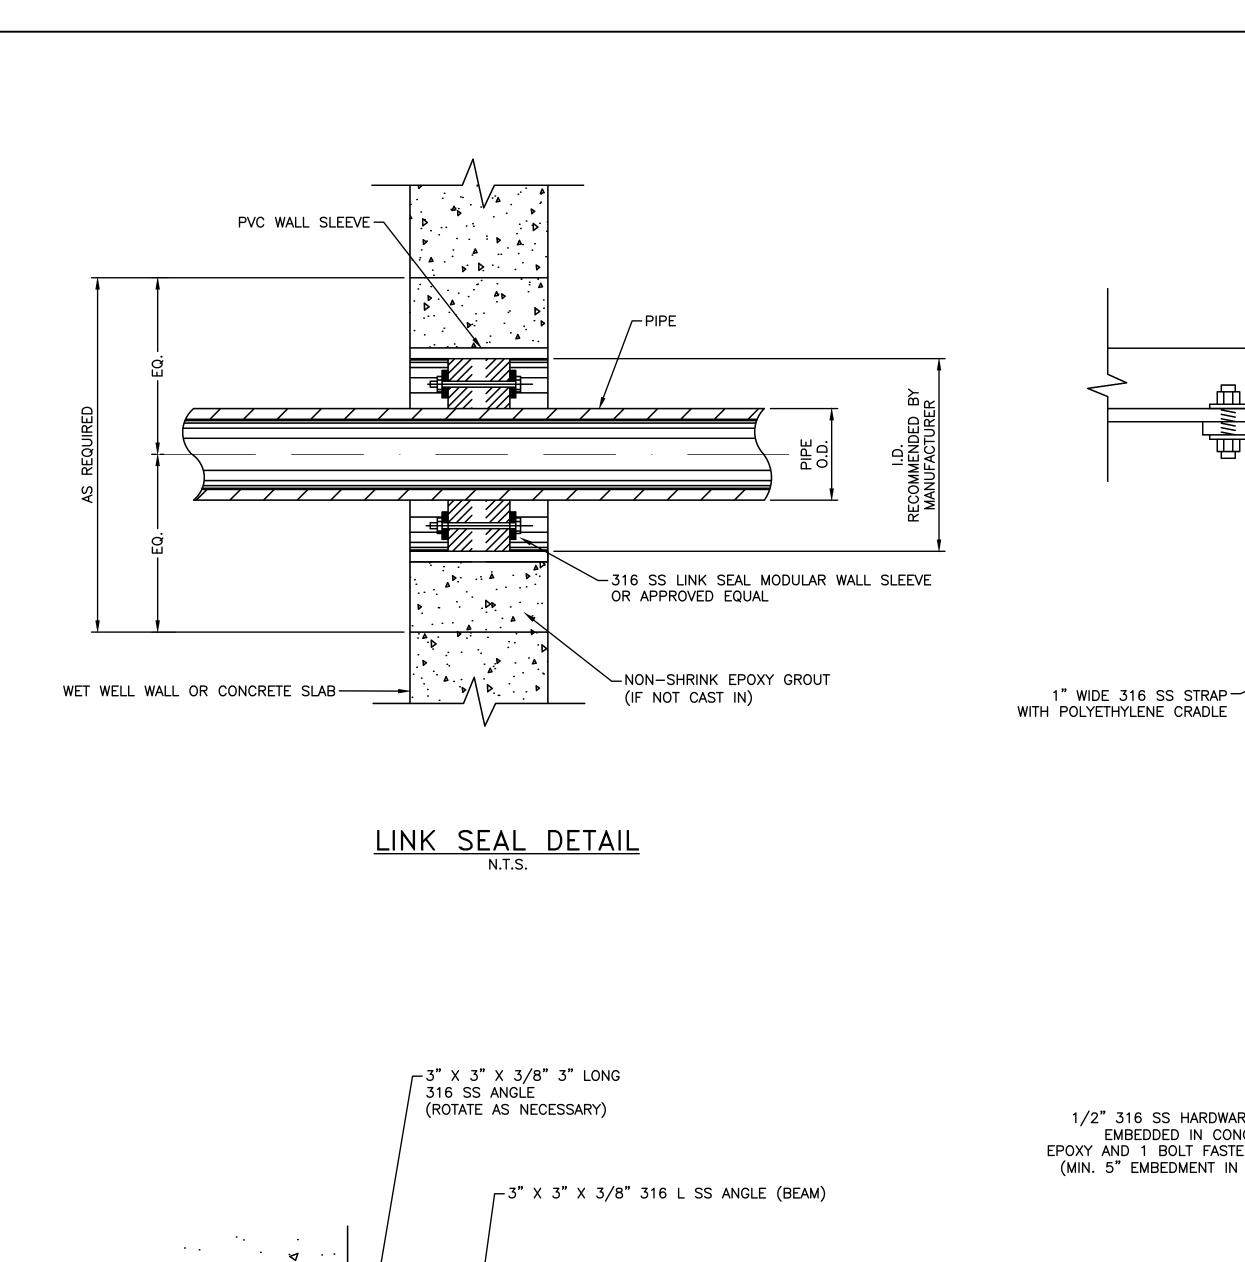


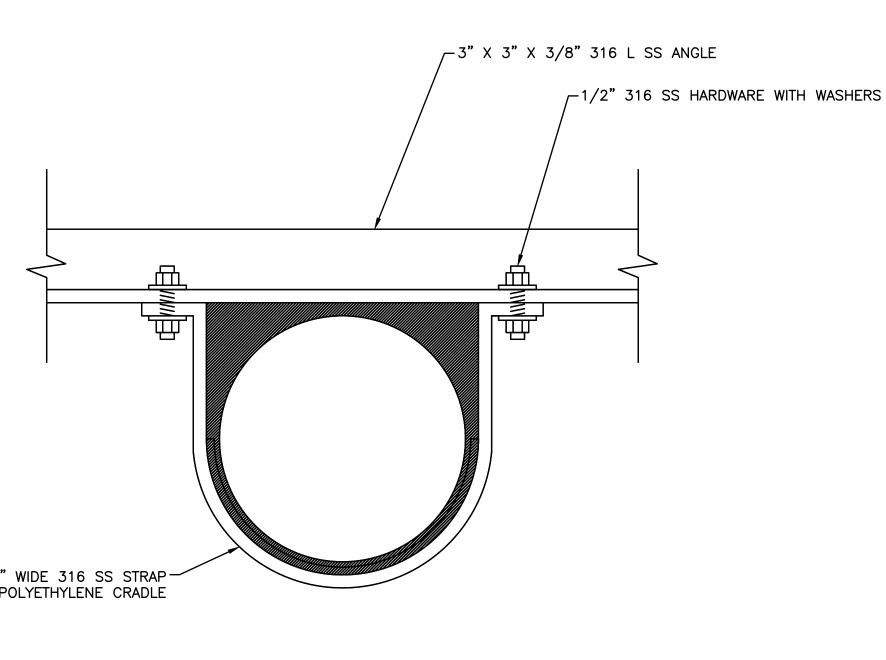


PIPE STRAP SUPPORT N.T.S.

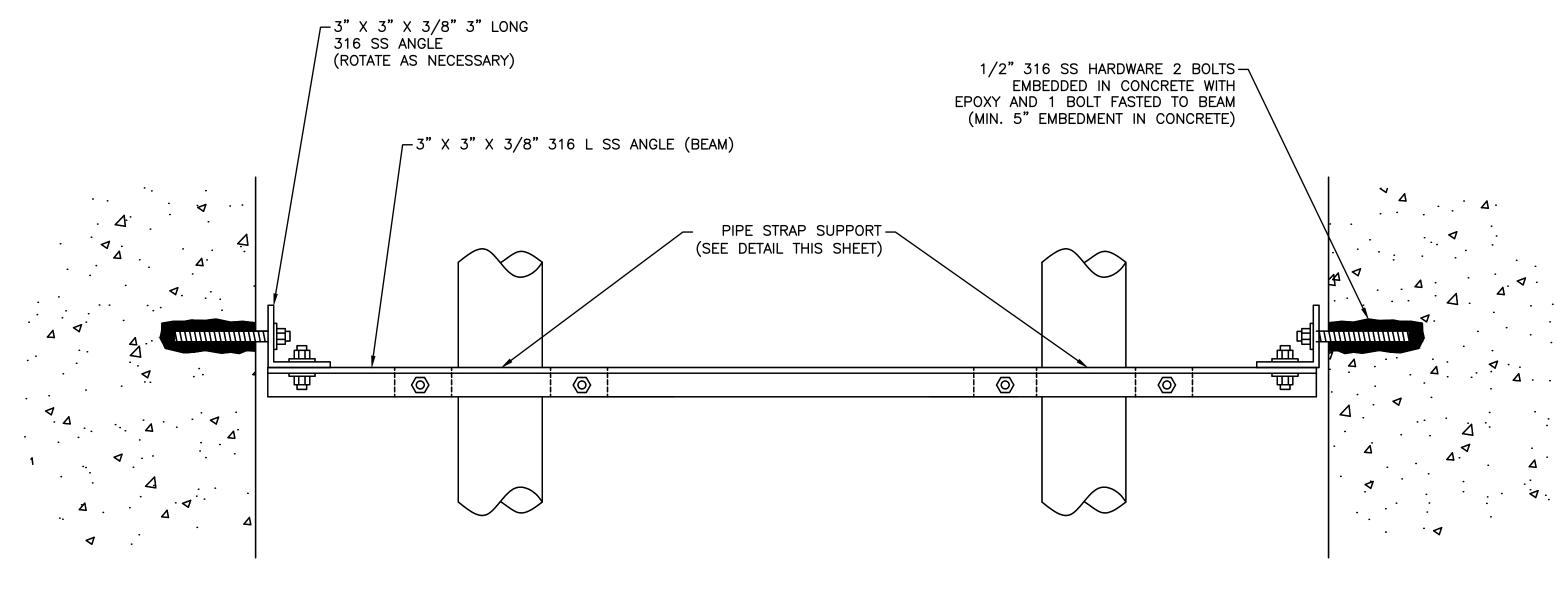



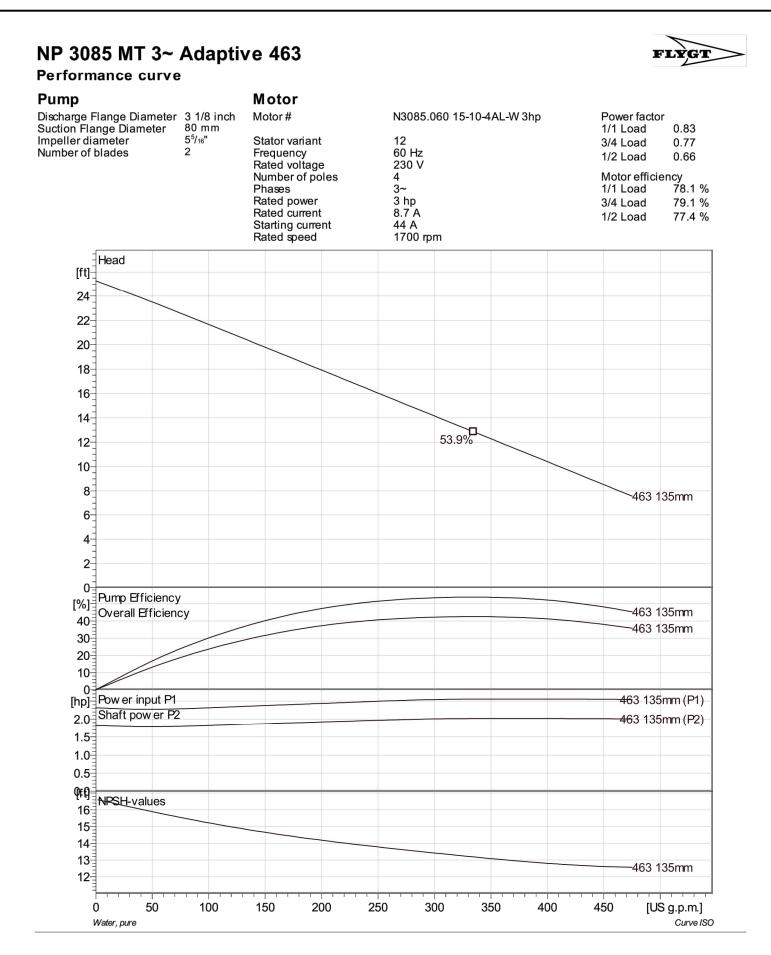

PUMP CURVE DATA

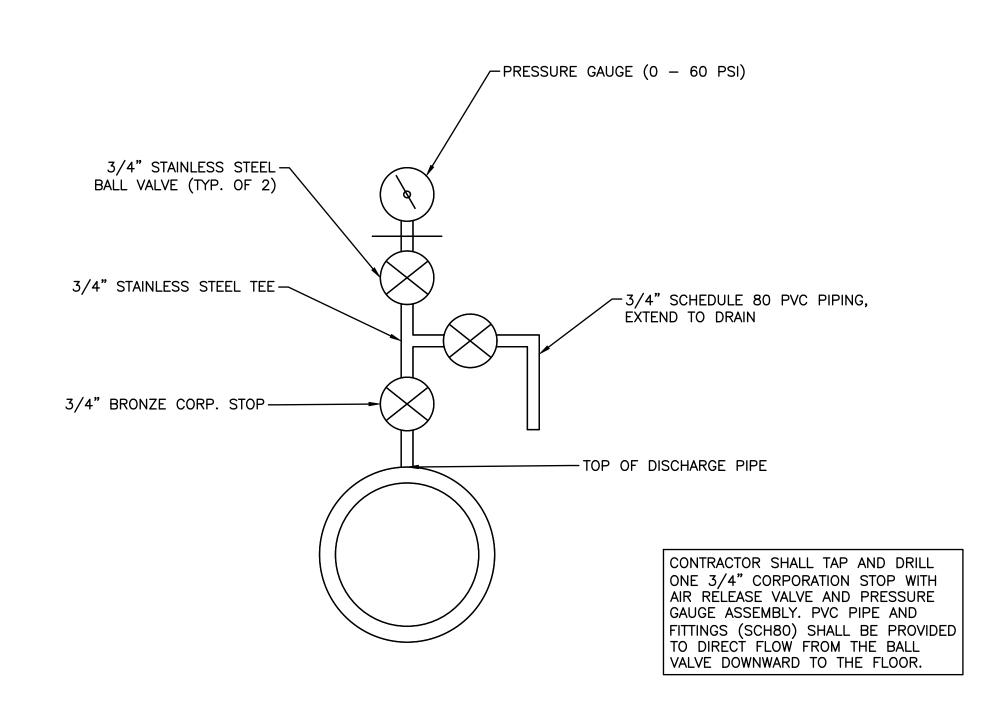

AIR RELEASE AND PRESSURE GAUGE ASSEMBLY


DESCRIPTION

201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952


CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

DETAIL SHEET (1 OF 3)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB JOB NO. TPA2007-01M

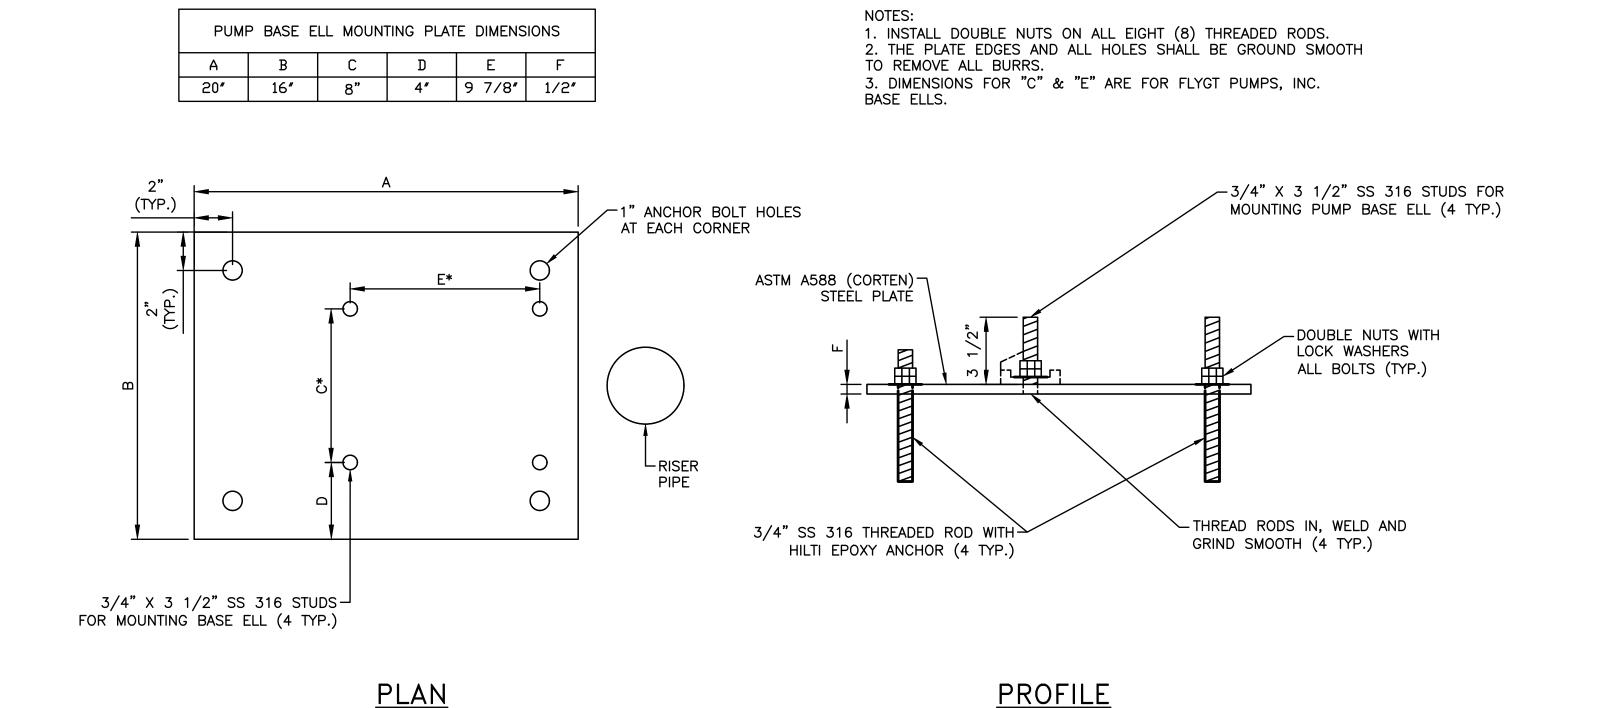

PUMP BASE ELL MOUNTING PLATE DETAIL

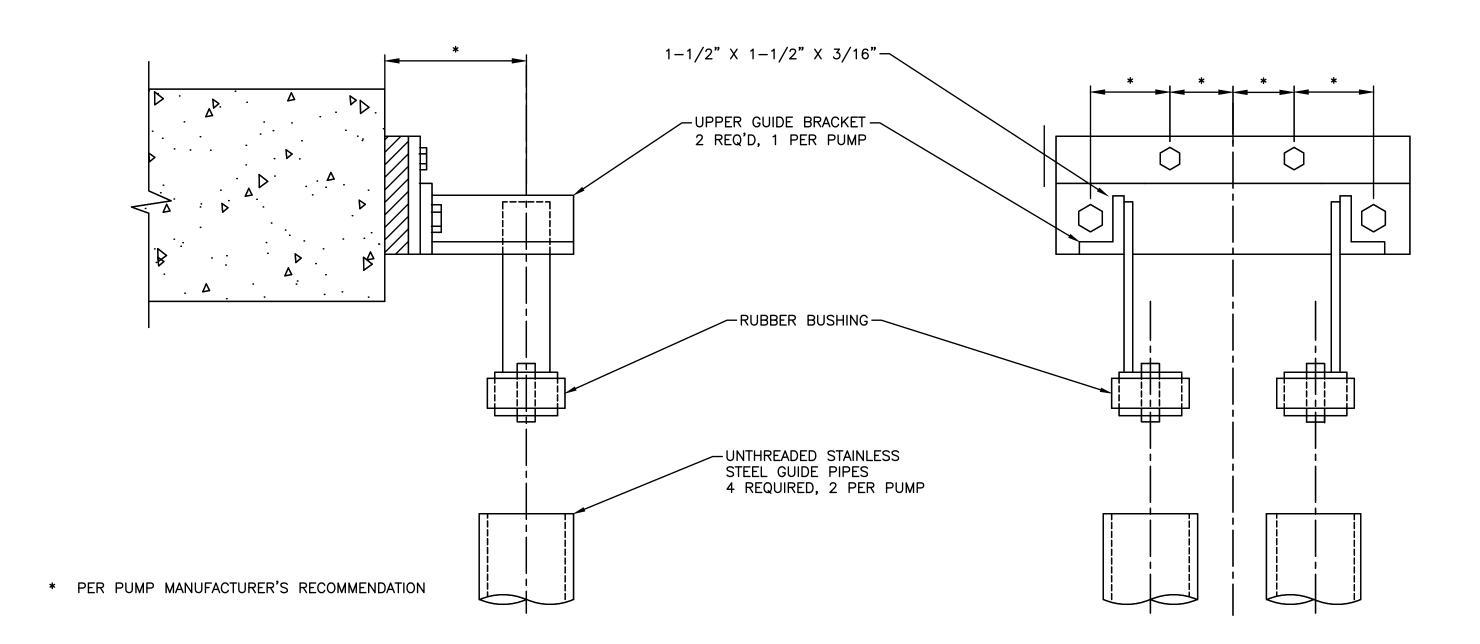

RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 6710

DESCRIPTION

DATE

GUIDE BRACKET DETAIL (SUPPLIED WITH PUMPS)

201 North Franklin Street, Suite 1350
Tampa, FL 33602
CITY OF TAMP

www.wadetrim.com

Certificate of Authorization No.: 3952


CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

DETAIL SHEET (2 OF 3)


| ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB | TPA2007-01M | SHEET |


- \* ALIGNMENT OF ANCHOR BOLTS SHALL BE AS RECOMMENDED BY PUMP MANUFACTURER.
- \*\* CONTRACTOR SHALL PROVIDE A MINIMUM 1/2 INCH BOLT PROTRUSION ABOVE THE FINAL NUT LOCATION AFTER THE NUT IS TIGHTENED TO MANUFACTURE'S RECOMMENDATION.

# ANCHOR BOLT DETAIL N.T.S.

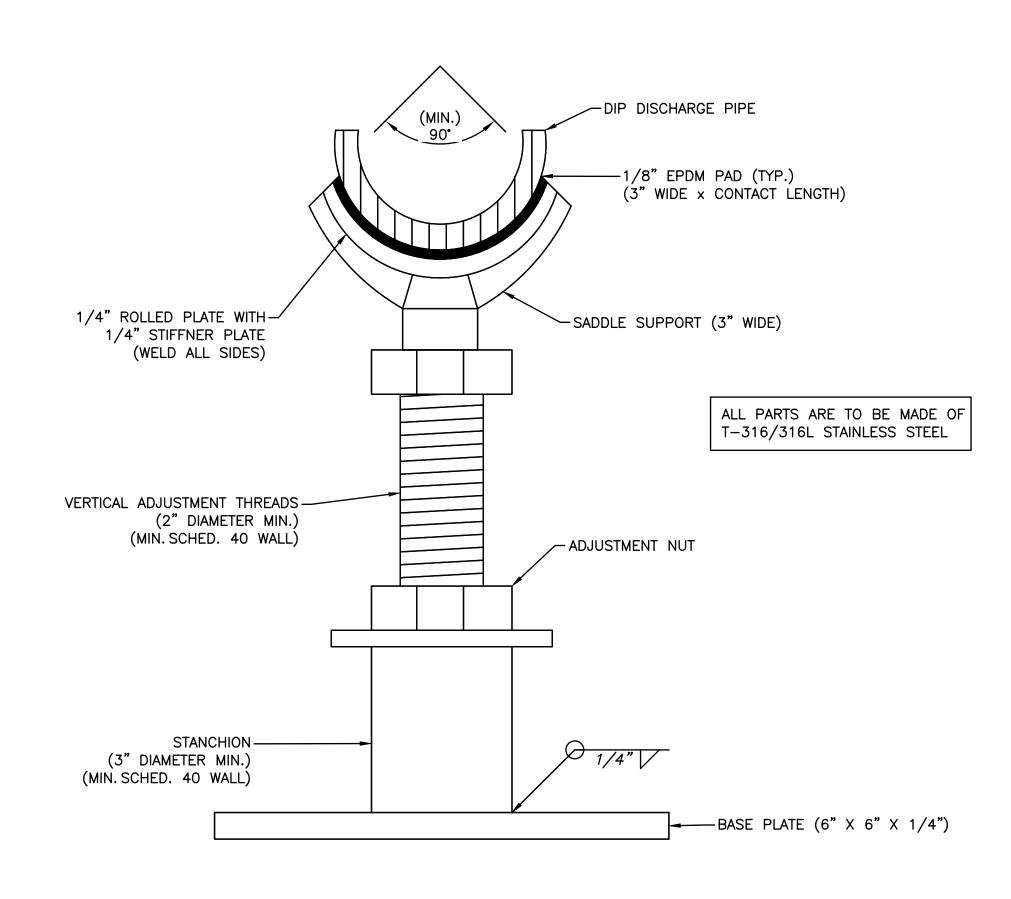

# SECTION VIEW — STAINLESS STEEL STANCHION SADDLE SUPPORT N.T.S.

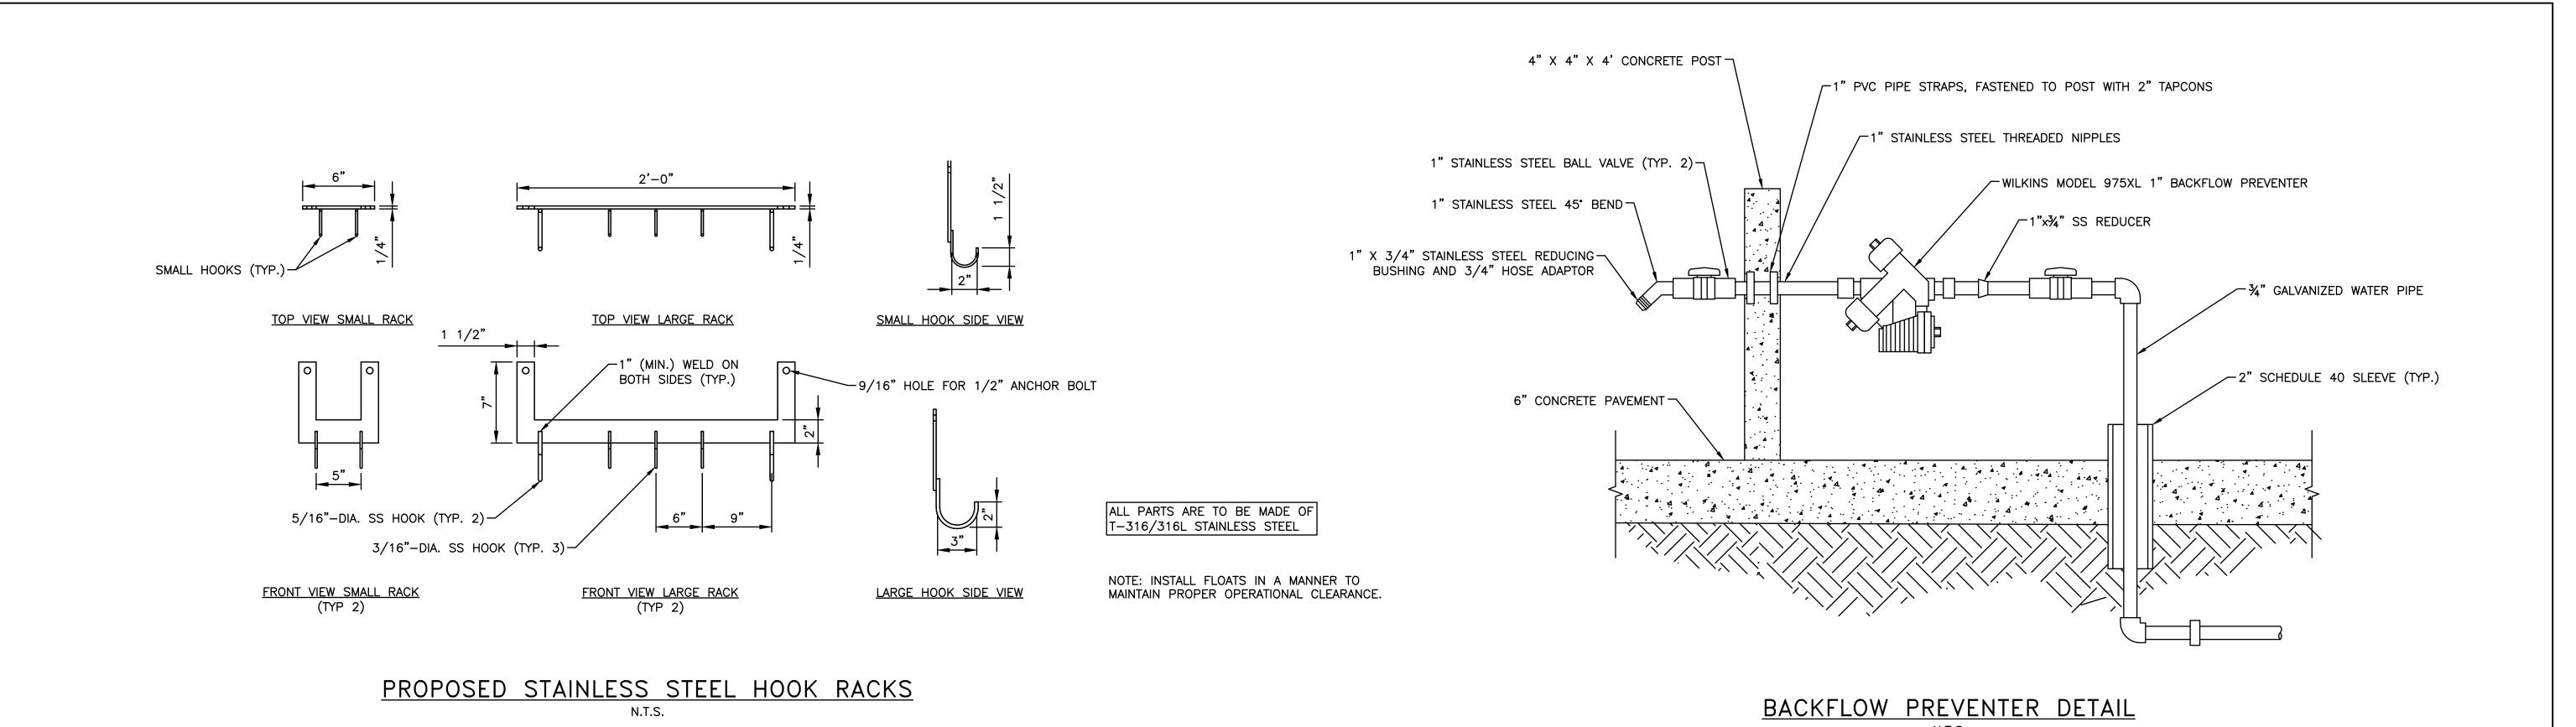

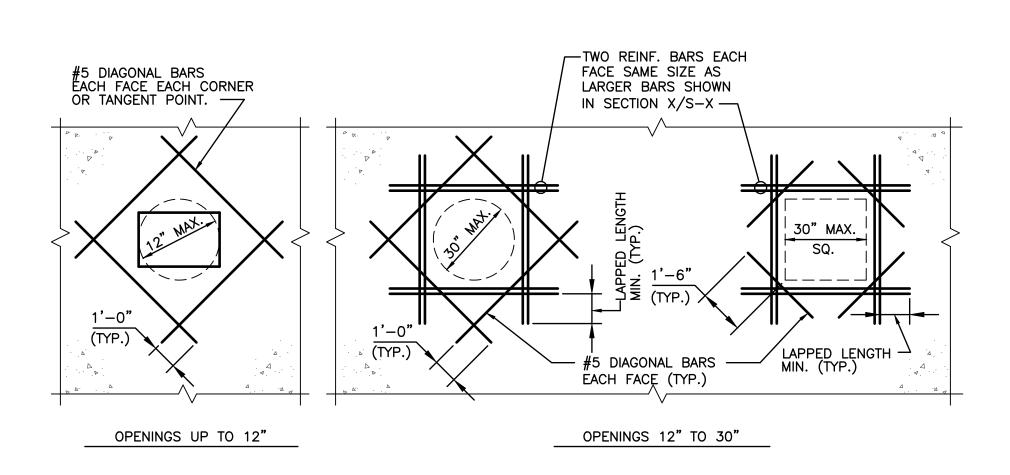

REINFORCEMENT DETAILS FOR SMALL OPENINGS

RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 6710


DATE

DESCRIPTION

201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373

Certificate of Authorization No.: 3952


www.wadetrim.com

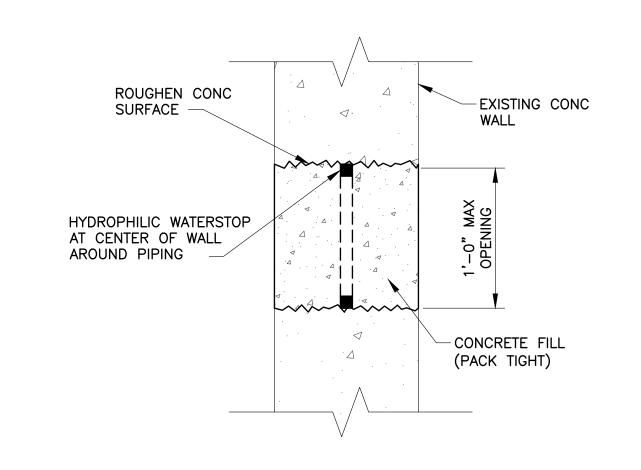

EXISTING WALL PENETRATION
FILL IN DETAIL (12" OR LESS)

CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION

REHABILITATION

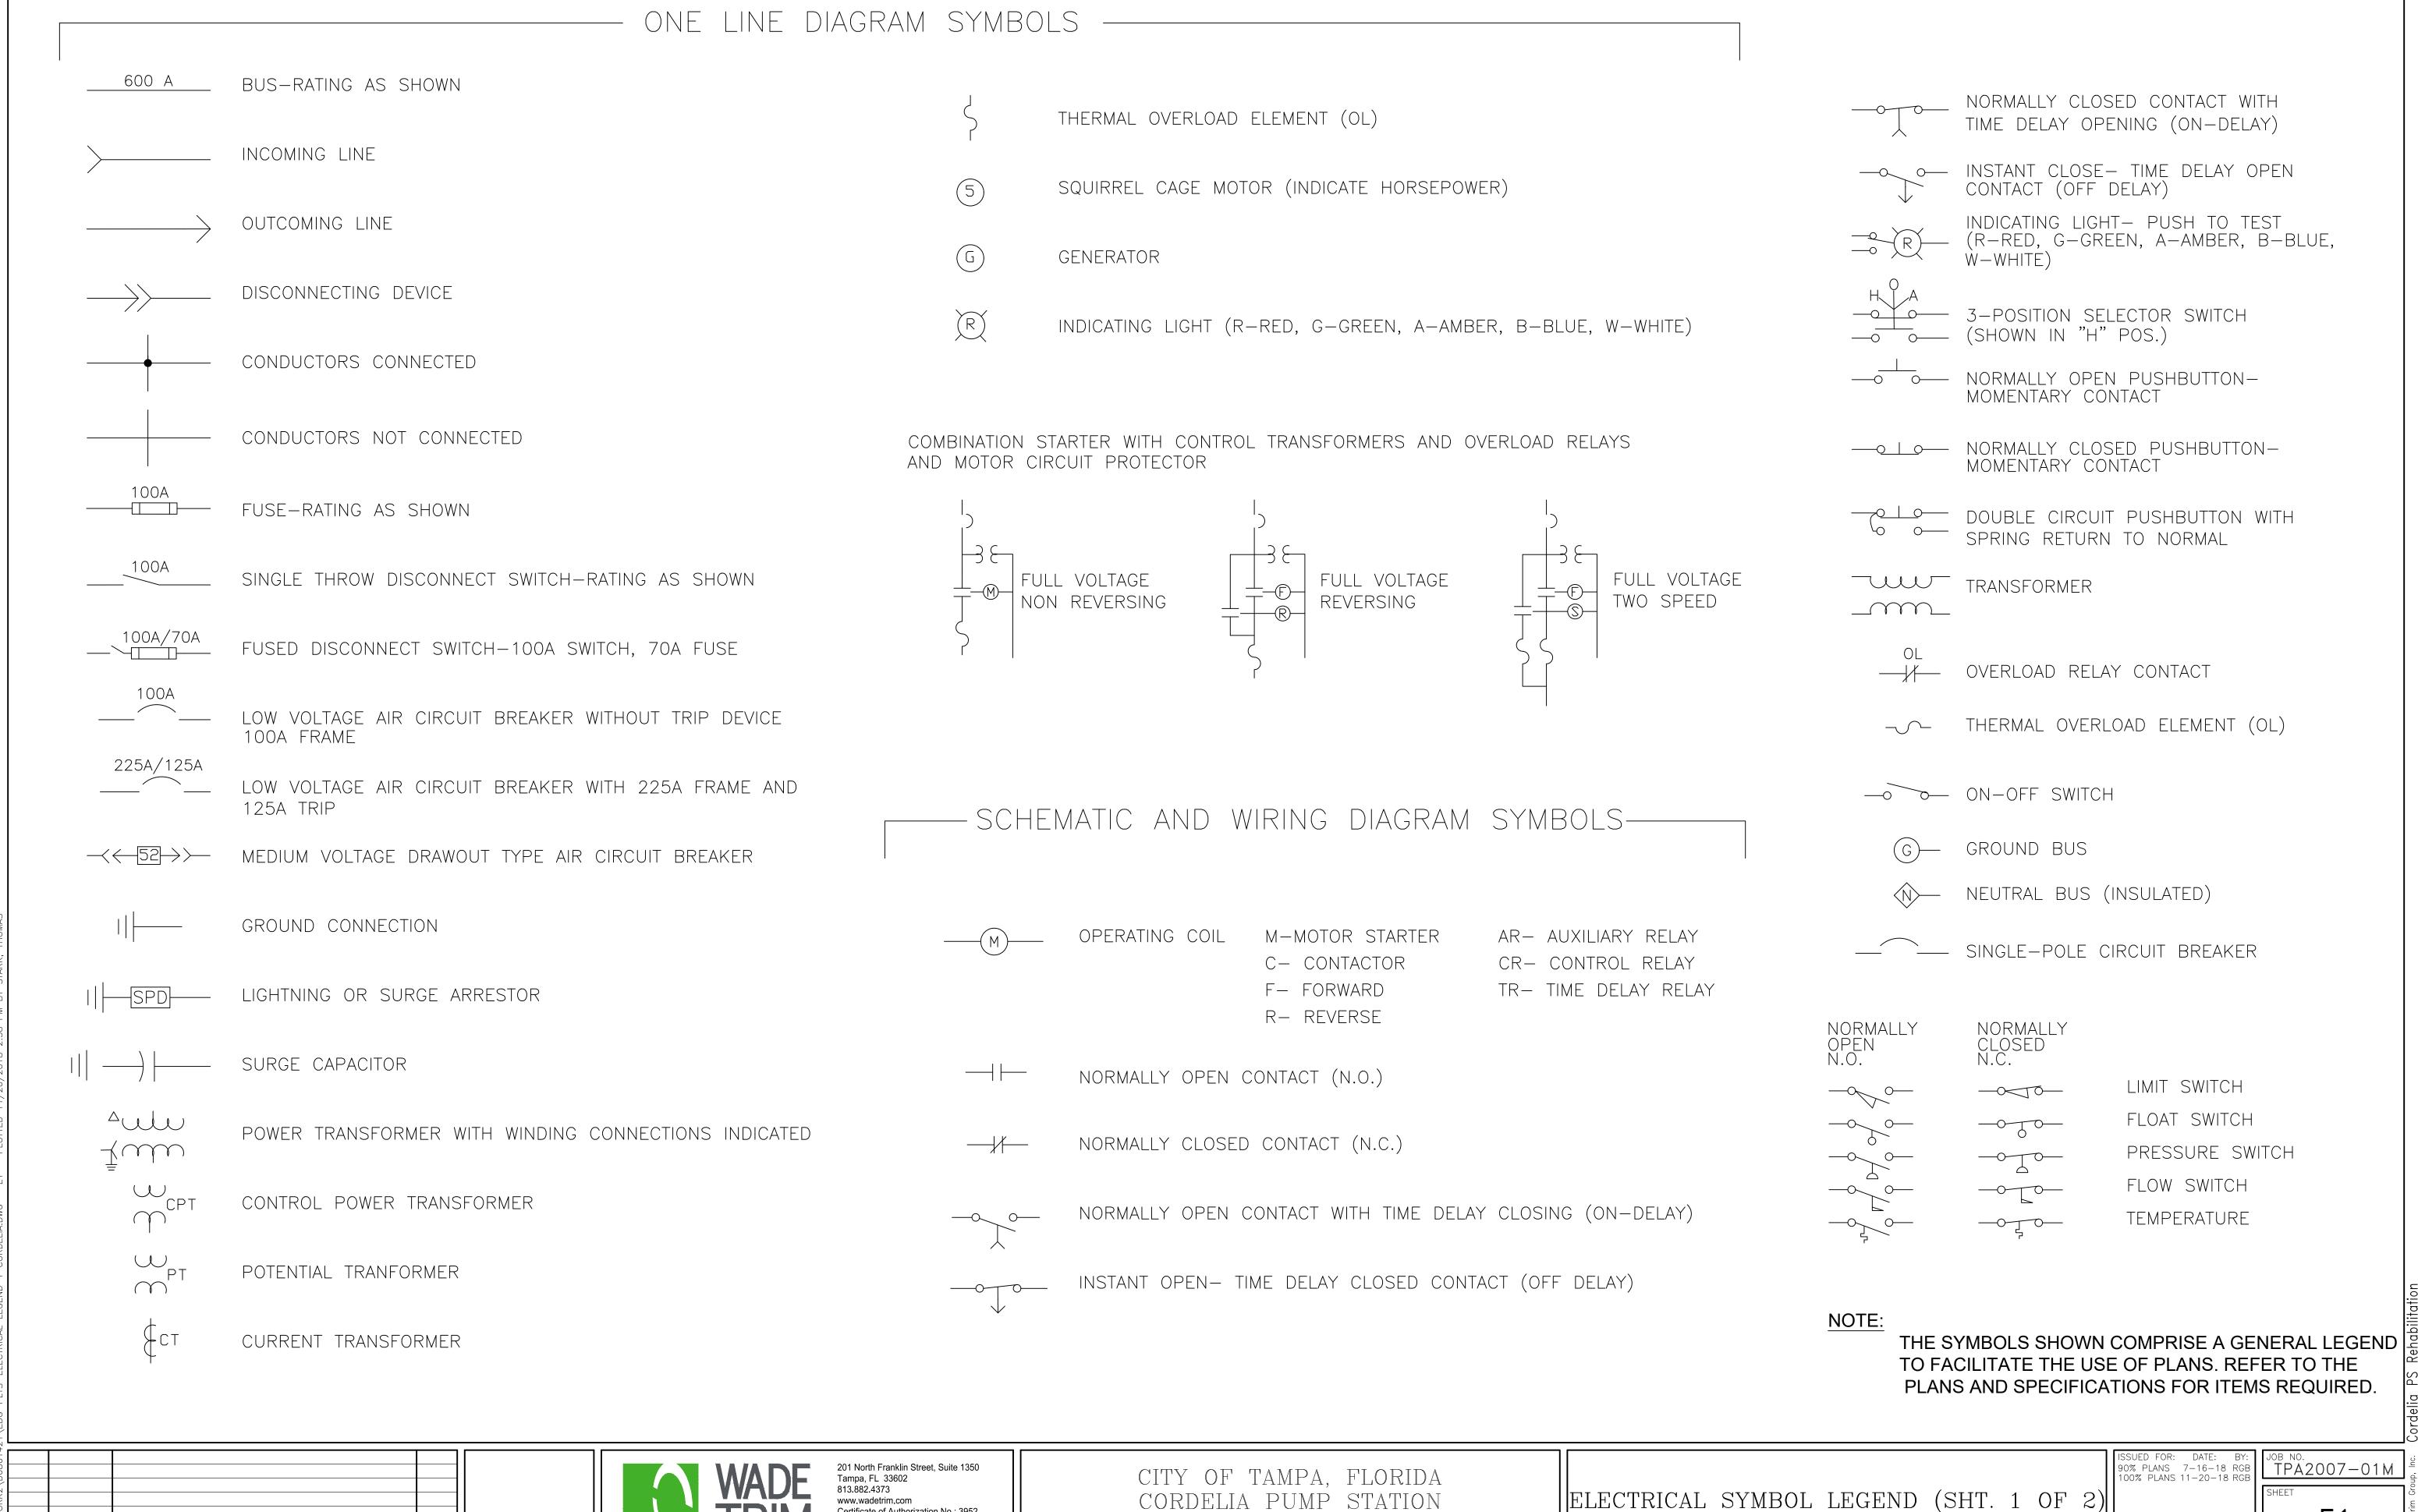

REHABILITATION

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613

DATE

DESCRIPTION

POLE MOUNTED LIGHTING FIXTURE

	EXPOSED CONDUIT RUN
	CONDUIT RUN CONCEALED IN FLOOR OR UNDERGROUND
	CONDUIT RUN CONCEALED IN WALLS, ABOVE SUSPENDED CEILING, OR IN ROOF SLAB
	CONDUIT WITH HOT, NEUTRAL AND GROUND WIRES (LONG LINE IS NEUTRAL; LONG LINE WITH DOTS DENOTE GROUND)
PNL-1 1,3,5	HOMERUN TO LIGHTING PANELBOARD (PNL-1 INDICATES PANELBOARD AND 1, 3, 5 INDICATES 20A-1P CKTS. 1, 3 AND 5)
	FLEXIBLE LIQUIDTIGHT CONDUIT
	CONDUIT-UP (OR TOWARDS VIEWER)
•	CONDUIT-DOWN (OR AWAY FROM VIEWER)
	GROUNDING CONDUCTOR
	GROUND ROD
X	LIGHTNING ROD
	CEILING MOUNTED INCANDESCENT OR MERCURY VAPOR FIXTURE. "A" INDICATES FIXTURE TYPE LISTED IN SCHEDULE
	WALL MOUNTED LIGHTING FIXTURE
	EXIT SIGN
	EMERGENCY INCANDESCENT OR MERCURY VAPOR LIGHTING FIXTURE
	FLUORESCENT FIXTURE
	EMERGENCY FLUORESCENT FIXTURE

4	DUPLEX RECEPTACLE— 20 A, 120 V, 3 WIRE (TO PNL— CIRCUIT No.4)
	SINGLE RECEPTACLE - 2 POLE, 3 WIRE, 240V, RATING NOTED
60 A	3 POLE, 4 WIRE, 240V WELDING OUTLET (60 A)
<del></del>	SINGLE POLE SWITCH
<del>(∕)</del> 2P	TWO POLE SWITCH
<del></del>	THREE WAY SWITCH
J	OUTLET BOX WITH BLANK COVER
JB	JUNCTION BOX
РВ	PULL BOX
ТВ	TERMINAL BOX
	GENERAL SYMBOLS
•	START-STOP PUSHBUTTON
ON/OFF	ON-OFF MAINTAINED CONTACT PUSHBUTTON WITH LOCK ATTACHMENT
• • • S/L	INDICATING LIGHT AND START-STOP PUSHBUTTON WITH LOCK ATTACHMENT ON STOP
RESUME STOP/L	PUSH/PULL BUTTON WITH STOP LOCK. (PULL TO RESUME- PUSH TO STOP)
	SELECTOR SWITCH ("HOA" INDICATES HAND, OFF, AND AUTO;

FL	FLOW SWITCH
LS	LIMIT SWITCH
P	PRESSURE SWITCH
S	SOLENOID OPERATED VALVE
T	TEMPERATURE SWITCH
F	FLOAT SWITCH
L	LEVEL TRANSMITTER (PRESSURE ANALOG TYPE)
LC	LEVEL TRANSMITTER (FLOAT TYPE)
Т	TEMPERATURE TRANSMITTER
FT	FLOW TRANSMITTER
МН	DESIGNATES MOUNTING HEIGHT
WP	DESIGNATES WATERPROOF EQUIPMENT
XP	DESIGNATES EXPLOSIONPROOF EQUIPMENT
MOV	DESIGNATES MOTOR OPERATED VALVE

NOTE:

THE SYMBOLS SHOWN COMPRISE A GENERAL LEGEND TO FACILITATE THE USE OF PLANS. REFER TO THE PLANS AND SPECIFICATIONS FOR ITEMS REQUIRED.

DESIGNATES EXISTING EQUIPMENT

DESIGNATES PROPOSED EQUIPMENT

DESCRIPTION





"MOR" INDICATES MANUAL, OFF, AND REMOTE; ETC)

ON-OFF SWITCH WITH LOCK ATTACHMENT ON OFF POSITION

- 2. ALL POWER CONDUCTORS SHALL BE STRANDED COPPER, #12 AWG MIN. W/XHHW-2 INSULATION, UNLESS OTHERWISE NOTED.
- 3. ALL WIRING SHALL BE IDENTIFIED W/NUMBERS AT ALL TERMINALS AND ON WIRING DIAGRAMS.
- 4. VERIFY ALL MECHANICAL EQUIPMENT SIZES AND RATING PRIOR TO CONNECTING.
- 5. FIELD VERIFY ALL EQUIPMENT LOCATIONS AND CONNECTIONS PRIOR TO COMMENCING CONSTRUCTION.
- 6. PLANS ARE DESIGNED IN ACCORDANCE WITH THE 6TH EDITION 2017 OF THE FLORIDA BUILDING CODE AND THE 2014 EDITION OF THE NATIONAL ELECTRICAL CODE. CONTRACTOR SHALL ENSURE THAT ALL ELECTRICAL WORK PERFORMED SHALL ADHERE TO THE SAME ACCORDANCE AND ALL APPLICABLE LOCAL ORDINANCES.
- 7. ALL THREADED CONNECTIONS SHALL BE COATED W/ ALUMA—SHIELD ANTI—SIEZE COMPOUND MANUFACTURED BY THOMAS & BETTS (T & B) OR EQUAL.
- 8. ALL PANELS, DISCONNECTS, SWITCHES, AND EQUIPMENT COVERPLATES SHALL BE LABELED W/ NAMEPLATES. NAMEPLATES SHALL BE THREE-PLY PHENOLIC BLACK-WHITE-BLACK ENGRAVED THROUGH THE FIRST BLACK LAYER. LETTERING SHALL BE 0.5 CM (3/16") MIN. EDGE OF NAMEPLATE SHALL BE BEVELED 45 DEG.
- 9. ALL CONDUIT SHALL BE SUPPORTED AT MAXIMUM 5'-0" INTERVALS.
- 10. ALL CIRCUITS SHALL HAVE A PROPERLY SIZED GROUNDING CONDUCTOR ROUTED INSIDE EACH CONDUIT W/ POWER CONDUCTORS.
- 11. ALL CONDUCTOR LENGTHS SHALL BE CONTINUOUS, NO SPLICES OR CONDUCTOR TERMINATIONS SHALL BE PERMITTED UNLESS SPECIFICALLY DESIGNED IN THE DRAWINGS.
- 12. NEATLY COIL ALL SPARE CONDUCTORS & TAPE W/ VINYL ELECTRICAL TAPE (SCOTCH 33+).
- 13. PROVIDE A MINIMUM OF 3'-6" CLEARANCE IN FRONT OF ALL ELECTRICAL EQUIPMENT IN ACCORDANCE W/ ARTICLE 110 OF THE NEC.
- 14. ALL FASTENING HARDWARE (SCREW, BOLTS NUTS ETC.) SHALL BE 316-STAINLESS STEEL. FASTENING HARDWARE CONSTRUCTED OF FERROUS MATERIAL ARE NOT ACCEPTABLE.
- 15. EXPOSED CONDUITS SHALL BE NON-COATED RIGID ALUMINUM CONDUIT, UNLESS OTHERWISE NOTED (UON). INSTALL PVC COATED RIGID ALUMINUM CONDUIT TO THE WET WELL. UNLESS OTHERWISE NOTED (UON).
- 16. DIRECT BURIED AND CONCRETE ENCASED CONDUIT SHALL BE SCHEDULE 80 PVC, UNLESS OTHERWISE NOTED. TRANSITIONS FROM ABOVE-GRADE RIGID ALUMINUM CONDUIT TO NONMETALLIC CONDUIT SHALL BE ACCOMPLISHED WITH A THREADED ADAPTER. RIGID ALUMINUM CONDUIT INSTALLED ABOVE GRADE AND EXTENDING BELOW GRADE SHALL INCLUDE THE FIRST 90° ELBOW. ALL RIGID ALUMINUM CONDUITS EXTENDING BELOW GRADE SHALL BE COATED WITH TWO COATS OF ASPHALTUM-TYPE PAINT ALONG ITS ENTIRE LENGTH BELOW GRADE AND EXTENDING 6" ABOVE GRADE OR ABOVE THE TOP OF THE FINISHED SLAB.
- 17. ABOVE GRADE INDOOR, AND NON-WASHDOWN AREAS, RIGID ALUMINUM CONDUIT CONNECTIONS TO CONTROL BOXES, ETC. SHALL BE MADE WITH ALUMINUM DOUBLE LOCKNUTS AND BUSHINGS. TURN DOWN ON THREADS TO SOLIDLY CONNECT RACEWAY TO BOX OR ENCLOSURE.
- 18. ALUMINUM WATERTIGHT HUBS (MYERS HUBS) SHALL BE USED FOR CONNECTIONS TO CONTROL BOXES, ETC. MOUNTED OUTDOORS, BELOW GRADE, OR WASHDOWN AREAS.
- 19. A 316-STAINLESS STEEL CHANNEL ERECTOR SYSTEM SHALL BE USED TO SUPPORT ALL CONDUITS, BOXES ETC. USE 316 STAINLESS STEEL MOUNTING HARDWARE.
- 20. THE CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND MAKE ADJUSTMENTS AS NECESSARY TO EXECUTE THE PROPOSED INSTALLATIONS.
- 21. ALL EXISTING INSTALLATIONS DENOTED ON THE DRAWINGS ARE FOR THE CONTRACTORS REFERENCE ONLY. ALL EXISTING INSTALLATIONS SHALL BE FIELD VERIFIED PRIOR TO SUBMITTING A BID AND PRIOR TO COMMENCING CONSTRUCTION.
- 22. PULL BOXES SHALL BE INSTALLED AS NECESSARY TO FACILITATE WIRE PULLS AND AVOID EXCESSIVE PULLING TENSION ON WIRING. IN NO CASE SHALL CONDUIT LENGTHS EXCEED 150' OR THE EQUIVALENT OF FOUR QUARTER BENDS (360 DEGREES TOTAL) WITHOUT A PULL BOX. PULL BOXES SHALL BE SIZED IN ACCORDANCE WITH ARTICLE 314 OF THE NEC.

- 23. THE WET WELL CLASSIFICATION IS CLASS 1, DIVISION 1, GROUP D, (HAZARDOUS AREA) NEC CHAPTER 5 IS APPLICABLE FOR INTERFACING WET WELL AND THE CONTROL ENCLOSURE.
- 24. ALL ELECTRICAL WORK SHALL BE PERFORMED WITHIN 2014 NEC AND CITY OF TAMPA/ HILLSBOROUGH COUNTY CODES AND SHALL BE INSPECTED BY CITY OF TAMPA/ HILLSBOROUGH COUNTY ELECTRICAL INSPECTORS AS APPLICABLE.
- 25. ALL ELECTRICAL COMPONENTS SHALL BE UL LISTED AND AS SPECIFIED, OR AS APPROVED BY THE ENGINEER. THE PANEL BUILDER SHALL BE UL-508A CERTIFIED AND A UL LABEL SHALL BE ATTACHED TO THE INSIDE OF THE ENCLOSURE. THE DOUBLE THROW DISCONNECT MUST BE LABELED "SUITABLE FOR USE AS SERVICE EQUIPMENT."
- 26. THE ENCLOSURES SHALL BE NEMA 4X, THEY SHALL BE CONSTRUCTED OF MINIMUM 14 GAUGE 304SS, THEY SHALL HAVE RAL 9003 WHITE POWDER COAT AND THE CLOSING SURFACES SHALL HAVE ROLLED LIPS, PROVIDE HINGED DOORS WITH 3-POINT LATCHED AND LOCKABLE HANDLES.
- 27. ALL COMPONENTS TO BE MOUNTED ON PANEL USING TAPPED HOLES.
- 28. ALL CONTROL WIRING SHALL BE STRANDED XHHW-2 COPPER, MINIMUM AWG #14 AND SHALL HAVE SPADE LUG TERMINATIONS.
- 29. ALARM FLOAT SWITCH WILL BE SUPPLIED BY THE CITY, BUT INSTALLED BY CONTRACTOR.
- 30. DIMENSIONS, ITEMS, OR ELEVATIONS MARKED "\*" TO BE DETERMINED AFTER EQUIPMENT SELECTION.
- 31. ALL MECHANICAL CONNECTORS SHALL BE TORQUED PER NEC, UL OR MANUFACTURES SPECIFICATIONS.
- 32. INSTALL LAMINATED SCHEMATIC, LAMINATED DATA SHEET AND LAMINATED SOFT STARTER SETUP PARAMETERS ON BACK FACE OF THE DOOR INSIDE THE ENCLOSURE.
- 33. ENSURE THAT LINE CONNECTIONS TO METER SOCKET PROVIDE CORRECT MOTOR ROTATION.
- 34. CONDUCTORS WITHIN THE ENCLOSURE AND NOT ROUTED IN WIREWAYS, SHALL BE SECURED TO THE BACK PANEL WITH MECHANICAL FASTENERS, FASTENERS SECURED WITH ADHESIVE ARE NOT ACCEPTABLE.
- 35. ALL HINGED SURFACES SHALL BE GROUNDED WITH A BONDING JUMPER SECURED TO THE ENCLOSURE OR BACKPANEL.
- 36. THE PCSR SHALL BE MOTOROLA ACE 3600 PACKAGE AS DISTRIBUTED BY DCR ENGINEERING SERVICES INC., OR REVERE CONTROL SYSTEMS. THE PUMPING STATION CONTRACTOR SHALL COORDINATE HIS EFFORTS WITH DCR, OR REVERE CONTROL SYSTEMS TO ENSURE SYSTEM COMPATIBILITY. THE CONTRACTOR SHALL PROVIDE AND INSTALL A COMPLETE DUPLEX CONTROL SYSTEM/SCADA PACKAGE, AS PROGRAMMED BY DCR, OR REVERE CONTROLS — THE EXISTING PUMPING STATION DCR CONTROLS SHALL REVERT TO THE CITY AS A SPARE.
- 37. A WET WELL LEVEL DETECTION SYSTEM SHALL BE PROVIDED AND INSTALLED BY THE CONTRACTOR. THE OUTPUT SHALL BE A LINEAR 4-20mA SIGNAL WITH RANGE AND CALIBRATION SUITABLE FOR THIS APPLICATION. THE SYSTEM SHALL BE OF THE ULTRASONIC TYPE-PULSAR, INC. MODEL dB10 W/ BLACKBOX 130 TRANSMITTER. CITY INSTRUMENTATION PERSONNEL WILL ASSIST THE CONTRACTOR WITH SPECIFYING THE TRANSDUCER MOUNTING LOCATION AND CALIBRATION. THE dB10 TRANSDUCER SHALL BE MOUNTED USING A 2 1/2" x 1/4" S.S. BRACKET, SEE dB10 MOUNTING BRACKET DETAIL, SHEET E18.
- 38. PROVIDE 1/4" MINIMUM THICKNESS LEXAN SHIELDS OVER POWER DISTRIBUTION BLOCK AND OTHER EXPOSED CABLE TERMINATIONS.
- 39. XHHW-2 CONDUCTORS (3-#10 AWG + 1-#10 AWG GND. CU FOR EACH MOTOR) SHALL EXTEND FROM THE CONTROL PANEL TO ASSOCIATED HIGH VOLTAGE JUNCTION BOX. PROVIDE SEAL-OFF BETWEEN CONTROL PANEL AND JUNCTION BOX AS INDICATED. THE SHOWN SEAL-OFFS SHALL BE ALUMINUM BODY, CROUSE-HINDS, OR EQUIVALENT.
- 40. ALUMINUM CONDUIT SURFACE THAT IS A CONTACT WITH SOIL OR CONCRETE SHALL BE COATED WITH TWO COATS ASPALT VARNISH (FED. SPEC. TT-V-51) EXTENDING 4" BEYOND FINAL CONTACT POINT.
- 41. STAINLESS STEEL HANGERS TO SUPPORT THE EXCESS LENGTH OF MOTOR CABLES SHALL BE INSTALLED IN THE WET WELL. THESE HANGERS SHALL BE LOCATED IN A SEPARATE AREA FROM THE HANGERS SUPPORTING THE PUMP CHAINS.

SCOPE OF WORK:

- 1. THE CONTRACTOR SHALL COORDINATE ELECTRICAL SERVICE REQUIREMENTS WITH TAMPA ELECTRIC COMPANY (TECO). THE CITY WILL MAKE PRELIMINARY ARRANGEMENTS WITH TECO AND COMPENSATE THE UTILITY DIRECTLY FOR ANY CONTRIBUTION IN AID OF CONSTRUCTION (CIAC) REQUIRED FOR TECO TO INSTALL A HANDHOLE AT THE BASE OF THE EXISTING TECO POLE. THE PROPOSED SERVICE VOLTAGE SHALL REMAIN 120/240 VAC, 3PH, 4W, DELTA AT CORDELIA PS.
- 2. REMOVE THE EXISTING METER SOCKET, LIGHTNING ARRESTOR, AND ALL ASSOCIATED CONDUIT AND CONDUCTORS, AS SHOWN ON PLANS.
- 3. NEW DCR SCADA RTU CABINET, ANTENNA, AND MAST ARE TO BE PROVIDED AND INSTALLED.
- 4. ANY SALVAGEABLE MATERIALS, AS DETERMINED BY THE ENGINEER, SHALL BE DELIVERED, BY THE CONTRACTOR, TO THE HOWARD F. CURREN AWTP. THE CONTRACTOR SHALL PROPERLY DISPOSE OF ALL OTHER REMOVED EQUIPMENT.
- 5. PROVIDE AND INSTALL A NEW ELECTRICAL METER SOCKET, LIGHTNING ARRESTOR AND GROUNDING, AS SHOWN ON PLANS.
- 6. PREPARE THE SITE FOR THE INSTALLATION OF THE PROPOSED CONTROL EQUIPMENT.
- 7. PROVIDE AND INSTALL A NEW DUPLEX PUMP CONTROL PANEL. THE PUMP CONTROL PANEL SHALL CONTAIN CONTROL COMPONENTS, INDICATOR LIGHTS, AND SCADA RTU, AS SHOWN ON PLANS AND DETAILED IN SPECIFICATIONS.
- 8. PROVIDE AND INSTALL A WET WELL ISOLATION JUNCTION BOX FOR PUMP MOTOR CONNECTIONS.
- 9. PROVIDE AND INSTALL A NEW DUPLEX MOTOR CONTROL PANEL. THE MOTOR CONTROL PANEL SHALL CONTAIN CIRCUIT BREAKERS AND MOTOR STARTERS, AS SHOWN ON PLANS AND DETAILED IN SPECIFICATIONS.
- 10. PROVIDE AND INSTALL WET WELL ISOLATION BOX FOR INSTRUMENTATION AND CONTROL CONNECTIONS.
- 11. PROVIDE AND INSTALL A NEMA 4X, SERVICE ENTRANCE RATED, FUSED DOUBLE THROW SWITCH, AS SHOWN ON PLANS.
- 12. PROVIDE AND INSTALL EMERGENCY POWER CONNECTOR, AS SHOWN ON PLANS.
- 13. PROVIDE AND INSTALL SCADA ANTENNA & MAST. AS SHOWN ON PLANS.
- 14. PROVIDE AND INSTALL AREA LIGHT. AS SHOWN ON PLANS.
- 15. CALIBRATE AND ADJUST SETPOINTS FOR ALL SENSING DEVICES, ALARM DEVICES. AND TIMERS. CALIBRATION AND SETPOINTS SHALL BE PROVIDED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- 16. FURNISH AND INSTALL NEMA 4X JUNCTION BOXES, AS SHOWN ON PLANS.
- 17. PROVIDE FOR PROPER GROUNDING AS SHOWN, SPECIFIED, AND REQUIRED.
- 18. PROVIDE AND INSTALL ALL NECESSARY CONDUITS AND CONDUCTORS, AS SHOWN, SPECIFIED AND REQUIRED.
- 19. ALL ELECTRICAL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE 2014 EDITION OF THE NATIONAL ELECTRIC CODE AND CHAPTER 5 OF THE CITY OF TAMPA CODE.
- 20. REFER TO CIVIL/MECHANICAL SHEETS FOR BYPASS PUMPING REQUIREMENTS. IF ELECTRICALLY DRIVEN BYPASS PUMPS ARE UTILIZED. THE CONTRACTOR SHALL COORDINATE ALL TEMPORARY ELECTRICAL SERVICE REQUIREMENTS WITH TAMPA ELECTRIC COMPANY (TECO). ANY COSTS ASSOCIATED WITH TEMPORARY ELECTRIC POWER ARE TO BE INCLUDED IN THE LUMP SUM PRICE AND NO SEPERATE PAYMENT WILL BE MADE.




201 North Franklin Street, Suite 1350 Tampa, FL 33602 Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

TPA2007-01M 100% PLANS 11-20-18 RGB

THIS SHEET HAS BEEN LEFT INTENTIONALLY BLANK CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION RDELIA STREET PUMP BLANK SHEET

DESCRIPTION

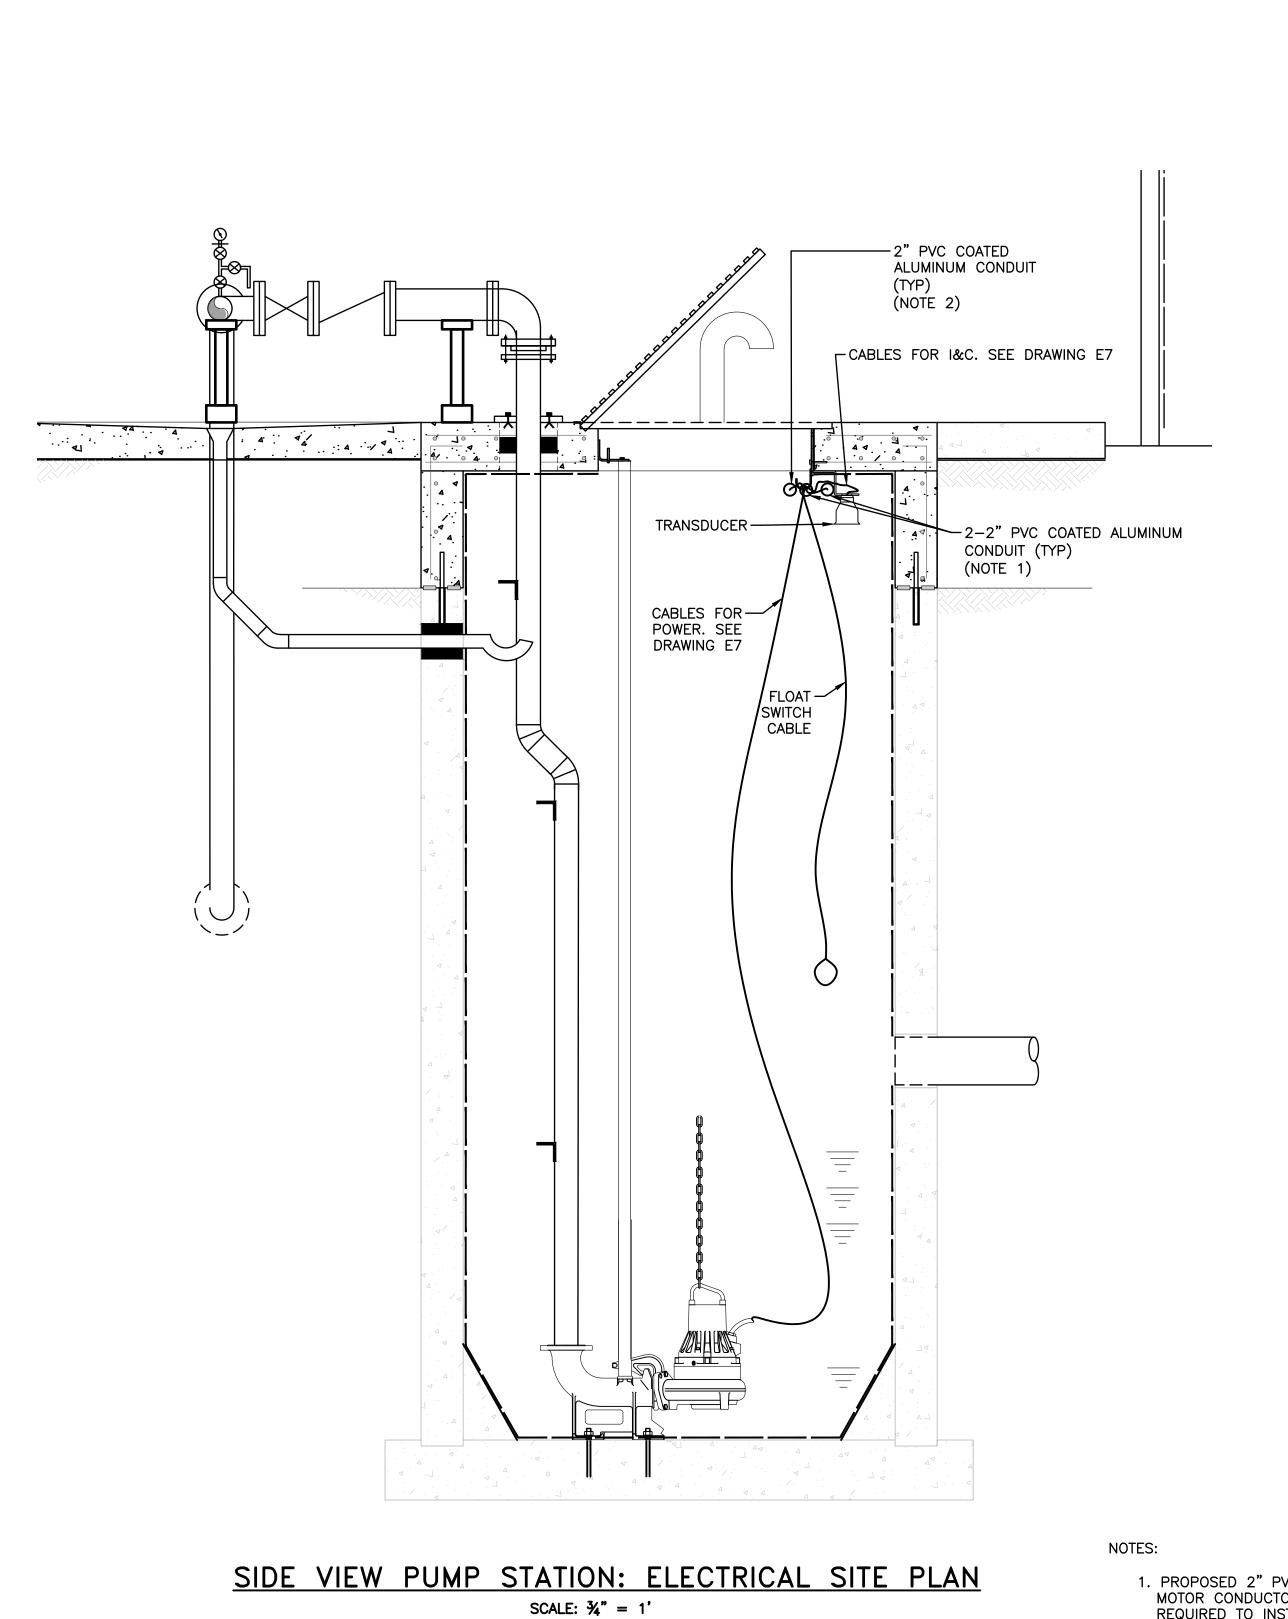

LHOSE BIB -CABLE HOOKS ~2-2" CONDUIT FOR PUMP POWER 2" CONDUIT FOR I&C-PUMP CONTROL PANEL Z" CONDUIT TO
HANDHOLE AT BASE
OF UTILITY POLE.
SEE DRAWING E7 .00 CONTROL PANEL — SEE DRAWING E18A, E18B FOR DETAILS -3/4" CONDUIT \_AREA LIGHT 1" CONDUIT -MOTOR CONTROL PANEL -GROUNDING CONDUCTOR -

 PROPOSED 2" PVC COATED ALUMINUM CONDUITS FOR MOTOR CONDUCTORS. CORE DRILL WET WELL WALL AS REQUIRED TO INSTALL CONDUIT USING LINK—SEALS. LINK—SEALS SHALL BE PROVIDED WITH 316 STAINLESS STEEL BOLTS AND NUTS.

 PROPOSED 2" PVC COATED ALUMINUM CONDUIT FOR I&C CONDUCTORS. INSTALL CONDUIT AS DESCRIBED IN NOTE 1.

# PUMP STATION: ELECTRICAL SITE PLAN

SCALE: 3/4" = 1'

PEV# DATE DESCRIPTION BY ALAN M. SCHI




201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

CORDELIA STREET PUMP STATION SITE PLAN | SSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB | SHEET | SHEET | SUBJECT | SHEET | SHEET | STATE | SHEET | SHEET

THIS SHEET HAS BEEN LEFT INTENTIONALLY BLANK CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION RDELIA STREET PUMP BLANK SHEET

DESCRIPTION

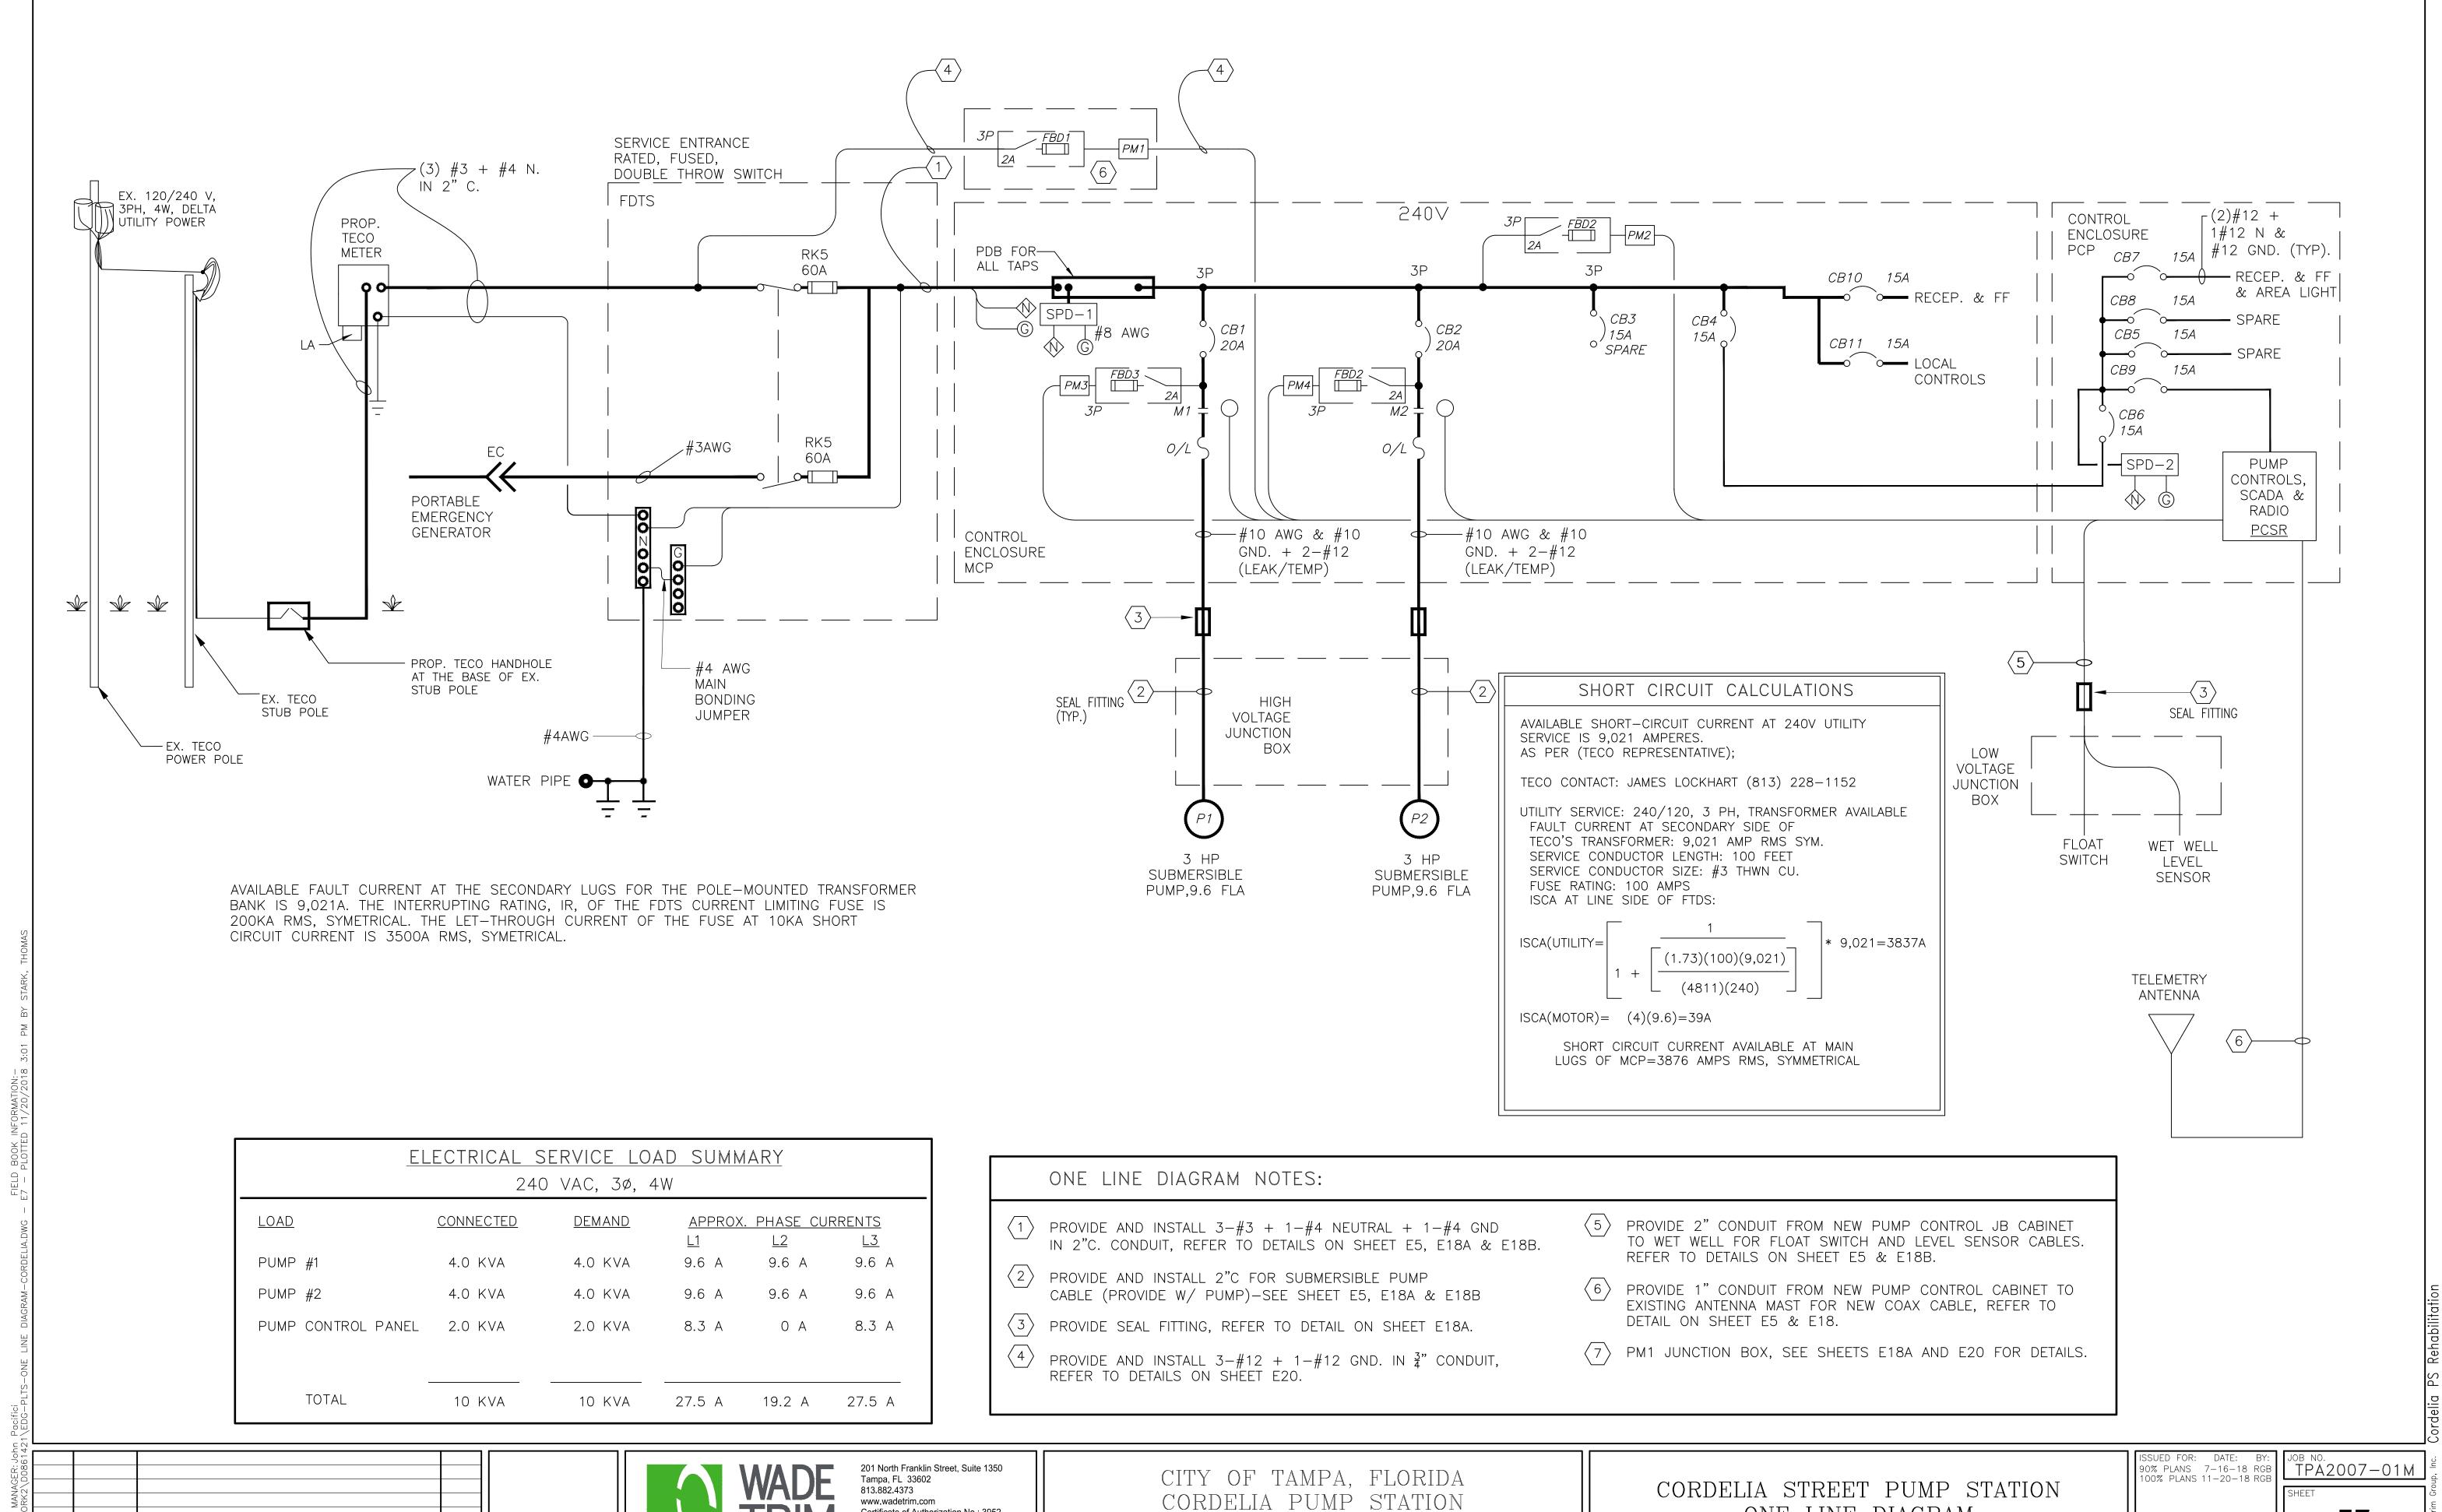

REHABILITATION

www.wadetrim.com

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613


DATE


DESCRIPTION

Certificate of Authorization No.: 3952

E7

ONE LINE DIAGRAM

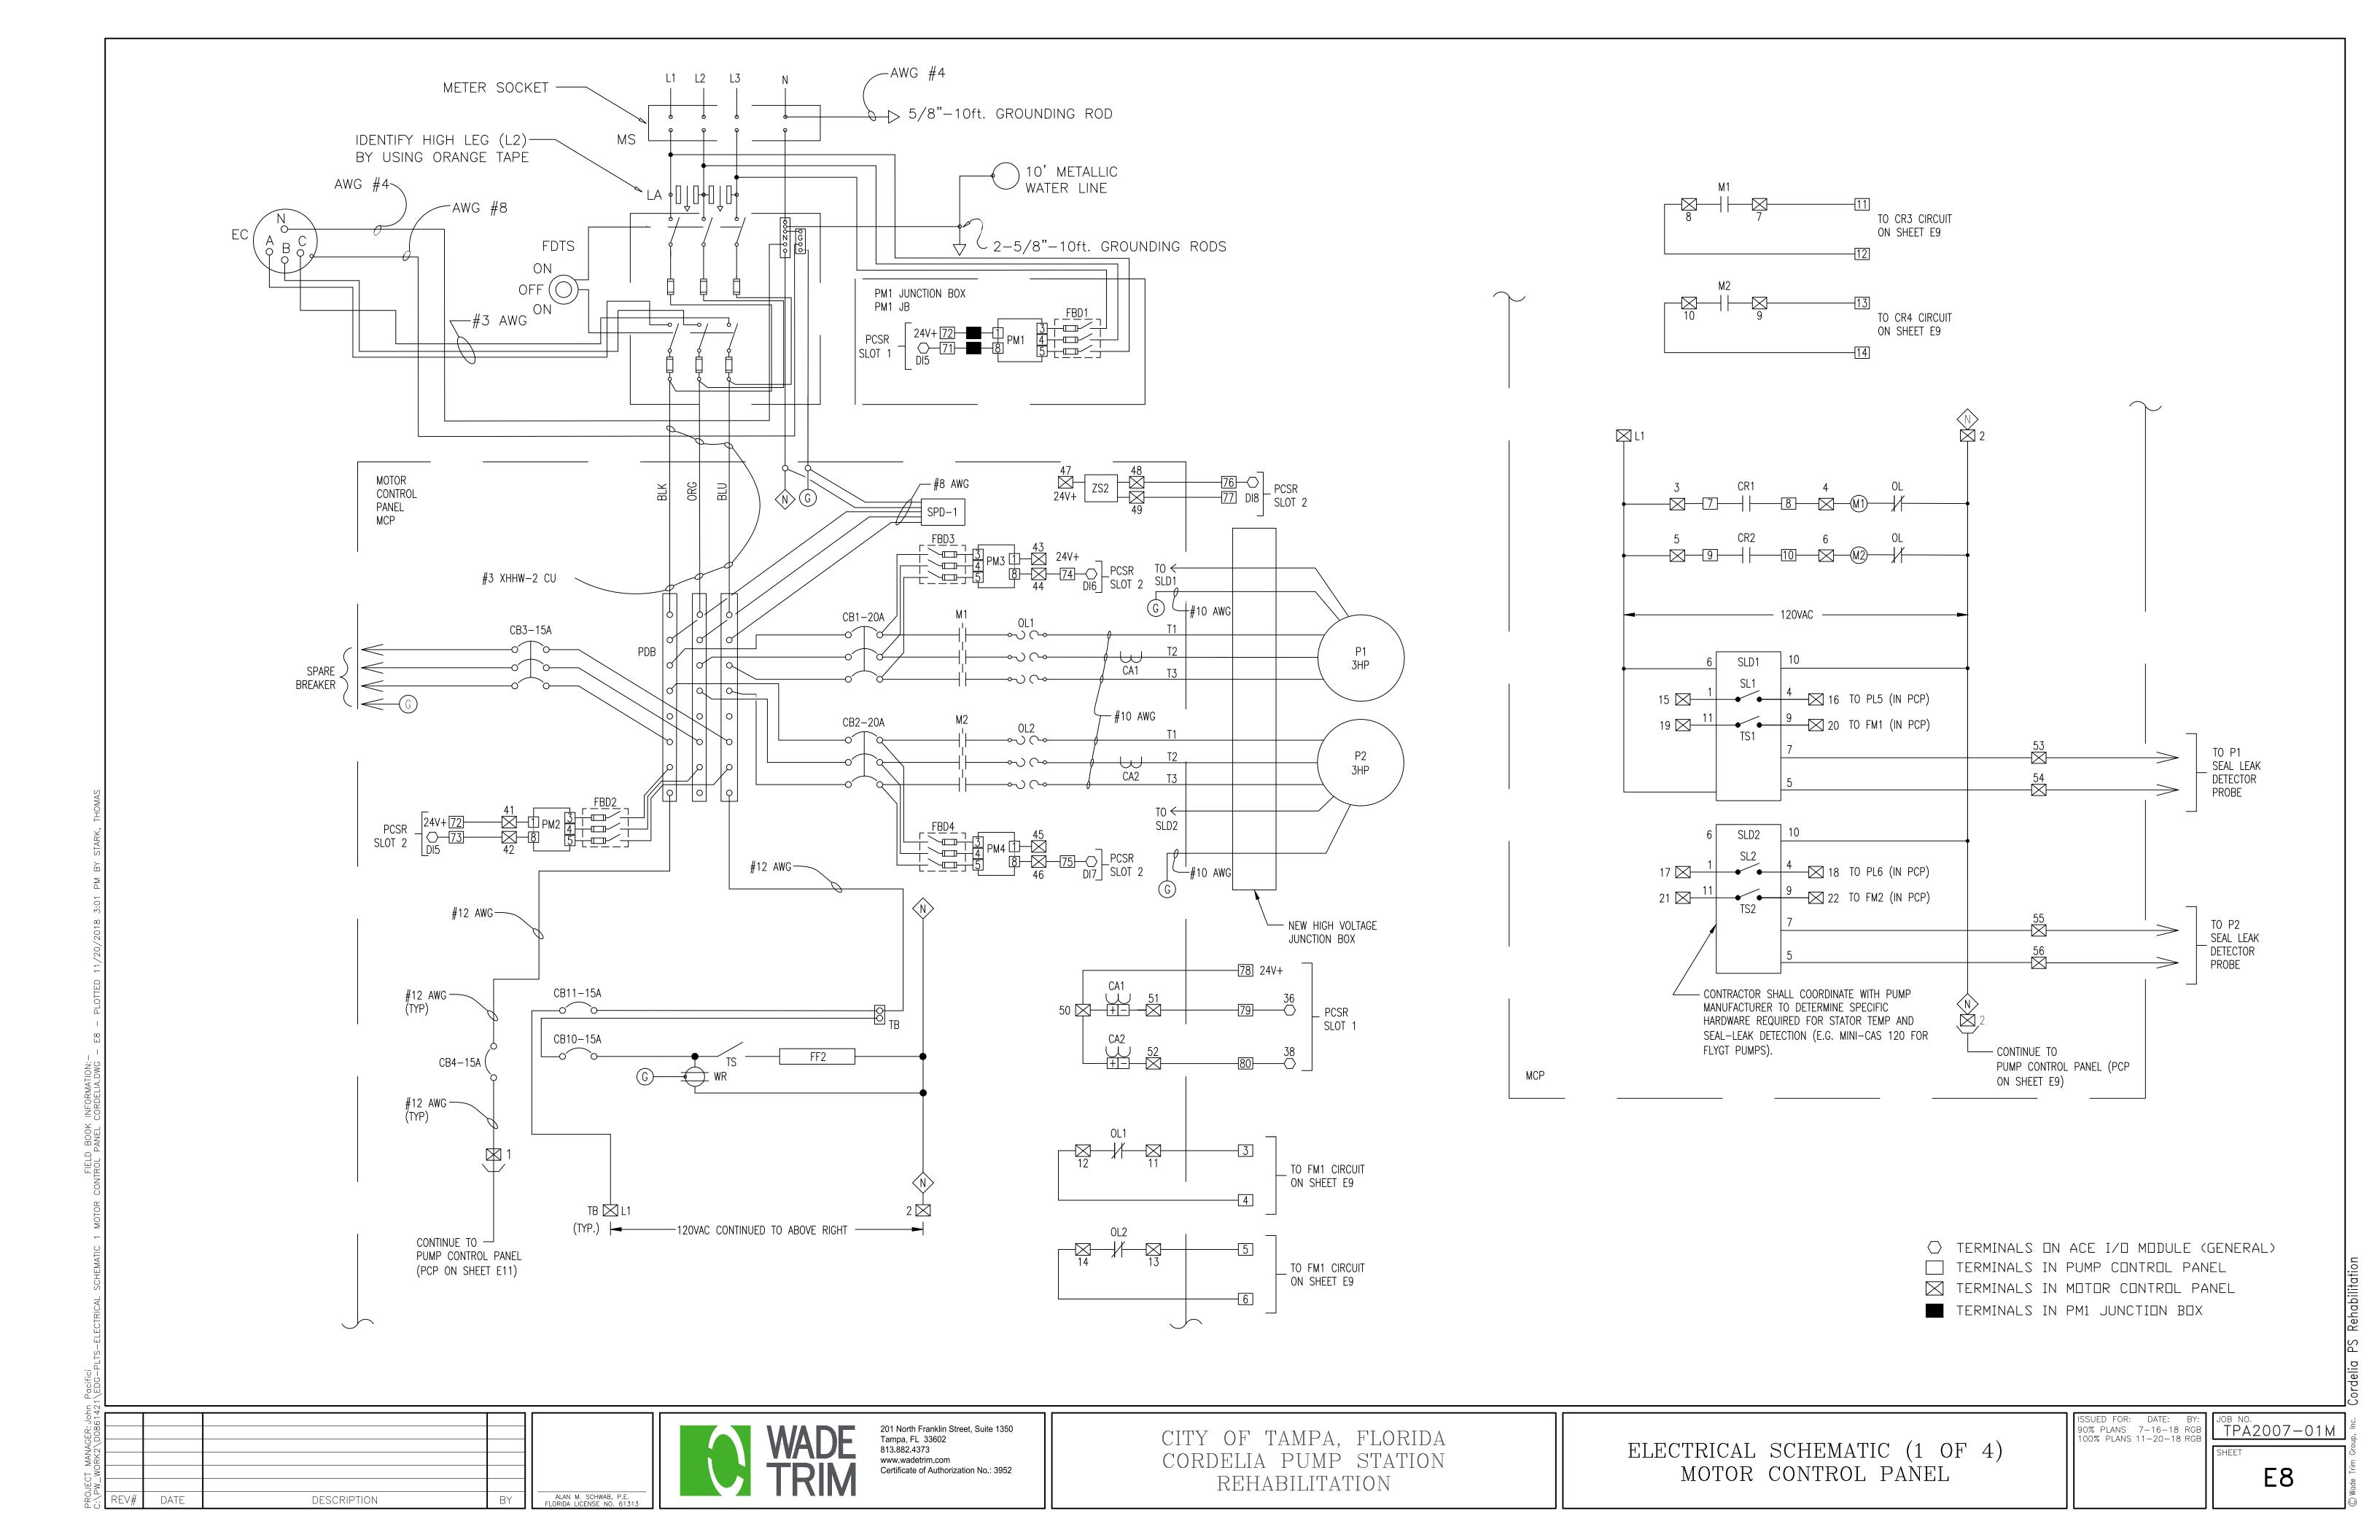

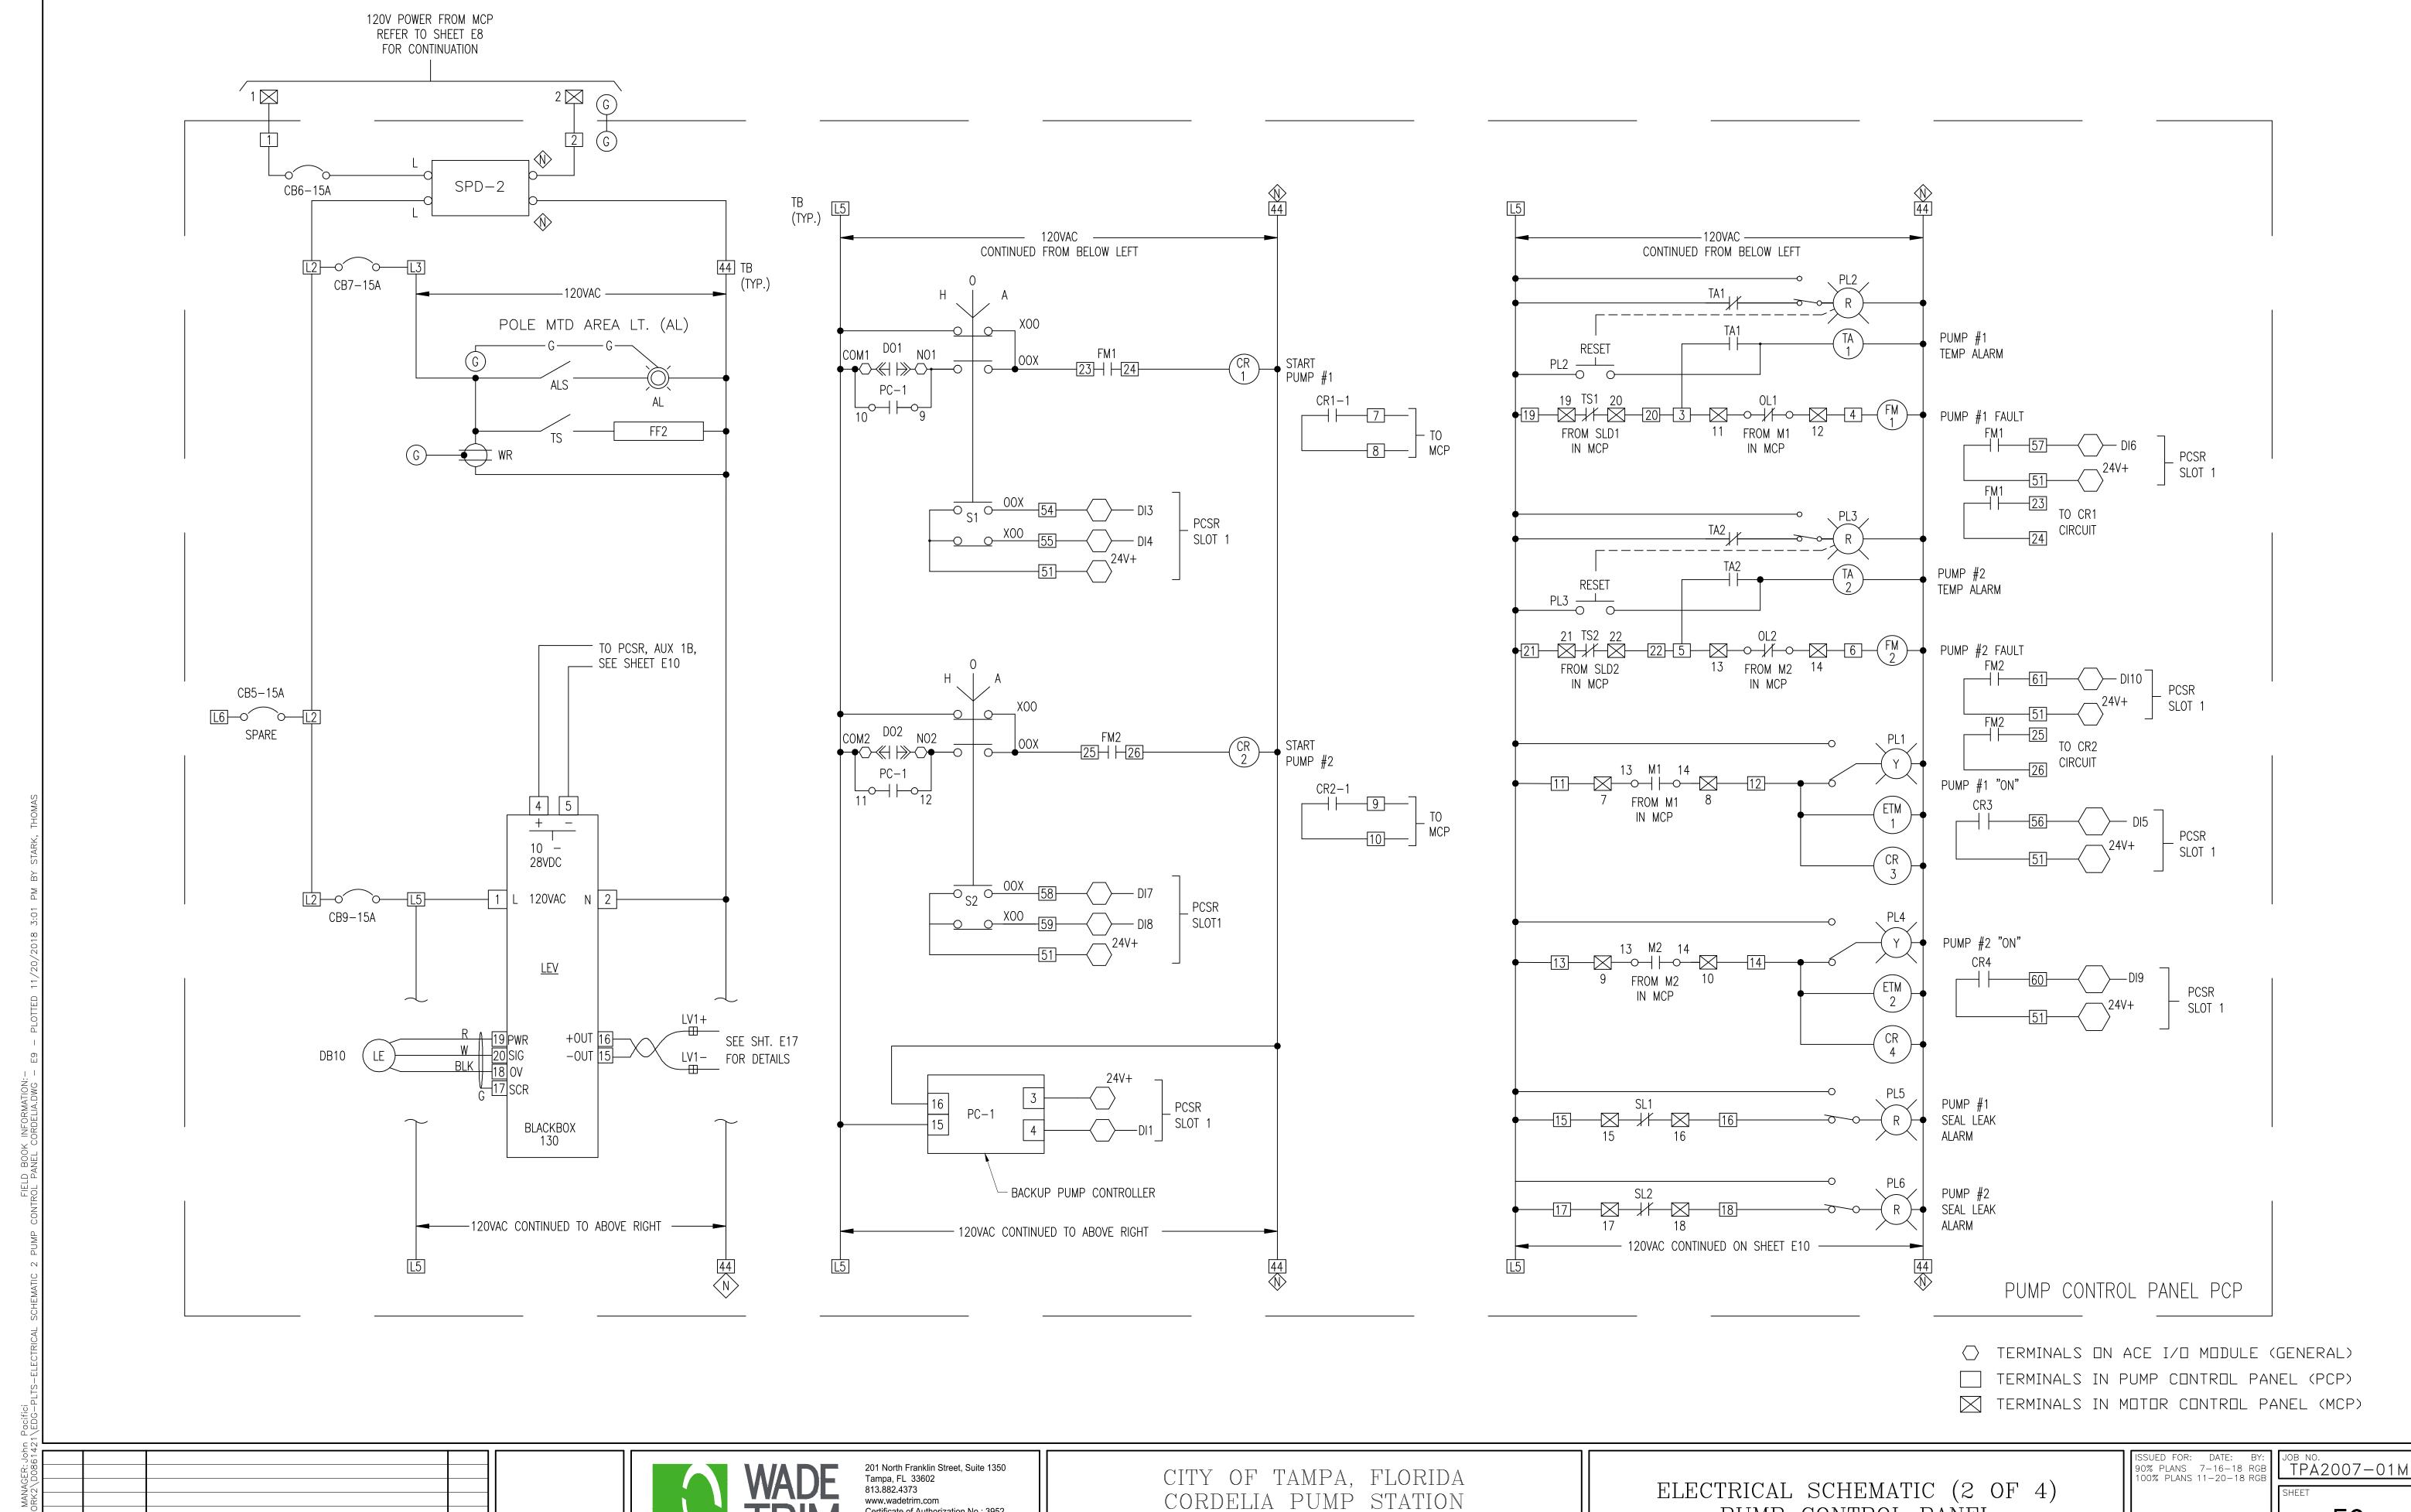


ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613

DESCRIPTION

Certificate of Authorization No.: 3952

CORDELIA PUMP STATION REHABILITATION


PUMP CONTROL PANEL

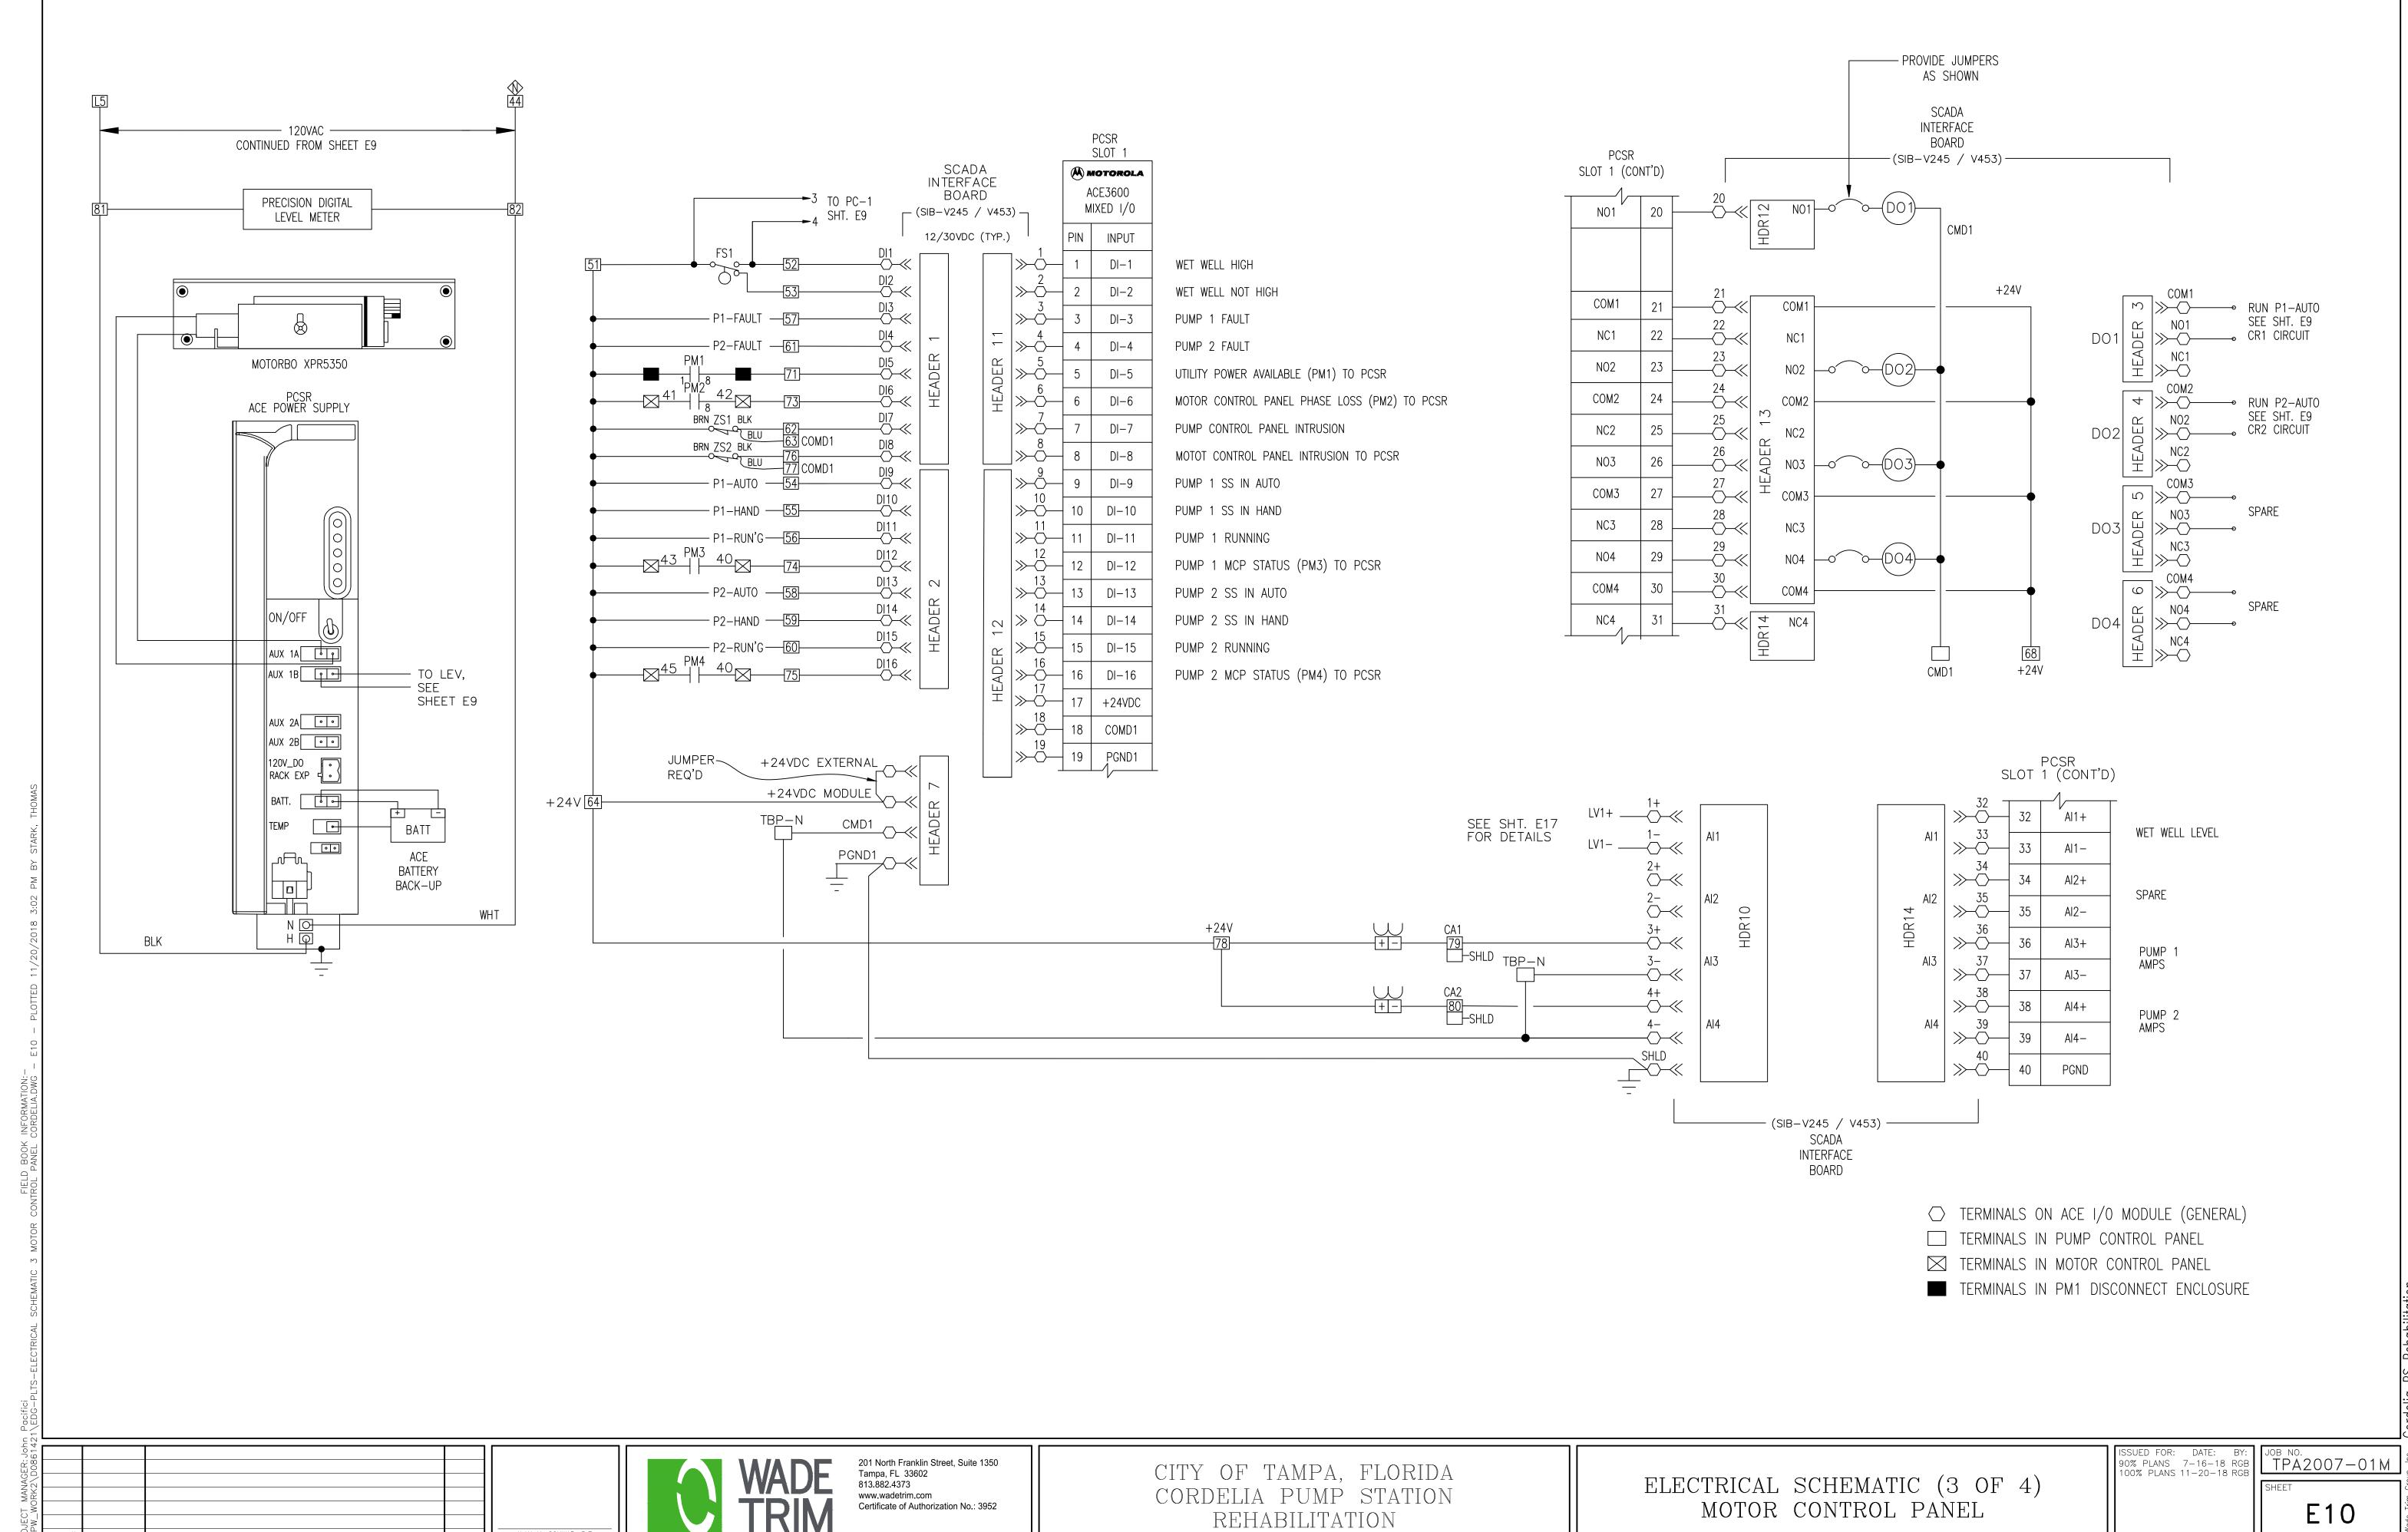

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613

DATE

DESCRIPTION

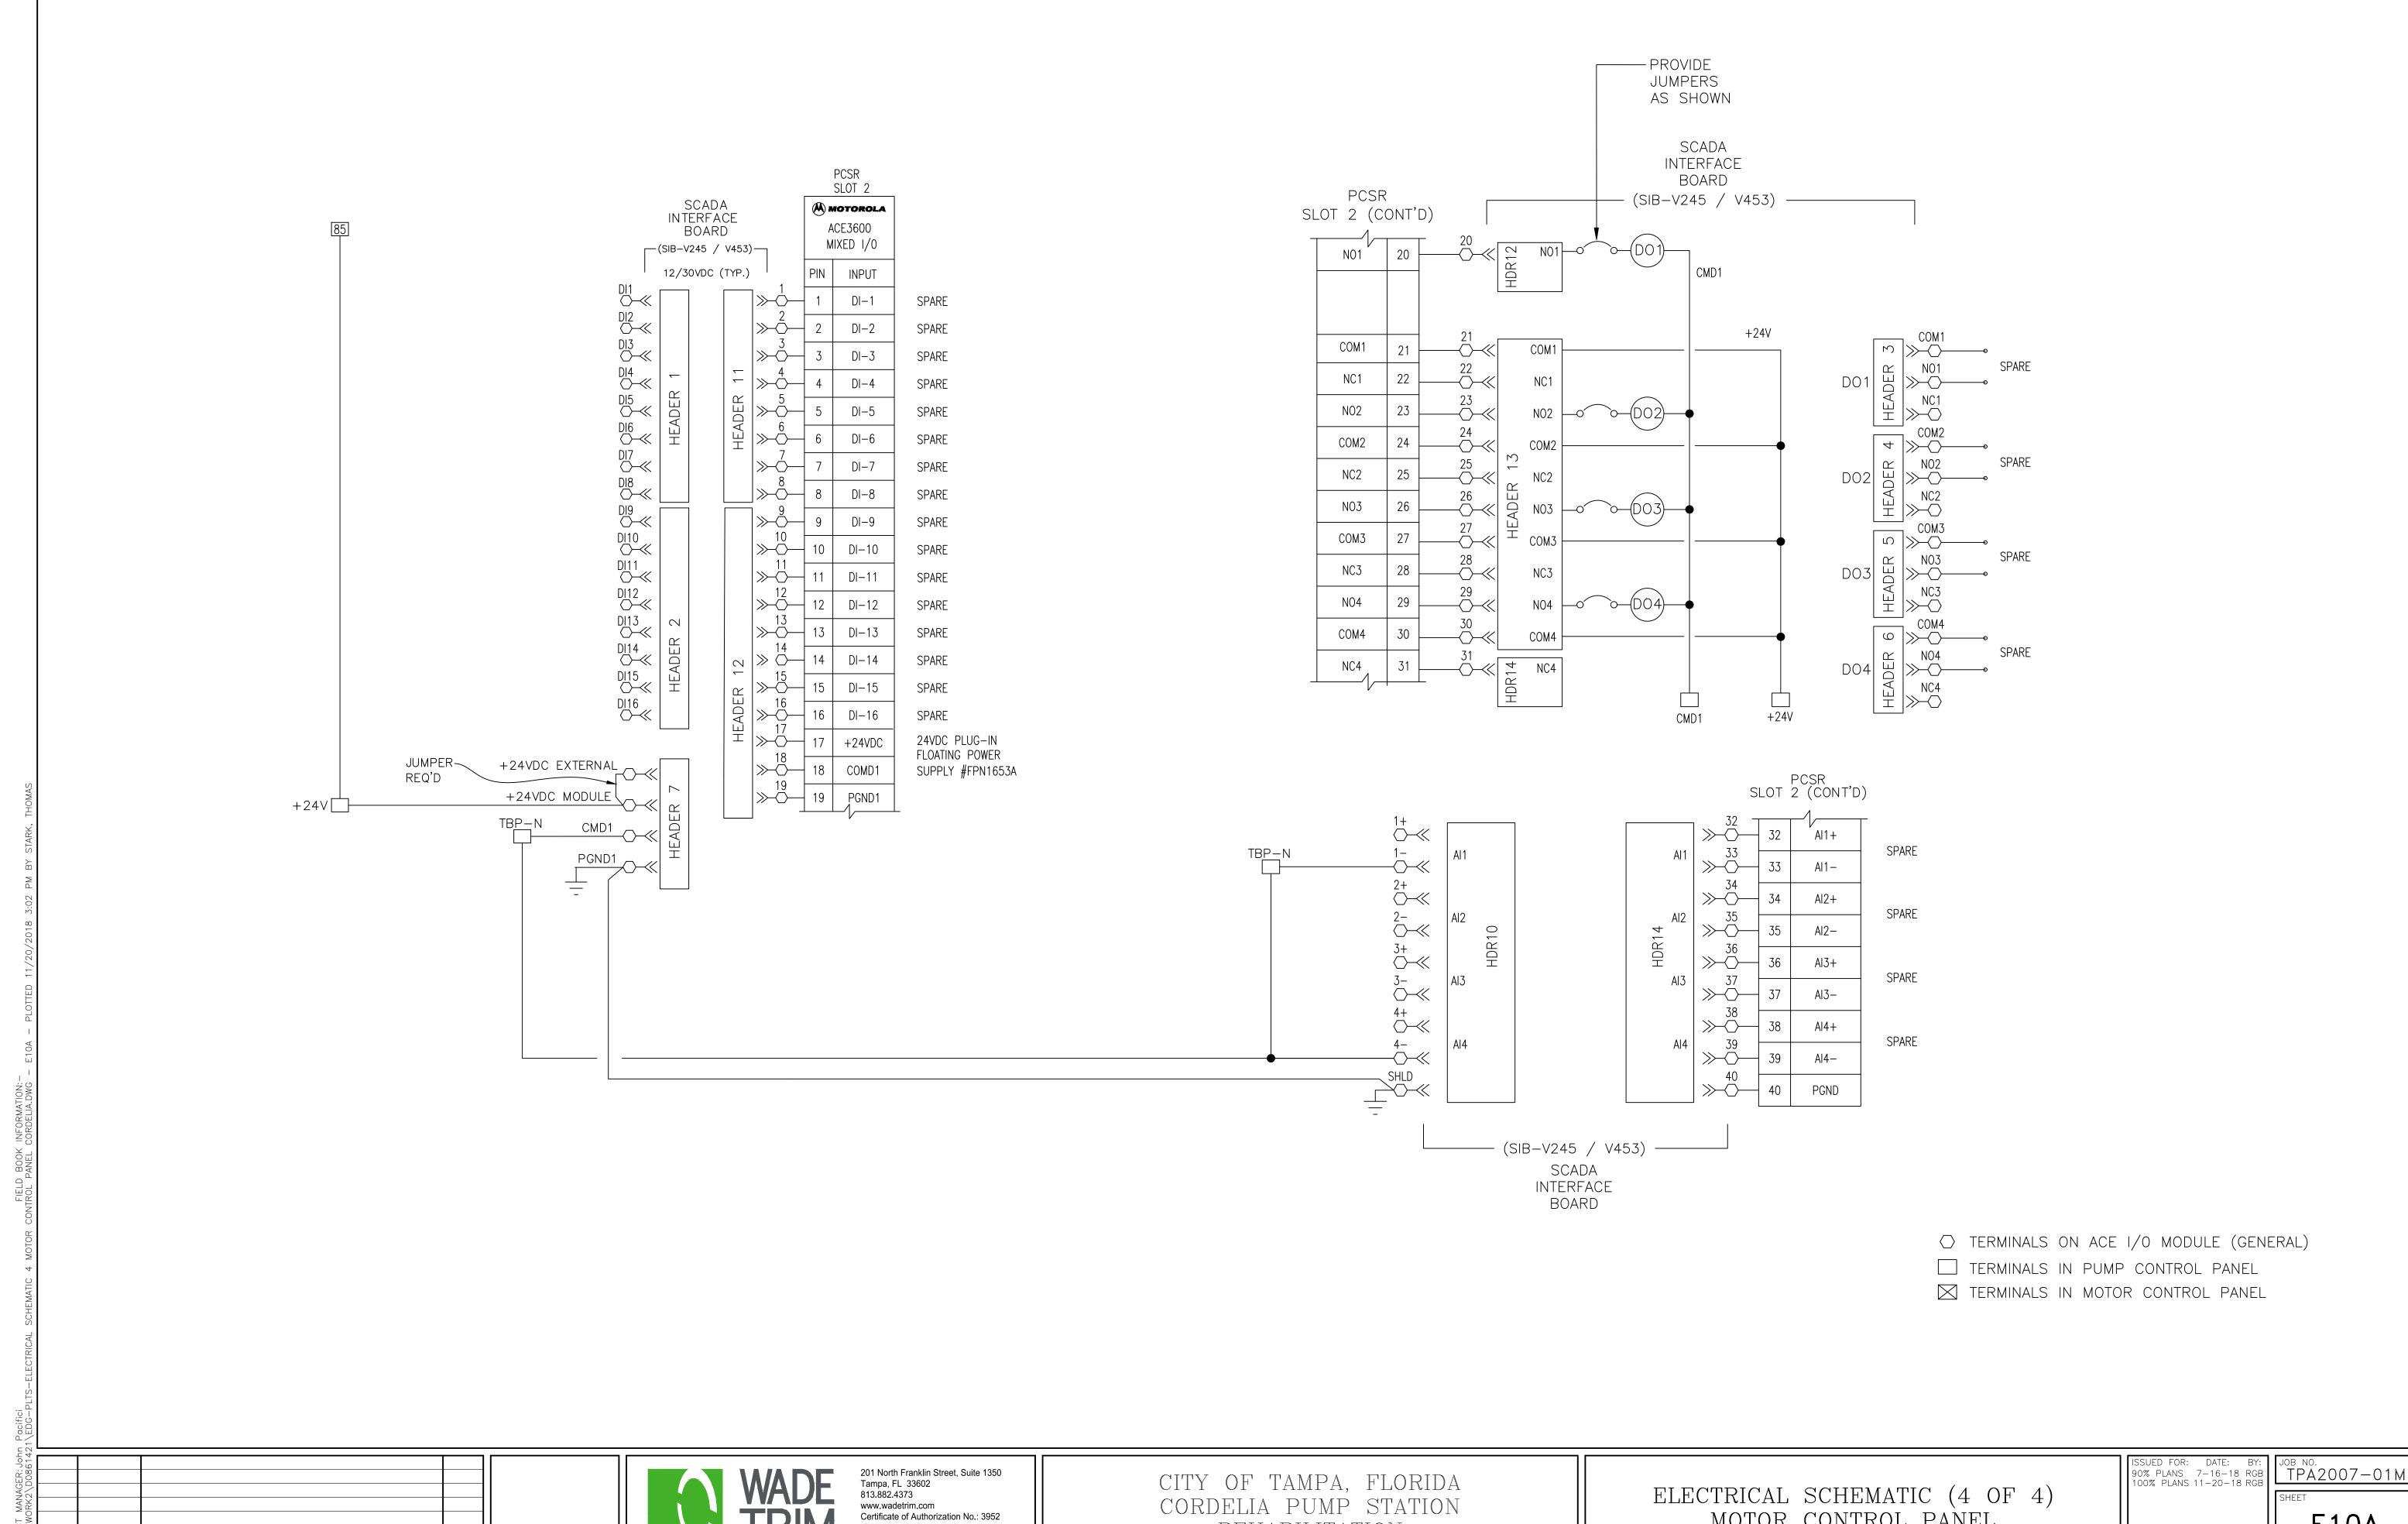

REHABILITATION

DESCRIPTION

ELECTRICAL SCHEMATIC (4 OF 4) MOTOR CONTROL PANEL

E10A

DATE

DESCRIPTION

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613






TERM. DESCRIPTION 120V FROM MOTOR CONTROL PANEL NEUTRAL FROM MOTOR CONTROL PANEL M1 OVERLOAD M1 OVERLOAD M2 OVERLOAD M2 OVERLOAD PUMP 1 START COMMAND TO M1 (IN MCP) PUMP 1 START COMMAND TO M1 (IN MCP) PUMP 2 START COMMAND TO M2 (IN MCP) PUMP 2 START COMMAND TO M2 (IN MCP) P1 "ON" SIGNAL FROM M1 (IN MCP) P1 "ON" SIGNAL FROM M1 (IN MCP) P2 "ON" SIGNAL FROM M2 (IN MCP) P2 "ON" SIGNAL FROM M2 (IN MCP) PUMP 1 LEAK ALARM FROM MCP PUMP 1 LEAK ALARM FROM MCP PUMP 2 LEAK ALARM FROM MCP PUMP 2 LEAK ALARM FROM MCP PUMP 1 TEMPERATURE ALARM FROM MCP PUMP 1 TEMPERATURE ALARM FROM MCP PUMP 2 TEMPERATURE ALARM FROM MCP PUMP 2 TEMPERATURE ALARM FROM MCP PUMP 1 FAULT RELAY CONTACT PUMP 1 FAULT RELAY CONTACT PUMP 2 FAULT RELAY CONTACT PUMP 2 FAULT RELAY CONTACT 27 SPARE 28 SPARE 29 SPARE SPARE 30 31-43 SPARE


TB1 ( ) (120V AC) MOUNTED ON PUMP CONTROL PANEL (PCP)

	V
44	SPD-2 NUETRAL OUT
L1	SPD-2 NUETRAL OUT
L2	MAIN BREAKER CB6
L3	CB7 OUT
L4	SPARE CB8 BREAKER
L5	CB9 OUT
L6	SPARE CB5 BREAKER

TB1 CONTINUED

TB2 ( ) (24V DC) MOUNTED ON PUMP CONTROL PANEL (PCP)		
DESCRIPTION		
SLOT 1 PCSR 24V+		
WET WELL HIGH		
WET WELL NOT HIGH		
PUMP 1 "AUTO" TO PCSR		
PUMP 1 "HAND" TO PCSR		
PUMP 1 "ON" TO PCSR		
PUMP 1 "FAULT" TO PCSR		
PUMP 2 "AUTO" TO PCSR		
PUMP 2 "HAND" TO PCSR		
PUMP 2 "ON" TO PCSR		
PUMP 2 "FAULT" TO PCSR		
DUMP CONTROL PANEL INTRUCION		
PUMP CONTROL PANEL INTRUSION		
SLOT 1 PCSR 24V+		
SPARE		
SLOT 1 PCSR 24V+		
SPARE		
SLOT 1 PCSR 24V+		
SPARE		
SLOT 1 PCSR 24V+		
UTIL POWER AVAILABLE (PM1) TO PCSR		
SLOT 1 PCSR 24V+		
MOTOR CONTROL PANEL PHASE LOSS (PM2)		
PUMP #1 MCP STATUS (PM3) TO PCSR		
PUMP #2 MCP STATUS (PM4) TO PCSR		
MOTOR CONTROL DANIEL INITELISION		
MOTOR CONTROL PANEL INTRUSION		
SLOT 1 PCSR 24V+		
PUMP 1 AMPS		
PUMP 2 AMPS		
PROCESS METER FOR LEVEL 120V-POWER		
PROCESS METER FOR LEVEL 120V-NEUTRAL		

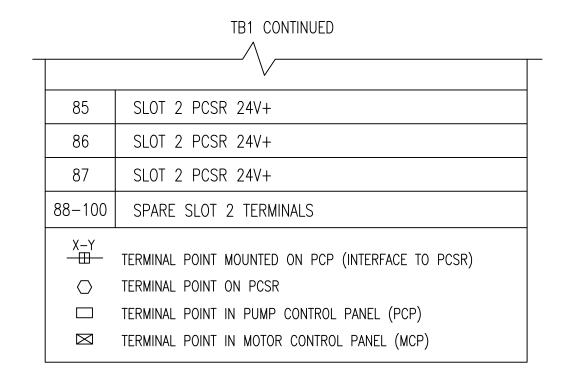

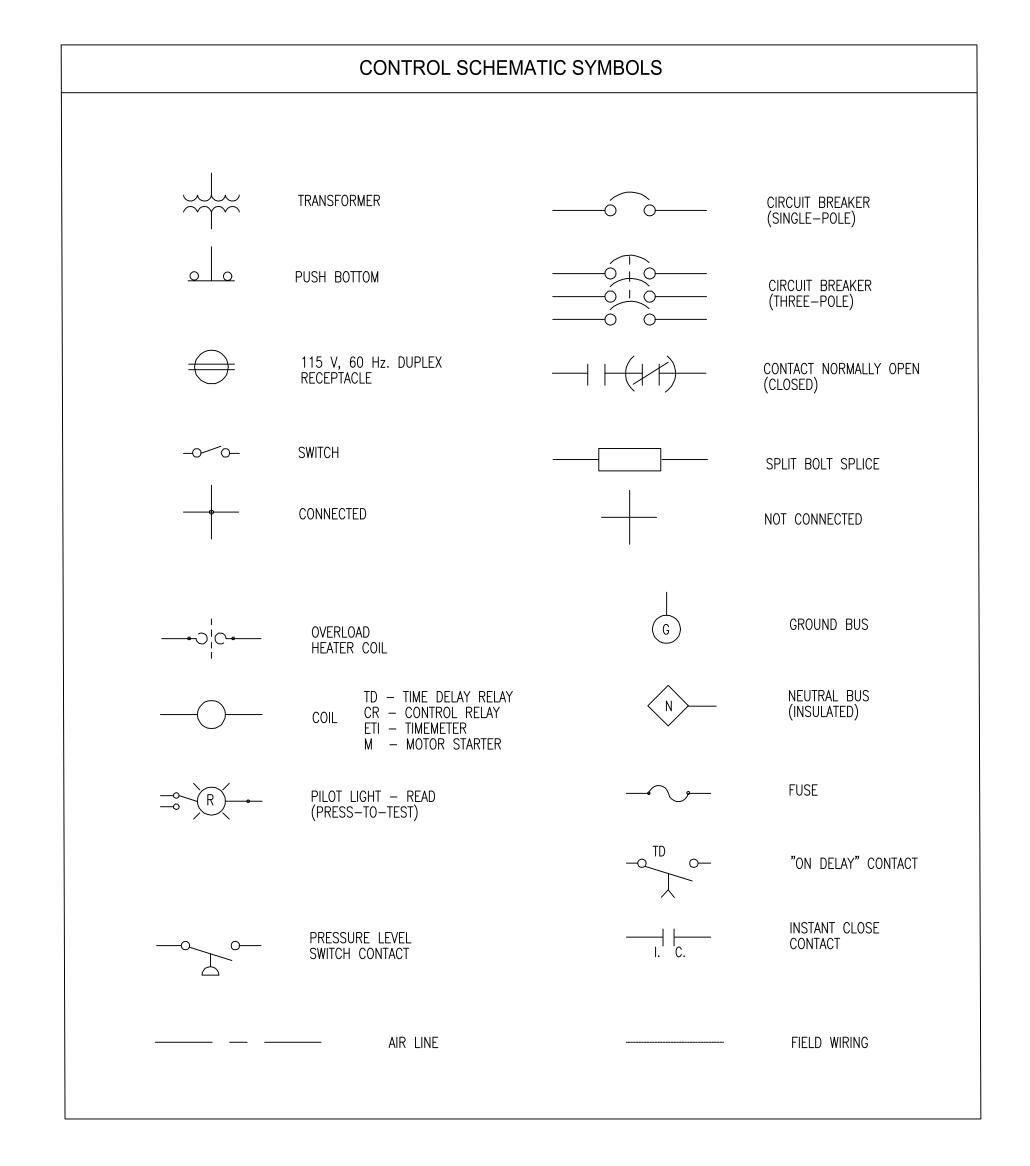

V# DATE DESCRIPTION BY ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 61313



CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION


ELECTRICAL SCHEMATIC LEGEND (SHT. 1 OF 2)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO. TPA2007-01M

TB4 ( ) (24V DC) MOUNT_D ON MOTOR CONTROL PAN_L (MCP			
T_RM. D_SCRIPTION			
39	SPARE		
40	SPARE		
41	SLOT 1 PCSR 24V+		
42	MOTOR CONTROL PAN-L PHAS- LOSS (PM2) TO PCSR		
43	SLOT 1 PCSR 24V+		
44	PUMP #1 MCP STATUS PHAS: LOSS (PM3) TO PCSR		
45	SLOT 1 PCSR 24V+		
46	PUMP #2 MCP STATUS PHAS: LOSS (PM4) TO PCSR		
47	SLOT 1 PCSR 24V+		
4	MOTOR CONTROL PANEL INTRUSION		
49			
50	SLOT 1 PCSR 24V+		
51	PUMP 1 AMPS		
52	PUMP 2 AMPS		
53	PUMP 1 S-AL LEAK DET-CTOR PROBE		
54	PUMP 1 SEAL L-AK D-TECTOR PROBE		
55	PUMP 1 SEAL L-AK DETECTOR PROBE		
56	PUMP 1 SEAL L-AK D-TECTOR PROBE		
57–66	SPAR_		
X−Y —⊞—	T_RMINAL POINT MOUNT_D ON PCP (INT_RC_ TO PCSR)  T_RMINAL POINT ON PCSR		
	T_RMINAL POINT IN PUMP CONTROL PAN_L (PCP)		
$\boxtimes$	T-RMINAL POINT IN MOTOR CONTROL PAN-L (MCP		

/# DATE DESCRIPTION BY







PARTS SCHEDULE IS CONTINUED ON SHEET E15

- 1. ALARM FLOAT SWITCH WILL BE SUPPLIED BY WWD AND INSTALLED BY CONTRACTOR.
- 2. DIMENSIONS, ITEMS, OR ELEVATIONS MARKED "\*" SHALL BE DETERMINED AFTER EQUIPMENT SELECTION.

				ıΓ
REV#	DATE	DESCRIPTION	BY	

201 North Franklin Street, Suite 1350 Tampa, FL 33602 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

PARTS SCHEDULE (SHT. 1 OF 2)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

E14

JOB NO. TPA2007-01M

- 1. ALARM FLOAT SWITCH WILL BE SUPPLIED BY WWD AND INSTALLED BY CONTRACTOR.
- 2. DIMENSIONS, ITEMS, OR ELEVATIONS MARKED "\*" SHALL BE DETERMINED AFTER EQUIPMENT SELECTION.

DESCRIPTION


201 North Franklin Street, Suite 1350 Tampa, FL 33602 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

PARTS SCHEDULE (SHT. 2 OF 2)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO. TPA2007-01M

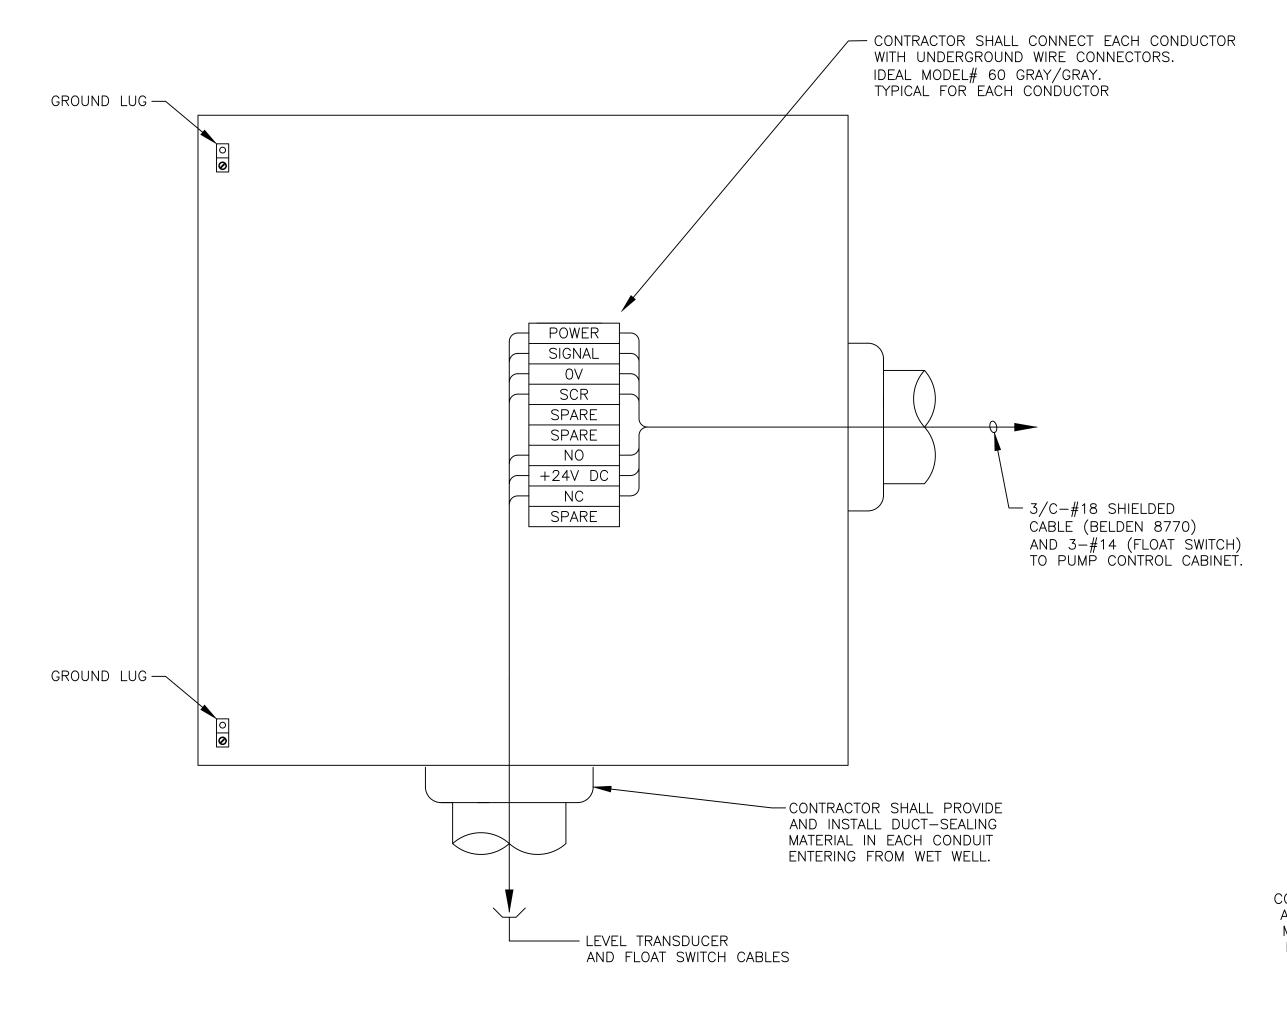

<u></u>3−#10 + #10 GND + 2-#12 (CAS) TO "MOTÒR CONTROL PANEL POB DIRECTLY MOUNT TO BACK PANEL — OOO CONTRACTOR SHALL CONNECT——EACH CONDUCTOR WITH BARRIER POWER DISTRIBUTION BLOCKS. TYPICAL FOR EACH CONDUCTOR. <u></u>3−#10 + #10 GND + GB3— 2-#12 (CAS) TO MOTOR CONTROL PANEL CONTRACTOR SHALL PROVIDE—
AND INSTALL DUCT—SEALING
MATERIAL IN EACH CONDUIT
ENTERING FROM WET WELL. SUBMERSIBLE PUMP
CABLE TO PUMP #2 — SUBMERSIBLE PUMP CABLE TO PUMP #1

### NOTES:

- 1. COVER NOT SHOWN FOR CLARITY
- BOND GROUNDING CONDUCTORS TO ENCLOSURE BACK PANEL.

### INSTRUMENTATION AND CONTROLS JUNCTION BOX DETAIL N.T.S.

ALL HINGED SURFACES SHALL BE GROUNDED WITH A BONDING JUMPER SECURED TO THE ENCLOSURE OR BACKPANEL.

### NOTES:

- 1. COVER NOT SHOWN FOR CLARITY
- BOND GROUNDING CONDUCTORS TO ENCLOSURE BACK PANEL.

PUMP MOTOR CONNECTIONS JUNCTION BOX DETAIL N.T.S.

DATE DESCRIPTION

201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION


GROUND LUG —


ELECTRICAL DETAILS (SHT. 1 OF 5)

| ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB | TPA2007-01M

E16

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 61313

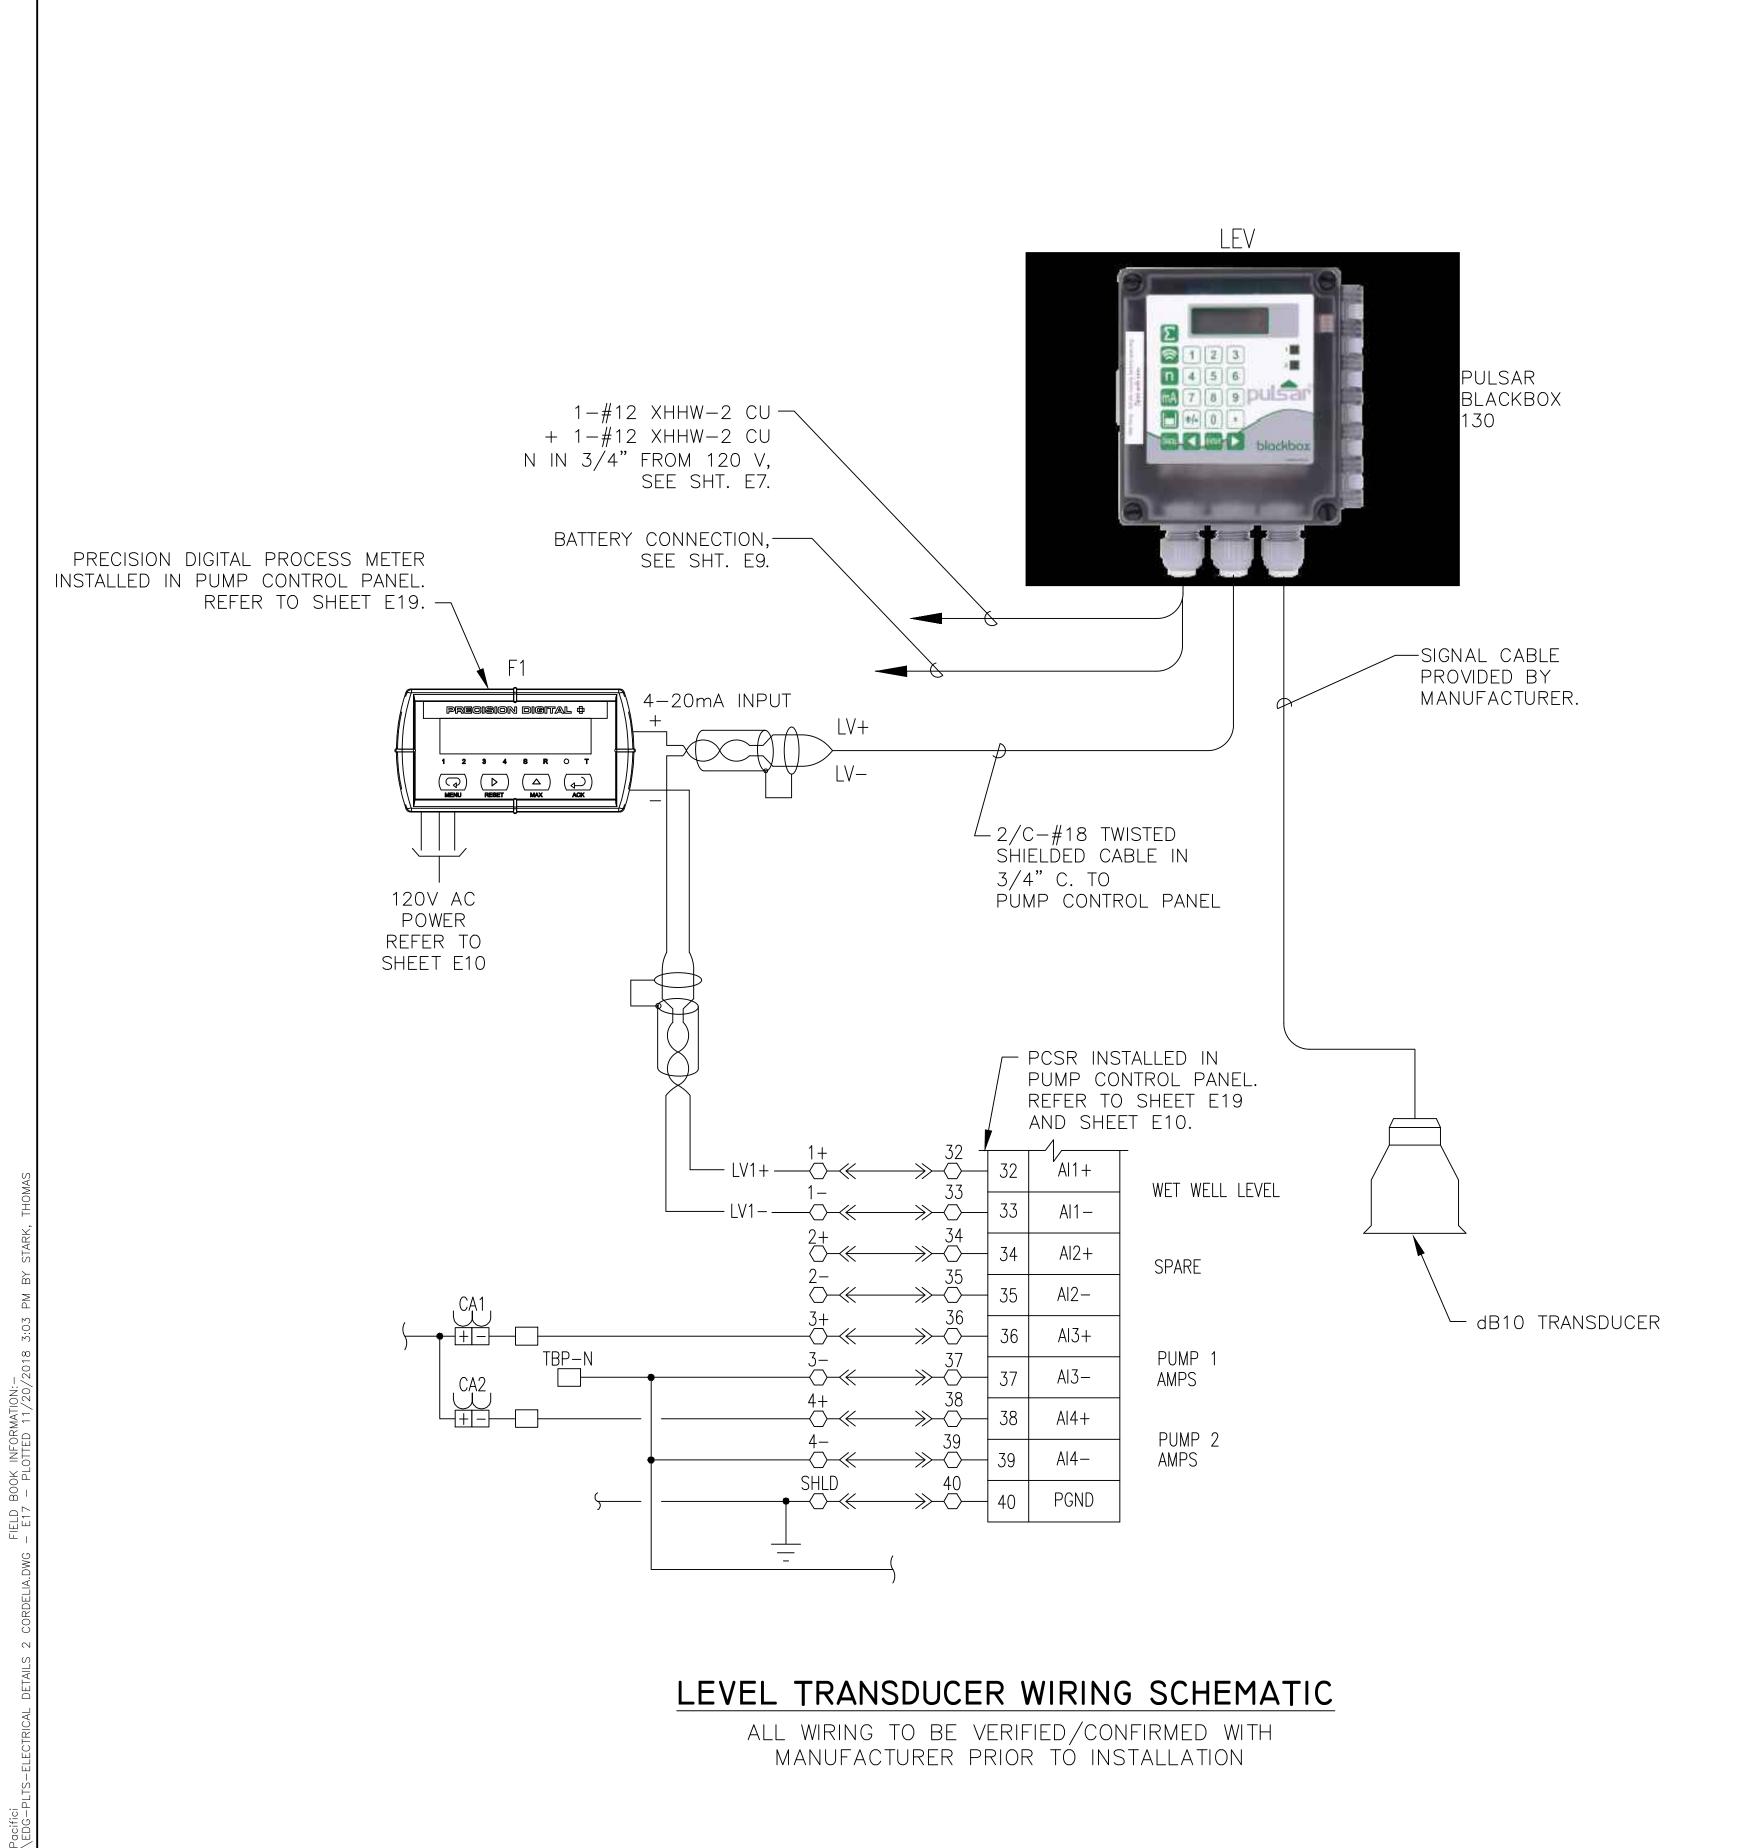

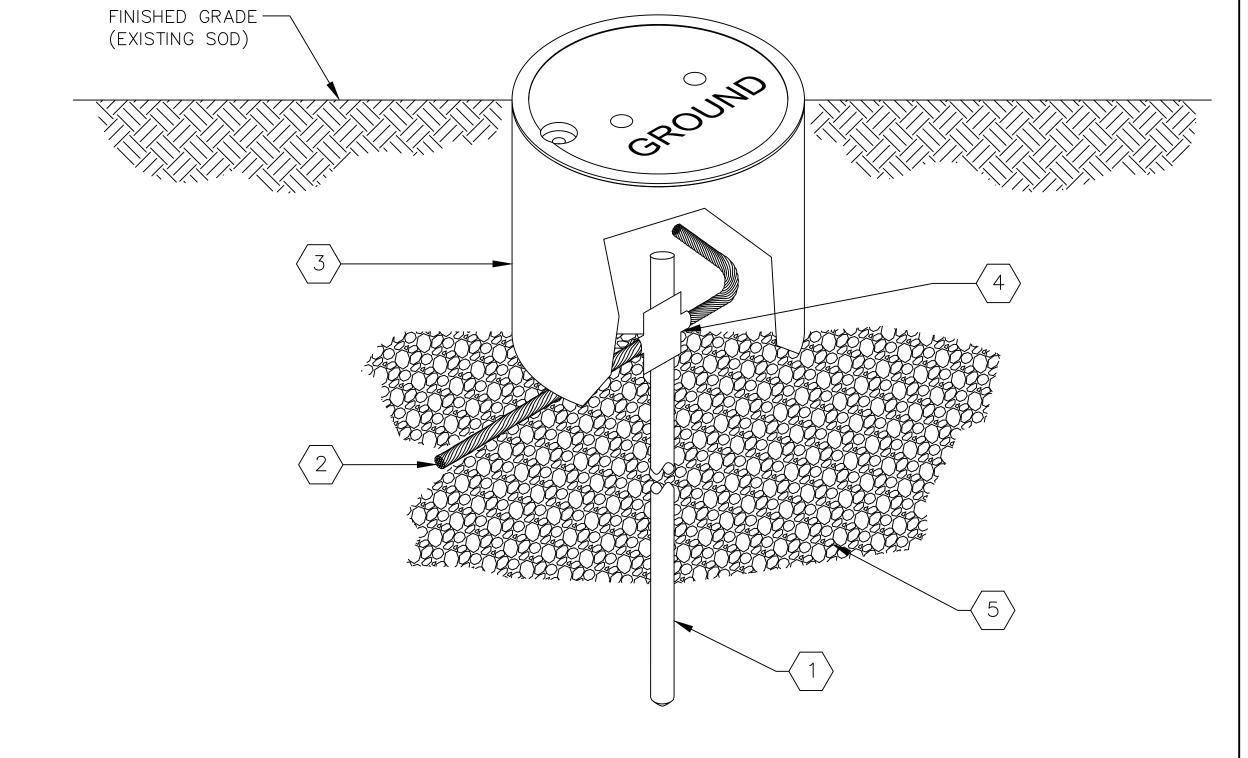


# GROUND TEST WELL DETAIL KEYED NOTES:

- $\langle 1 \rangle$  NEW GROUND ROD, STAINLESS STEEL, 5/8" X 10'-0"
- #4 BARE STRANDED COPPER GROUNDING ELECTRODE CONDUCTOR (TYP).
- PROVIDE AND INSTALL OLDCASTLE PRECAST ENCLOSURE SOLUTIONS #F08 BOX WITH #F08C CAST IRON LID MARKED "GROUND".
- EXOTHERMIC WELD.
- PROVIDE 6" MINIMUM OF CRUSHED STONE.

# GROUNDING TEST WELL DETAIL

SCALE: N.T.S.

_					
42					
9					1
08					
7					
XX.					
≥,					
≥ٰ					
$^{+}$	RFV#	DATE	DESCRIPTION	RY	1






201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 Certificate of Authorization No.: 3952


CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

ELECTRICAL DETAILS (SHT. 2 OF 5)


ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO. TPA2007-01M E17

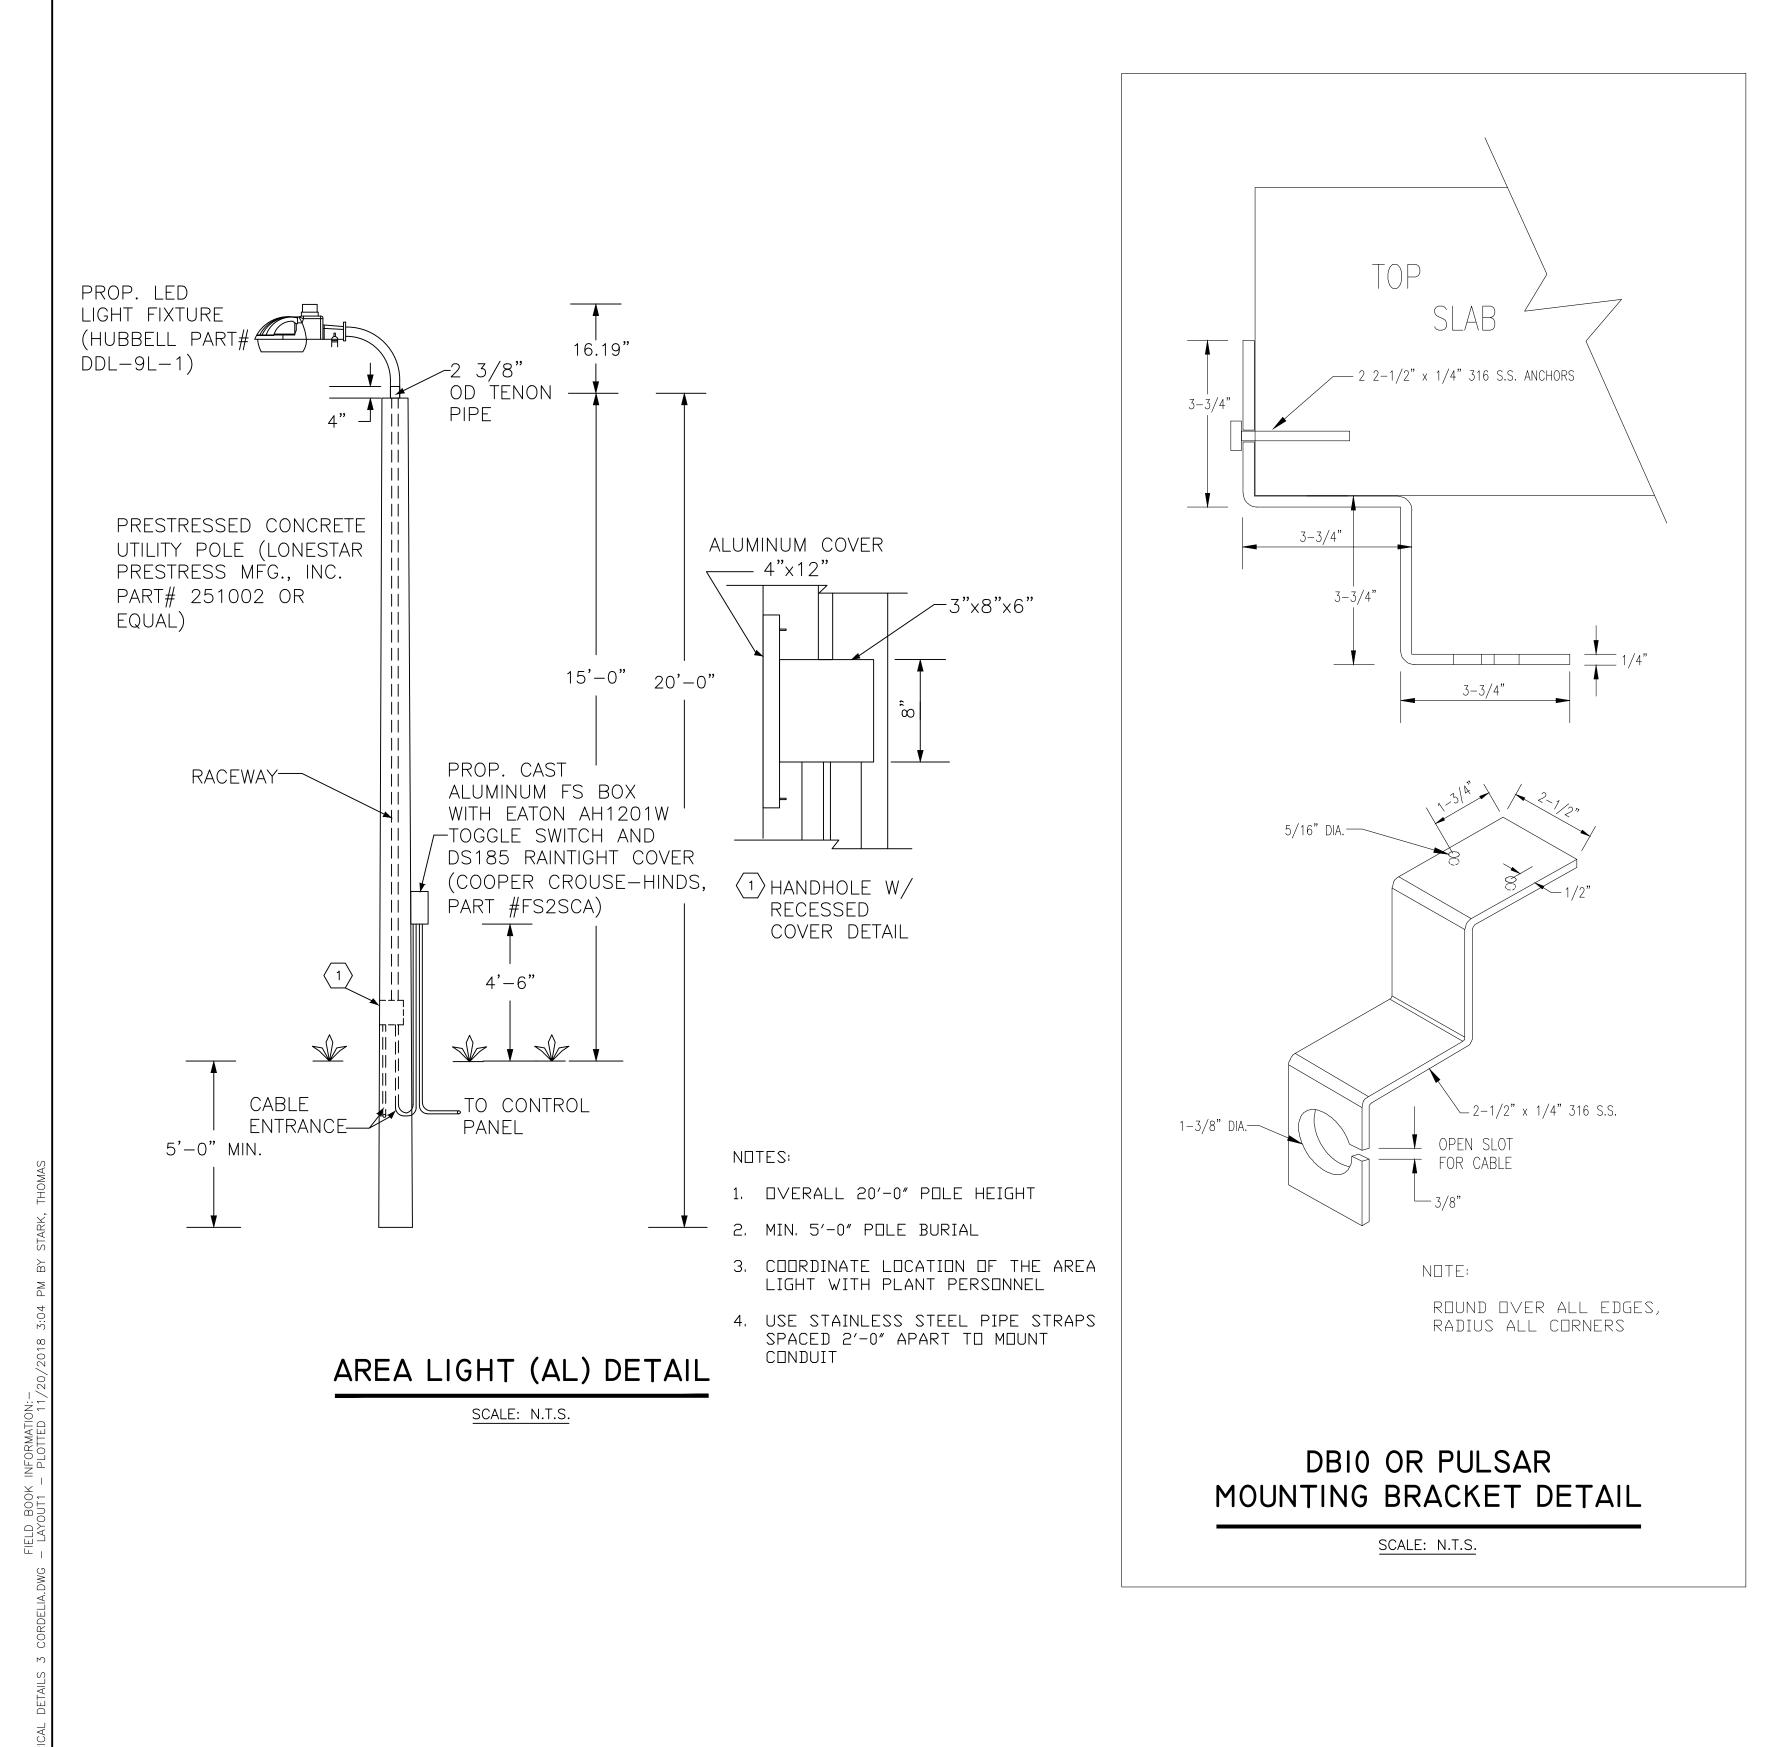

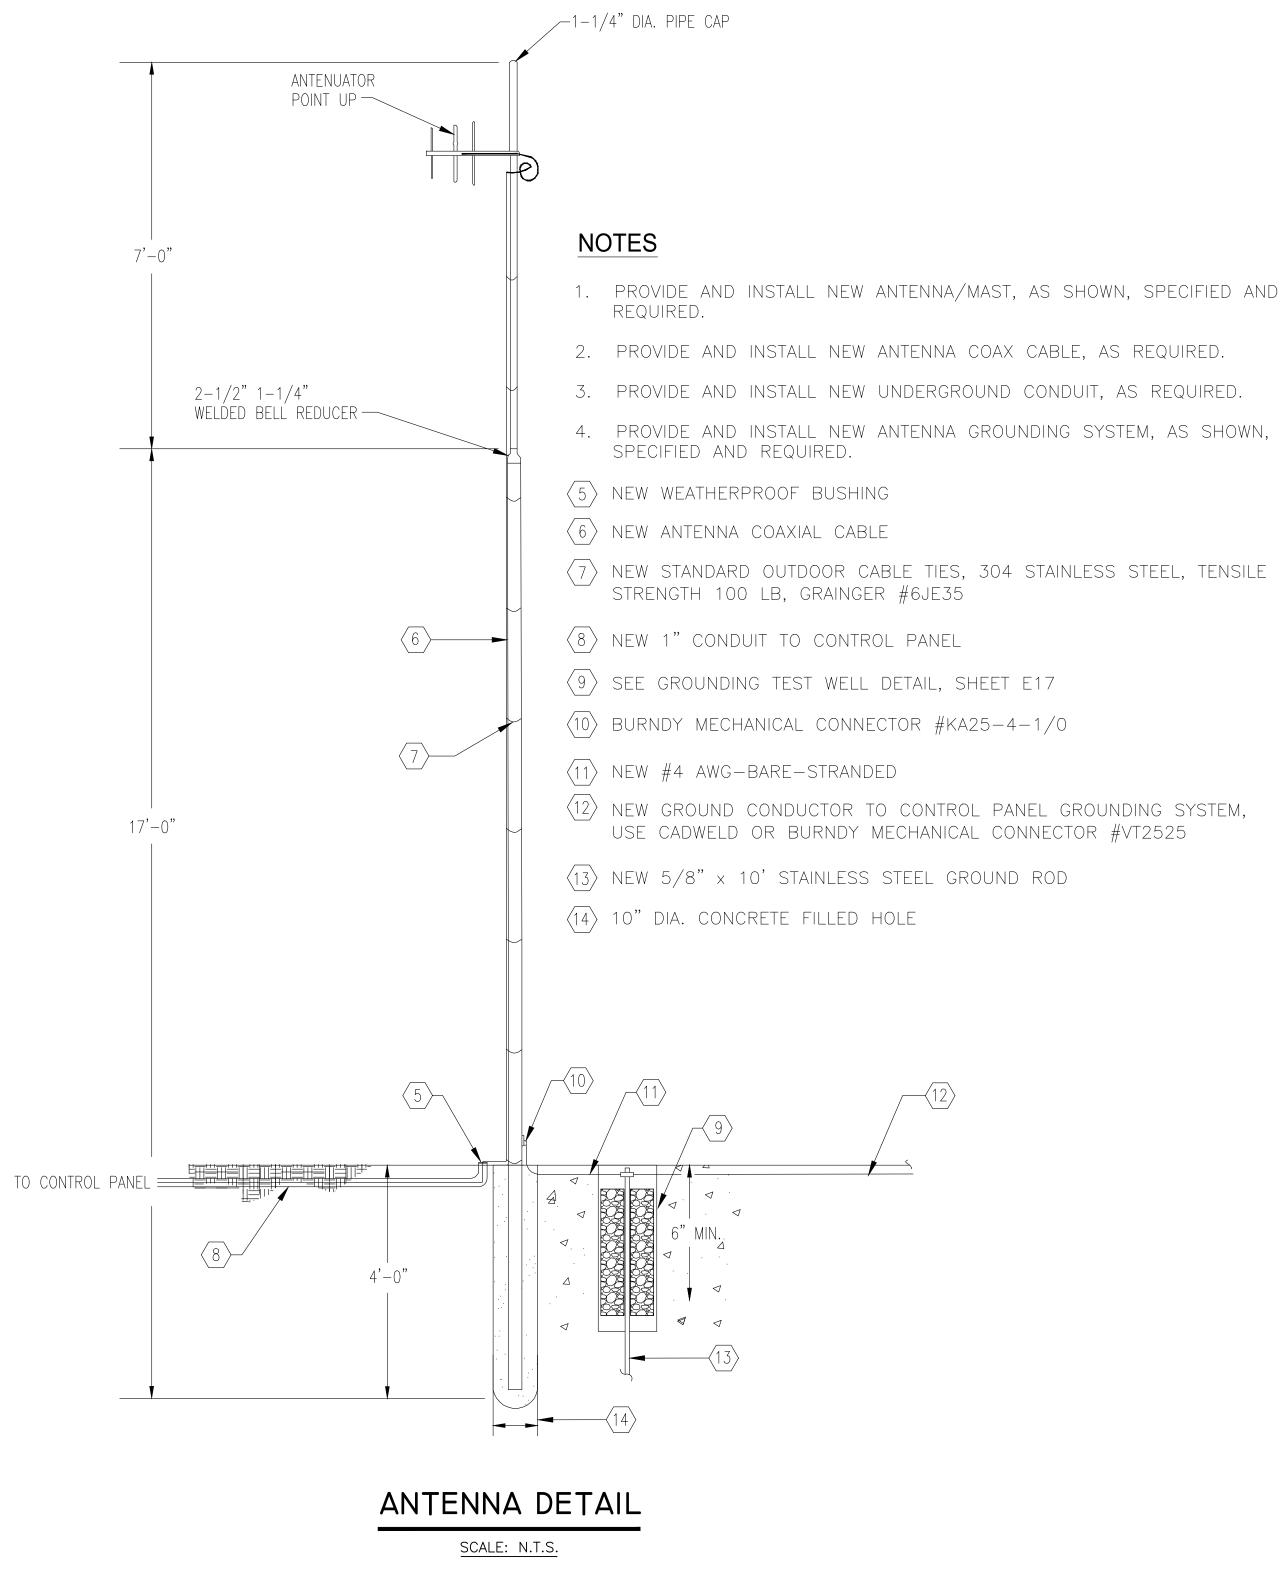

DESCRIPTION

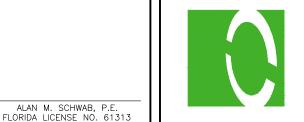





CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

ELECTRICAL DETAILS (SHT. 3 OF 5)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB JOB NO. TPA2007-01M

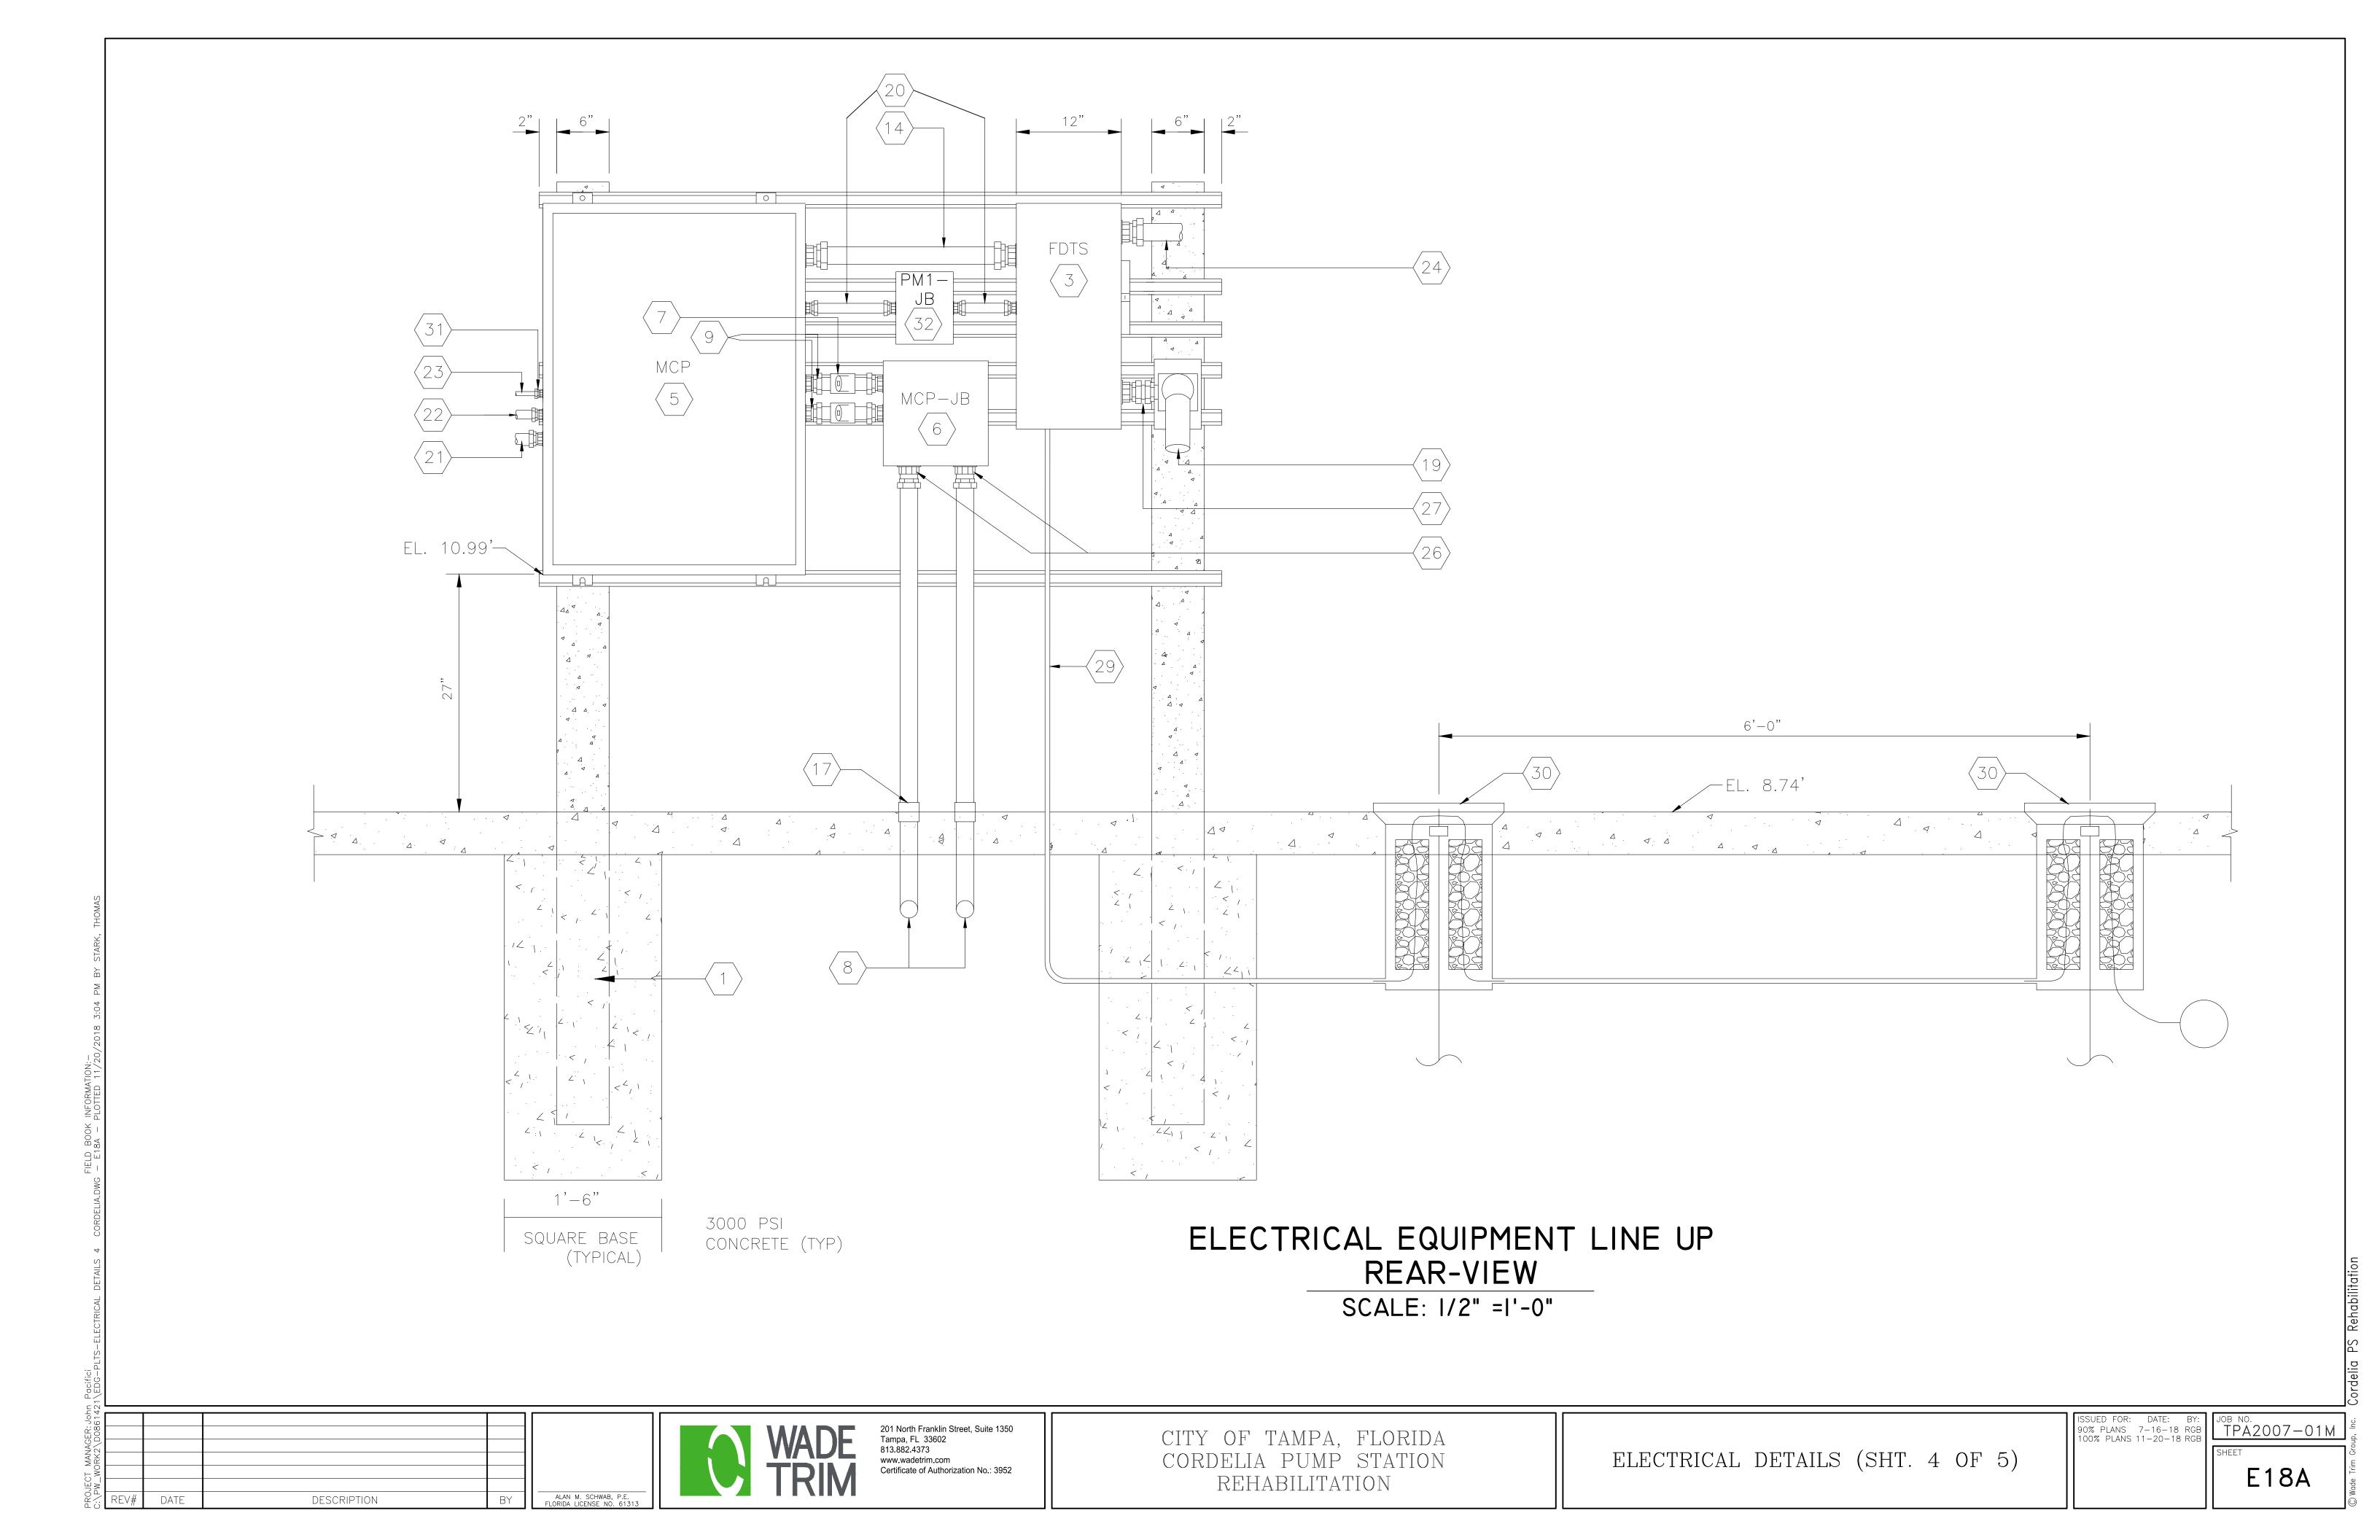

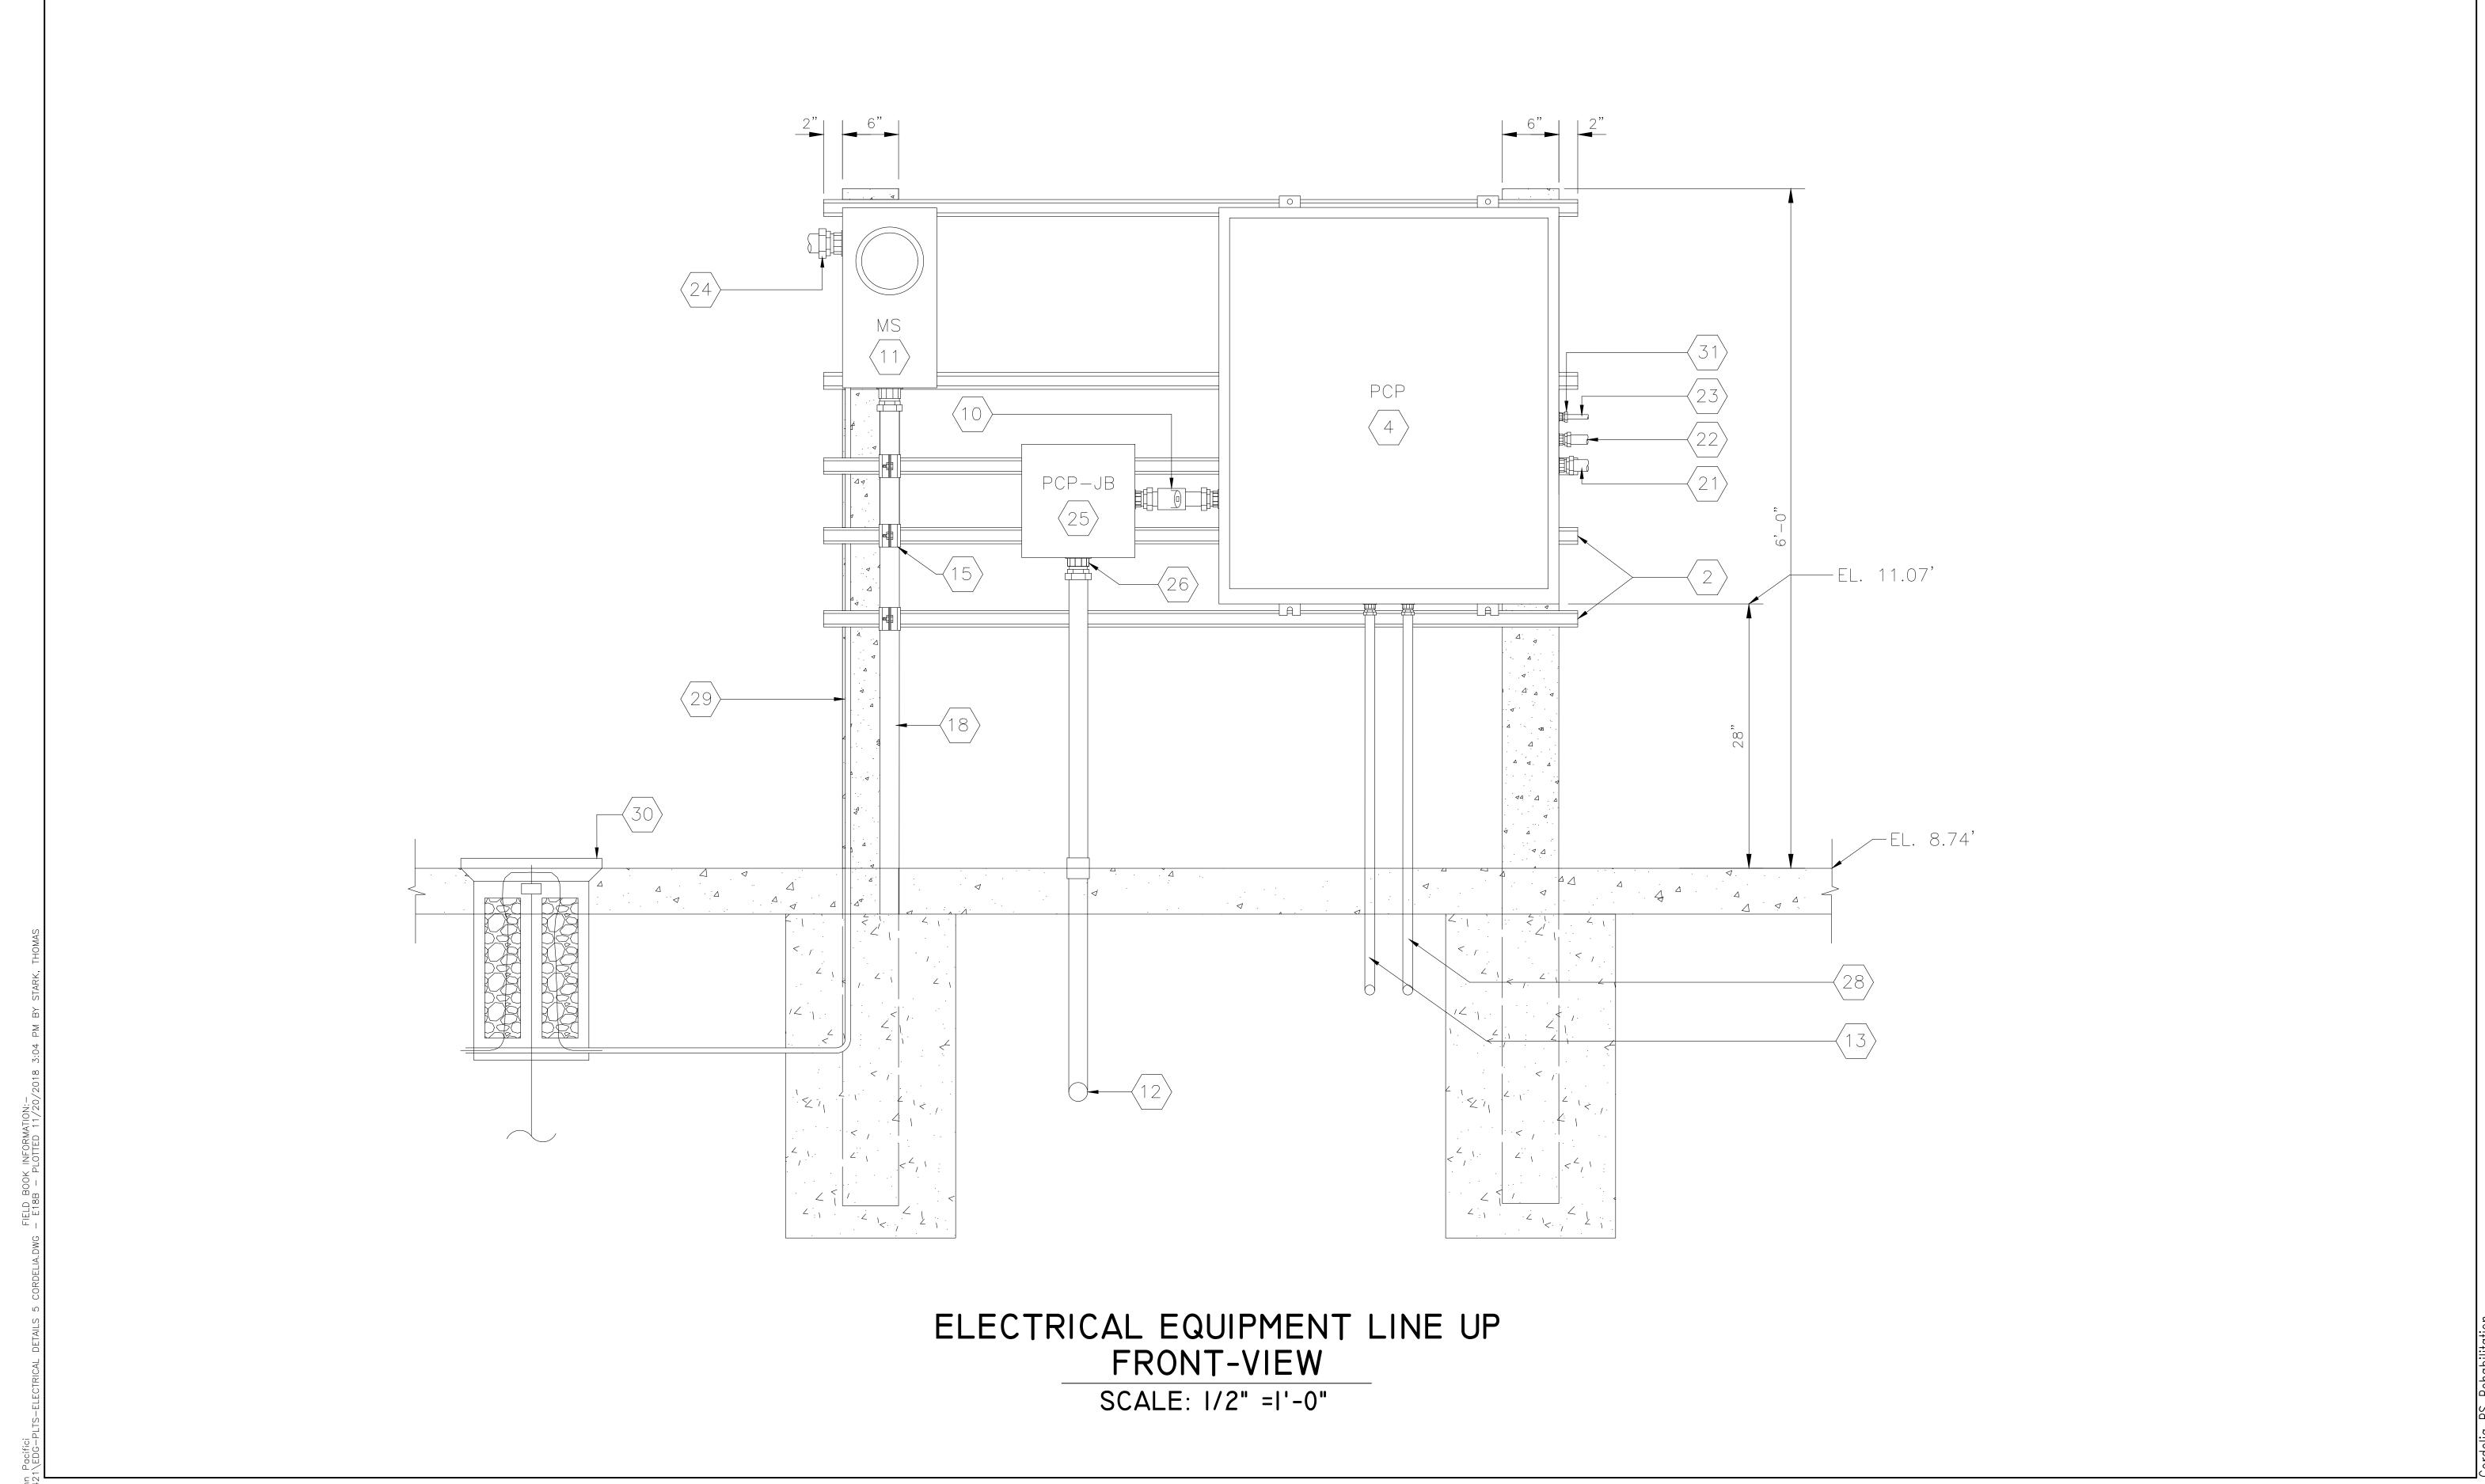

201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

DESCRIPTION

CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

ELECTRICAL DETAILS (SHT. 5 OF 5)

FOR: DATE: BY: ANS 7-16-18 RGB PLANS 11-20-18 RGB SHEET FINANCE SHEET FOR THE PROPERTY OF THE

# KEYED NOTES:

- $\langle$  1  $\rangle$  provide and install three (3) 6" x 6" x 10' reinforced square concrete posts.
- PROVIDE AND INSTALL 1-5/8" x 1-5/8" 316 STAINLESS STEEL UNISTRUT WITH 316 STAINLESS STEEL HARDWARE NOTE, INSTALL ALL BOLTO FOR INSTALL BOLTO FO HARDWARE. NOTE: INSTALL ALL BOLTS FOR UNISTRUT COMPLETELY THROUGH CONCRETE POSTS.
- PROVIDE AND INSTALL SERVICE ENTRANCE RATED HEAVY DUTY, DOUBLE THROW, FUSIBLE SWITCH, 3-POLE, 240 VAC, 60 AMP IN NEMA 4X TYPE ENCLOSURE, 240 VOLT, DUAL-ELEMENT, TIME-DELAY CLASS RK5 FUSES; SWITCH——EATON DT322FWK, DT100NK NEUTRAL KIT, DS100GK GROUND LUG KIT, DS36FK- "R" FUSE ADAPTER KIT.
- PROVIDE AND INSTALL PUMP CONTROL CABINET. REFER TO DETAIL ON SHEET E19.
- (5) PROVIDE AND INSTALL MOTOR CONTROL CABINET. REFER TO DETAIL ON SHEET E20.
- (6) PUMP MOTOR CONNECTIONS J.B.-USED AS A DEMARCATION BOX TO PROVIDE ISOLATION BETWEEN THE WET WELL AND PUMP CONTROLS. PROVIDE AND INSTALL A 12"x12"x6" NEMA 4X, STAINLESS STEEL JUNCTION BOX WITH HINGED DOOR, WIEGMANN #BN4121206CHSS. INSTALL A STAINLESS STEEL LOUVER PLATE KIT (4.75"x 4.5") ON SIDE OF BOX TO PROVIDE NATURAL ASPIRATION, WIEGMANN #WAVK0304SSA. TERMINATIONS SHALL BE MADE USING BARRIER POWER DISTRIBUTION BLOCKS (TYPICAL FOR EACH CONDUCTOR) SEE SHEET E16 FOR JB DETAILS.
- PROVIDE AND INSTALL CROUSE-HINDS EYS TYPE SEALS W/CHICO COMPOUNDS.
- PROPOSED 2" PVC COATED ALUMINUM CONDUITS FOR MOTOR CONDUCTORS. INSTALL CONDUIT AS DESCRIBED IN NOTE 1 OF SHEET E5.
- PROVIDE AND INSTALL (3)-#10 XHHW-2 CU + (1)-#10 XHHW-2 CU GND + (2)-#12 XHHW-2 CU (LEAK/TEMP) IN 1" CONDUIT FOR SUBMERSIBLE PUMP POWER.
- $\langle 10 \rangle$  PROVIDE AND INSTALL (3)-#14 XHHW-2 CU + (1)-#14 XHHW-2 CU GND + (1)-3/C-#18 TWISTED SHIELDED CABLE IN 1" CONDUIT FOR FLOAT AND WET WELL LEVEL TRANSMITTER.
- PROVIDE AND INSTALL METER SOCKET IN ALUMINUM ENCLOSURE.
- PROPOSED 2" PVC COATED ALUMINUM CONDUIT FOR I&C CONDUCTORS. INSTALL CONDUIT AS DESCRIBED IN NOTE 2 OF SHEET E5.
- PROVIDE AND INSTALL 1" CONDUIT FOR ANTENNA COAXIAL CABLE REFER TO SHEET E5 and E18 FOR CONTINUATION.
- $\langle 14 \rangle$  PROVIDE AND INSTALL (3)-#3 THWN CU, (1)-#4 THWN NEU, AND (1)-#6 THWN CU GND. IN 2" CONDUIT.
- PROVIDE AND INSTALL ALUMINUM CONDUIT STRAPS (TYPICAL).
- $\langle 16 \rangle$  NOT USED.
- (17) FOR UNDERGROUND RACEWAYS TO WETWELL THE CONTRACTOR SHALL UTILIZE PVC COATED ALUMINUM.
- PROVIDE AND INSTALL (3)-#3 AWG + (1)-#4 NEU. IN 2" CONDUIT TO PROPOSED TECO HANDHOLE. SEE SHEET E5 FOR CONTINUATION.

- $\langle 19 \rangle$  provide and install an emergency connector.
- $\langle 20 \rangle$  provide and install (3)-#12 xhhw-2 cu + (1)# 12 xhhw-2 cu gnd. in 3/4" c.
- $\langle 21 \rangle$  PROVIDE AND INSTALL (26)-#12 XHHW-2 CU + (1)# 12 XHHW-2 CU GND. IN 1-1/4" C. FOR 120VAC CONTROL SIGNALS. REFER TO MCP TO PCP INTERCONNECTIONS WIRING DIAGRAM ON SHEET E11.
- $\langle 22 \rangle$  PROVIDE AND INSTALL (15)-#14 XHHW-2 CU + (1)-#14 XHHW-2 CU GND. IN 1" C. FOR 24V DC CONTROL SIGNALS, REFER TO MCP TO PCP INTERCONNECTION WIRING DIAGRAM ON SHEET E11.
- PROVIDE AND INSTALL (1)-#12 XHHW-2 CU NUE. + (1)#12 XHHW-2 CU GND. IN 3/4" CONDUIT FROM MOTOR CONTROLS PANÈL TO PUMP CONTROL PANEL FÒR 120V POWER CIRCUIT.
- $\langle 24 \rangle$  provide and install (3)-#3 thwn cu + (1)-#4 thwn neu. in 2" conduit.
- INSTRUMENTATION AND CONTROLS J.B.-USED AS DEMARCATION BOX TO PROVIDE ISOLATION BETWEEN THE WET WELL AND PUMP CONTROLS. PROVIDE AND INSTALL A 12"x12"x6" NEMA 4X, STAINLESS STEEL JUNCTION BOX WITH HINGED DOOR, WIEGMANN #BN4121206CHSS. INSTALL A STAINLESS STEEL LOUVER PLATE KIT (4.75"x4.5") ON SIDE OF BOX TO PROVIDE NATURAL ASPIRATION, WIEGMANN #WAVK0304SSA. TERMINATIONS SHALL BE MADE WITH UNDERGROUND WIRE CONNECTORS - IDEAL MODEL #60 -(TYPICAL FOR EACH CONDUCTOR). SEE SHEET E16 FOR JB DETAILS.
- $\langle 26 
  angle$  provide duct sealing compound in all conduits extending to the wet well.
- $\langle 27 \rangle$  PROVIDE AND INSTALL (3)-#3 XHHW-2 CU + (1)-#4 XHHW-2 CU NEU + (1)-#6 XHHW-2 CU GND IN 1-1/4" CONDUIT FOR EMERGENCY CONNECTOR.
- $\langle 28 \rangle$  provide and install a 3/4" conduit to proposed area light, (al), see sht. E18 for details.
- $\langle 29 \rangle$  provide and install a 3/4" schedule 80 pvc conduit for #4 awg grounding conductor.
- $\langle 30 \rangle$  proposed ground test well. Minimum spacing between wells 6'-0". See sheet e17 for details.
- $\langle 31 \rangle$  Provide and install water-tight / dust-tight myers hub and union (typ.).
- $\langle \overline{32} \rangle$  PM1 J.B.- PROVIDE AND INSTALL A 8"x6"x3.5" NEMA 4X, STAINLESS STEEL JUNCTION BOX, ENCLOSURE PART NUMBER EJ863516. SEE E21 FOR JB DETAILS.

DATE DESCRIPTION




CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

TPA2007-01M

E18C

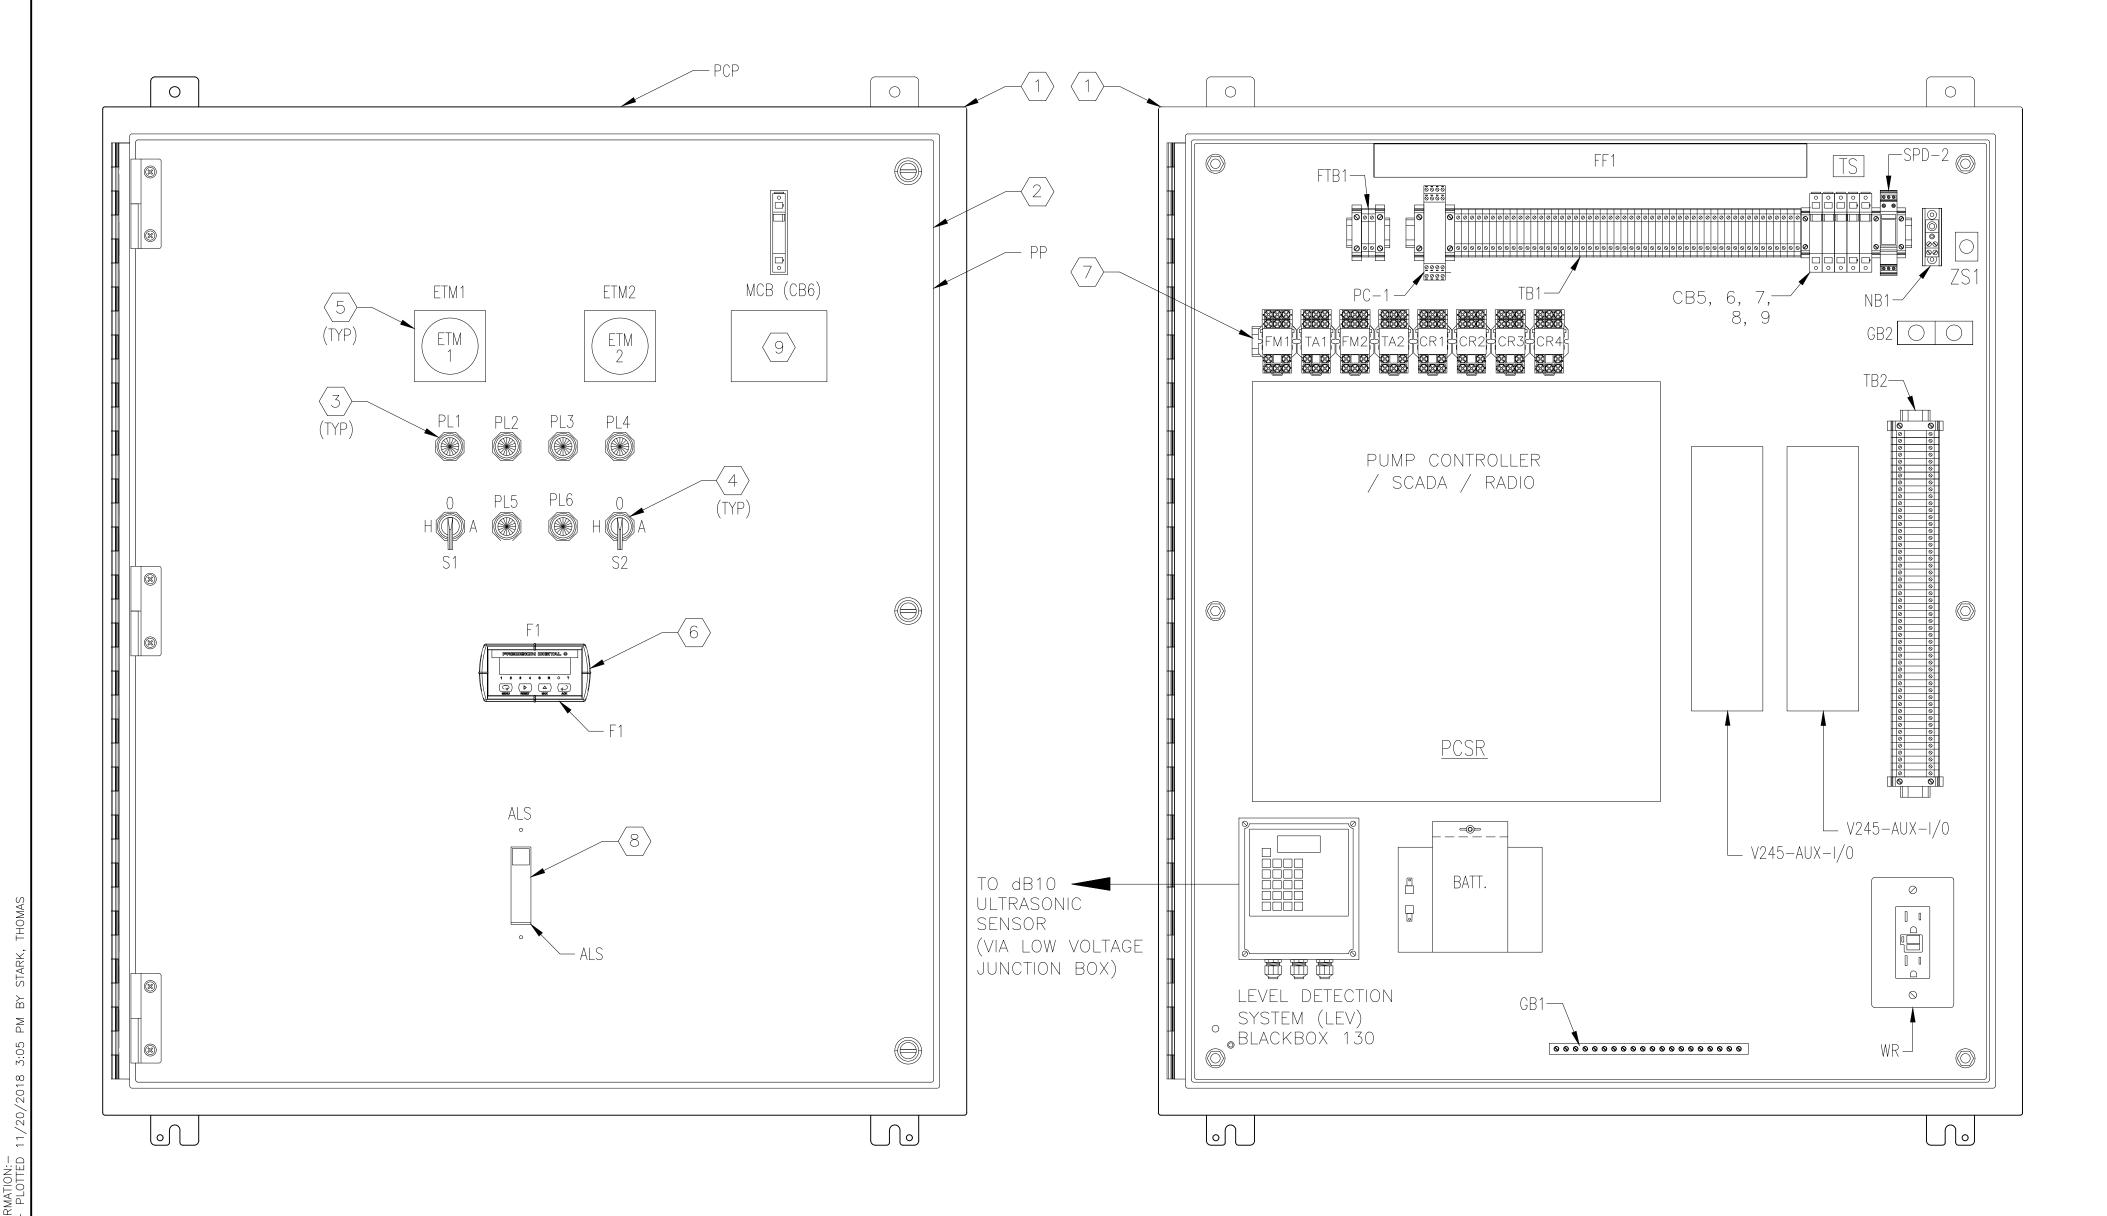

PUMP CONTROL PANEL DETAILS

SCALE: 1 1/2" = 1'-0"

NOTE: FRONT ENCLOSURE DOOR NOT SHOWN FOR CLARITY

PANEL INTERIOR

LEGEND PLATE SCHEDULE			
SYMBOL	DEVICE	LEGEND	
ETM1	ELAPSED TIME METER	PUMP NO. 1 HOURS	
ETM2	ELAPSED TIME METER	PUMP NO. 2 HOURS	
PL1	YELLOW PILOT LIGHT	PUMP NO. 1 ON	
PL2	RED ILLUMINATED PUSH BUTTON	PUMP NO. 1 TEMP. ALARM	
PL3	RED ILLUMINATED PUSH BUTTON	PUMP NO. 2 TEMP. ALARM	
PL4	YELOW PILOT LIGHT	PUMP NO. 2 ON	
PL5	RED PILOT LIGHT	PUMP NO. 1 SEAL LEAK ALARM	
PL6	RED PILOT LIGHT	PUMP NO. 2 SEAL LEAK ALARM	
S1	3 POSITION SWITCH	PUMP NO. 1 HAND—OFF—AUTO	
S2	3 POSITION SWITCH	PUMP NO. 2 HAND-OFF-AUTO	
MCB	PUMP CONTROL PANEL MAIN CIRCUIT BREAKER	MAIN CIRCUIT BREAKER	
F1	DIGITAL PROCESS METER	WET WELL LEVEL	
ALS	TOGGLE SWITCH	AREA LIGHT SWITCH	

### **KEYED NOTES:**

- PUMP CONTROL CABINET. 42" X 36" X 12" NEMA 4X SS, PAINTED WHITE.
- PROVIDE AND INSTALL ALUMINUM DEADFRONT DOOR WITH STOP KIT.
- PROVIDE AND INSTALL NEW PILOT LIGHT. REFER ALSO TO PARTS SCHEDULE ON SHEET E14.
- PROVIDE AND INSTALL NEW SELECTOR SWITCH. REFER ALSO TO PARTS SCHEDULE ON SHEET E14.
- PROVIDE AND INSTALL NEW ELAPSED TIME METER. REFER ALSO TO PARTS SCHEDULE ON SHEET E14. ON SHEET E14.
- PROVIDE AND INSTALL PRECISION DIGITAL PROCESS METER, MODEL PD765-6RO-10 WITH 4-20mA OUTPUT. REFER ALSO TO PARTS SCHEDULE ON SHEET E15.
- $\langle 7 \rangle$  provide and install aluminum din Rail where required.
- PROVIDE AND INSTALL NEW SINGLE-POLE 120/277V, 20A LIGHT SWITCH TO CONTROL AREA LIGHT. REFER ALSO TO PARTS SCHEDULE ON SHEET E15.
- 9 PROVIDE WARNING LABEL ABOVE OR BELOW CB6. LABEL TO READ:

PUMP CONTROL PANEL DETAILS

"WARNING: THE 120VAC SUPPLY FOR THIS PUMP CONTROL PANEL (PCP) IS FED FROM MOTOR CONTROL PANEL MCP AND WILL BE PRESENT AT THE LINE SIDE OF MCB (CB-6) LOCATED IN THIS PANEL. LOCK AND TAG OUT THE MOTOR CONTROL PANEL DISCONNECT PRIOR TO OPENING DEAD FRONT DOOR."

DATE DESCRIPTION

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613




201 North Franklin Street, Suite 1350 Tampa, FL 33602 www.wadetrim.com Certificate of Authorization No.: 3952


CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO. TPA2007-01M

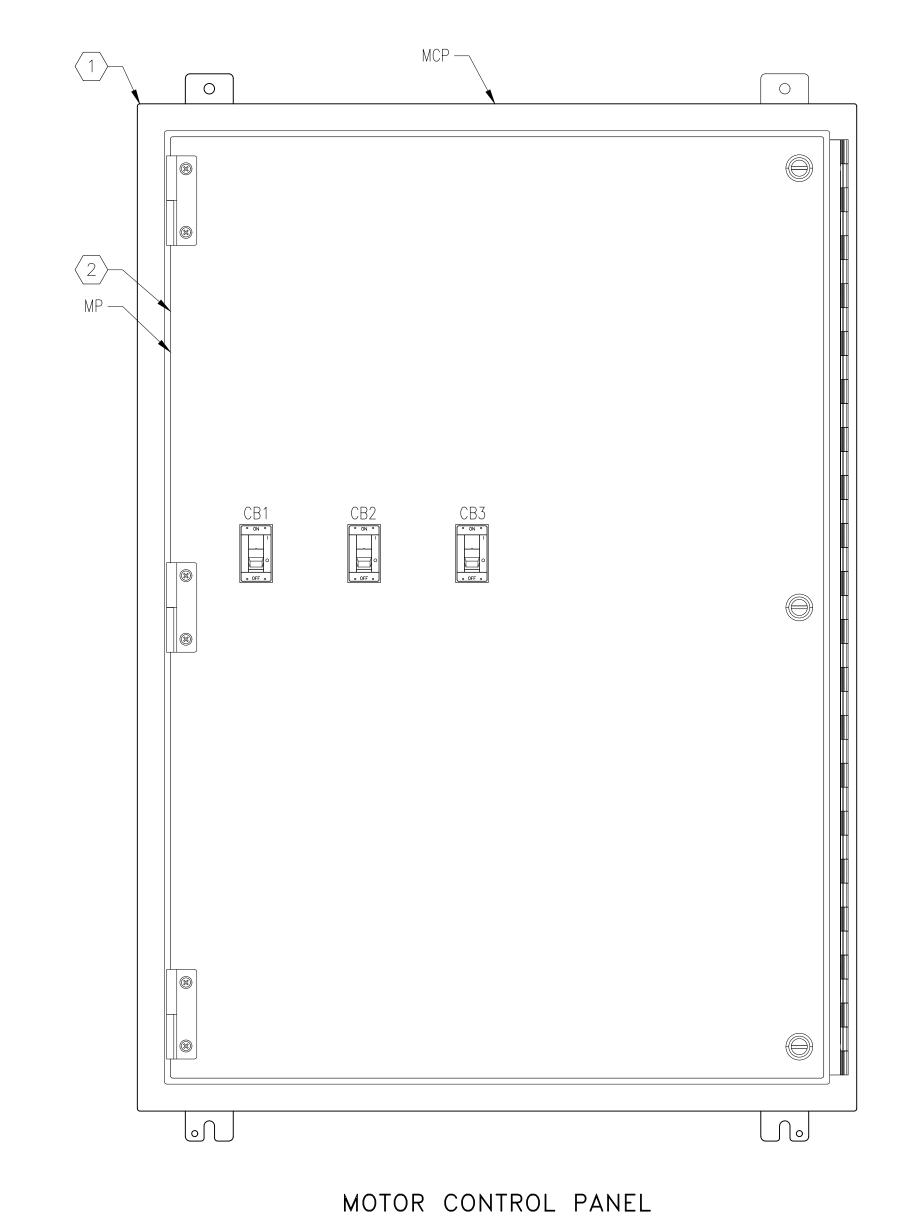

DETAILS

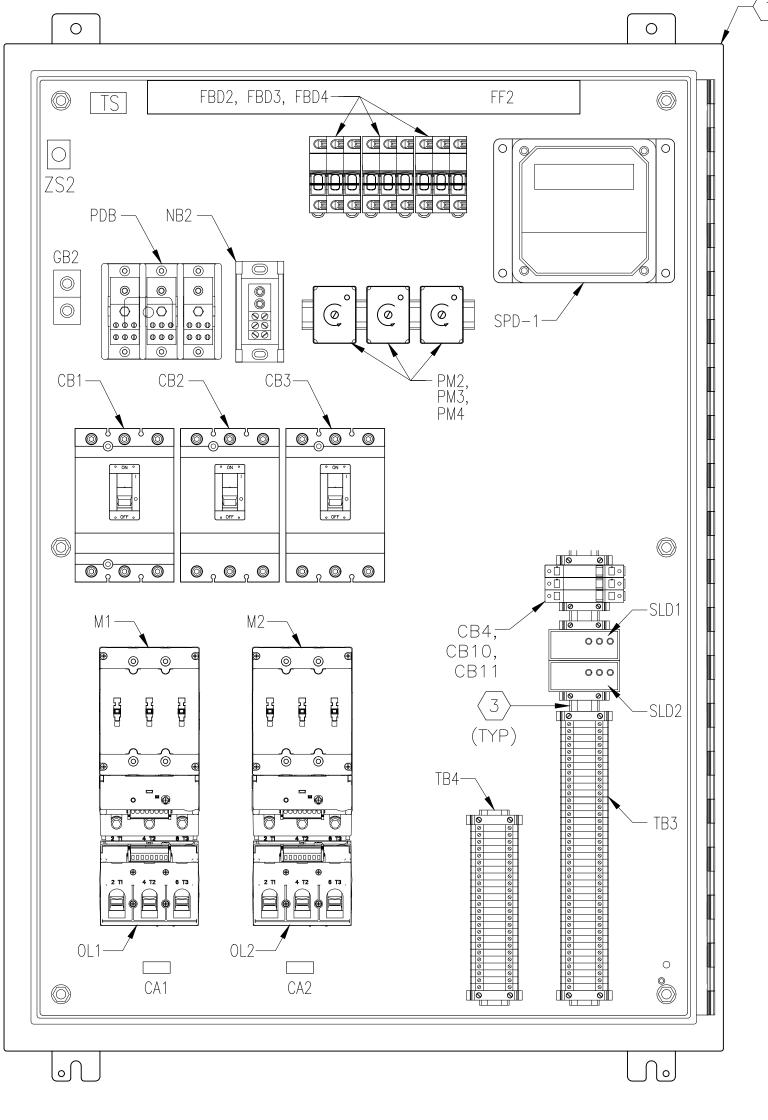

PANEL INTERIOR DETAILS

# LEGEND PLATE SCHEDULE


L			
	SYMBOL	DEVICE	LEGEND
	CB1	CIRCUIT BREAKER	PUMP NO. 1 CIRCUIT BREAKER
	CB2	CIRCUIT BREAKER	PUMP NO. 2 CIRCUIT BREAKER
	CB3	CIRCUIT BREAKER	SPARE CIRCUIT BREAKER


## **KEYED NOTES:**

- $\langle 1 \rangle$  motor control cabinet. 42" x 30" x 12" nema 4x ss, powder coat white.
- 2 PROVIDE AND INSTALL ALUMINUM DEADFRONT DOOR WITH STOP KIT.
- 3 PROVIDE AND INSTALL ALUMINUM DIN RAIL WHERE REQUIRED.
- 4 PROVIDE WARNING LABEL ON ENCLOSURE DOOR. LABEL TO READ:

"WARNING — OPENING FUSED DOUBLE THROW SWITCH DOES NOT DE—ENERGIZE VOLTAGE TO THIS ENCLOSURE"

(5) SEE SHEET E21 FOR FURTHER PM1 JUNCTION BOX DETAIL.

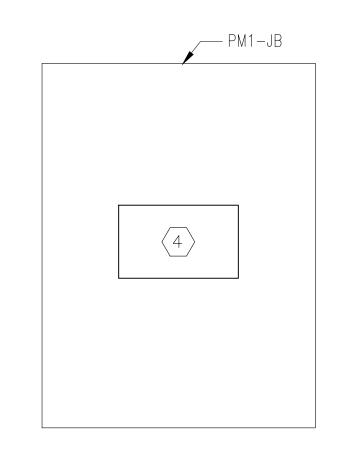

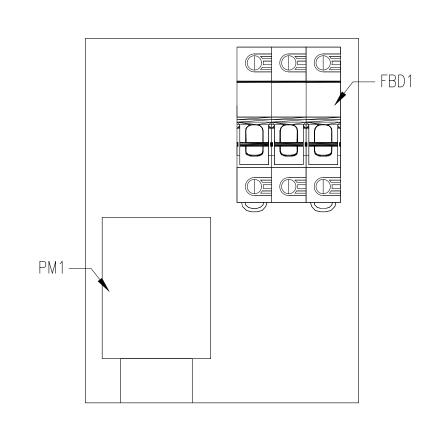

PM1 JUNCTION BOX
DETAILS 5

JUNCTION BOX INTERIOR

DETAILS 5

REV# DATE DESCRIPTION BY

ALAN M. SCHWAB, P.E.






CITY OF TAMPA, FLORIDA CORDELIA PUMP STATION REHABILITATION

MOTOR CONTROL PANEL DETAILS

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

PM1 JUNCTION BOX DETAIL

REV# DATE DESCRIPTION BY









# CITY OF TAMPA

# GRECO PUMP STATION REHABILITATION

# 100% PLANS CONTRACT NO. 18-C-00042

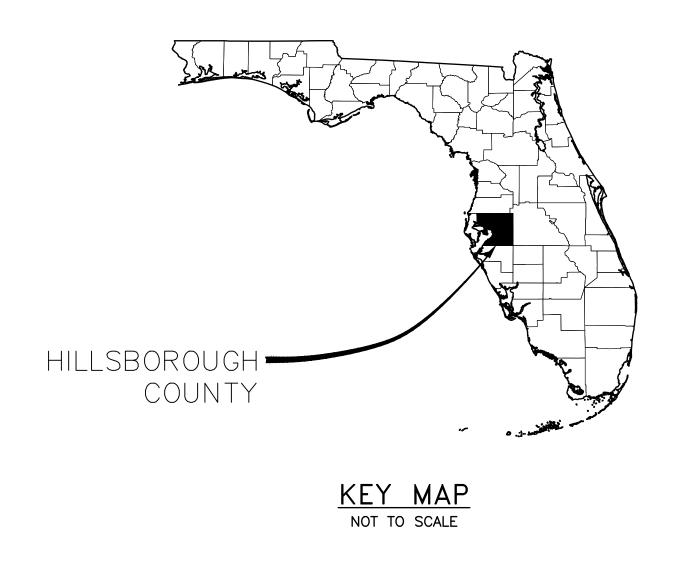

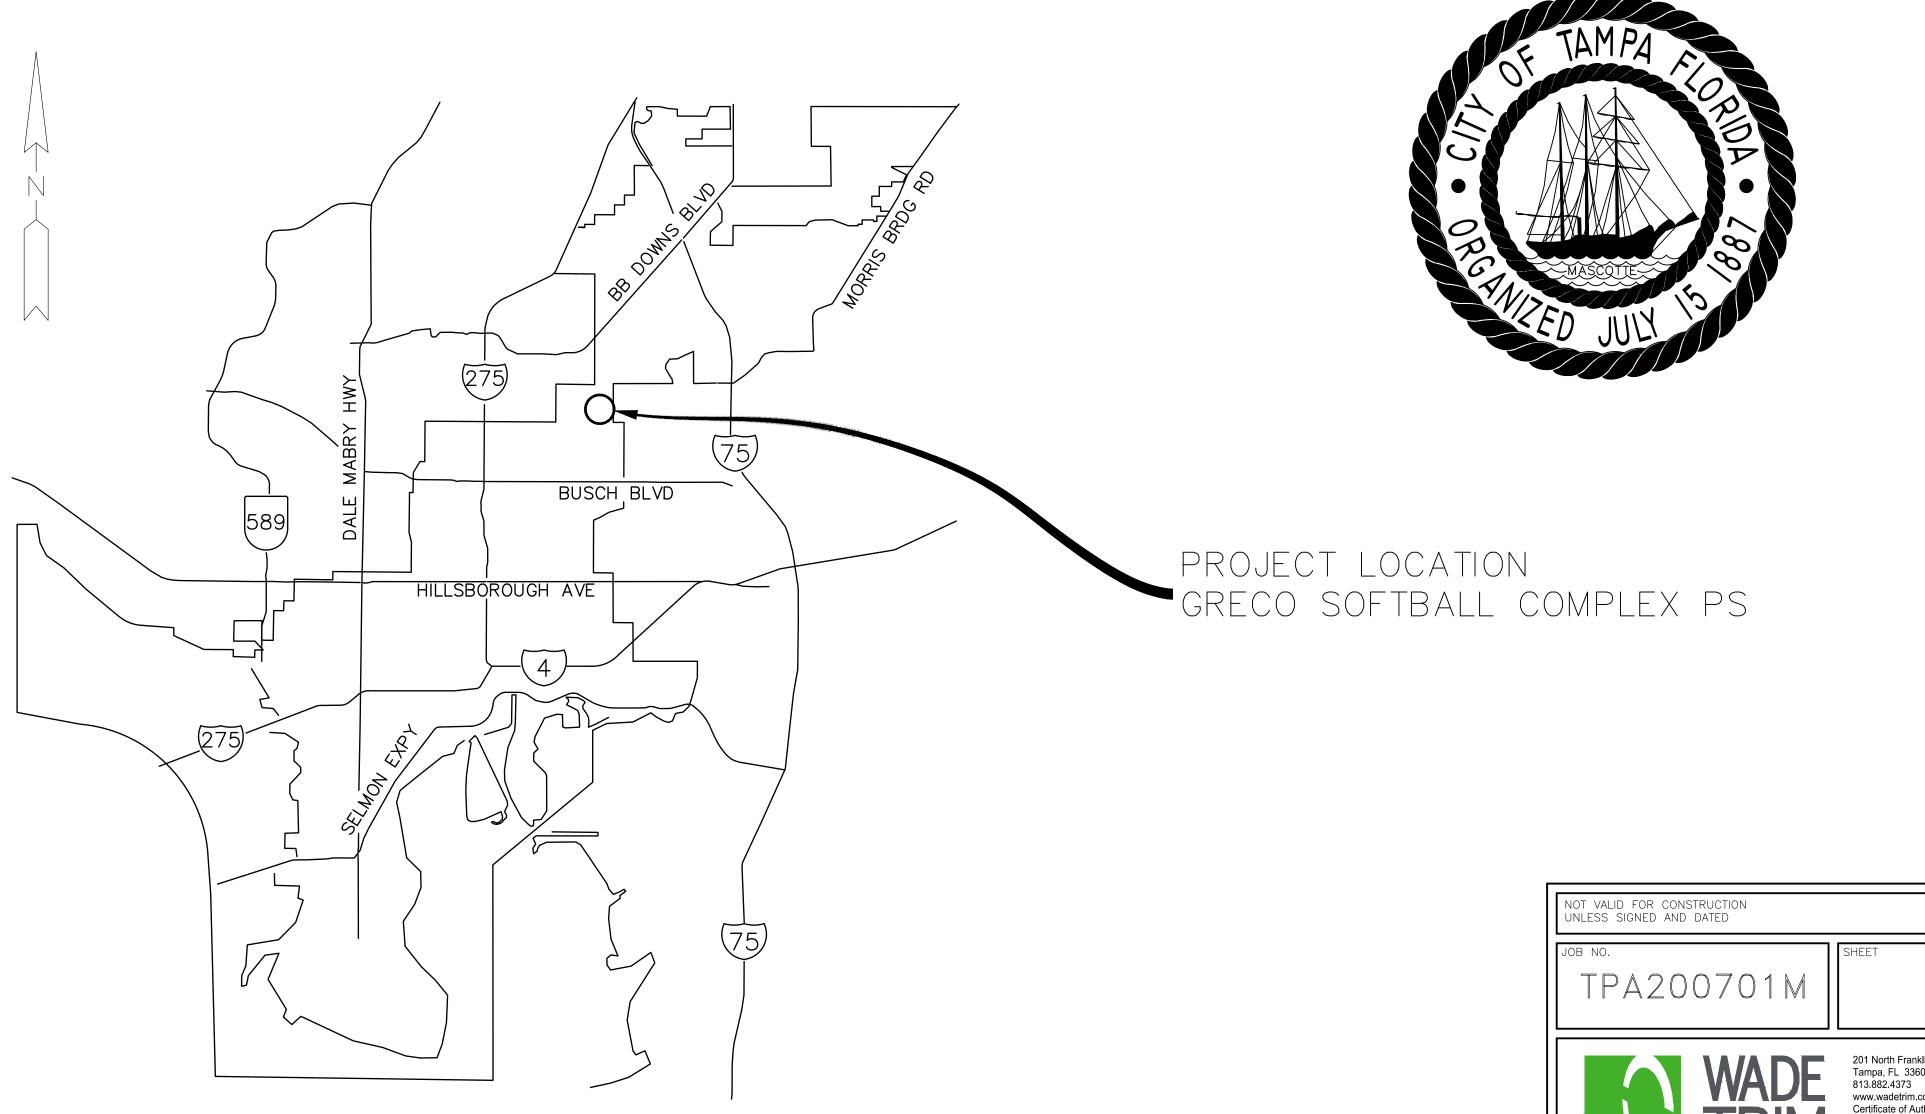




TPA200701M

Can 1

Can



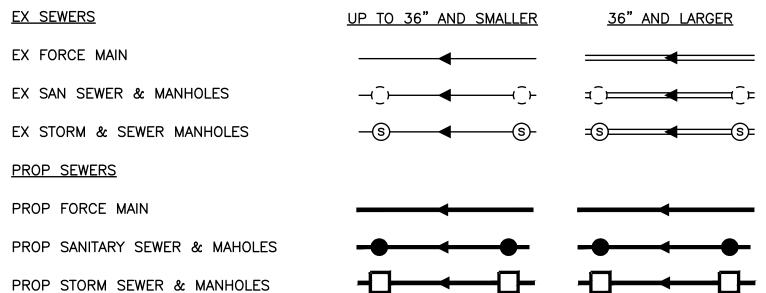

-

---)

<u> </u>	BURIED TELEPHONE
⊐ <sup>^</sup> ⊨	CONCRETE PIPE
~_ <i>-</i>	DIAMETER RATIO
<b>=(S)</b> =	DUCTILE IRON PIPE
O	EDGE OF PAVEMENT
	FIBER OPTIC CABLE
	FLORIDA DEPT. OF TRANSPORTA
	FORCE MAIN
_	HIGH DENSITY POLYETHYLENE F
_	EL INVERT ELEVATION
_	

AIR RELEASE VALVE

BENCH MARK


APPROXIMATE LOCATION


	ARV	MAINTENANCE OF TRAFFIC	MOT
	AL	MANHOLE	MH or M
	ВМ	PLUG VALVE	PV
	ВТ	POINT of INTERSECTION	PI
	CP	POLYVINYL CHLORIDE PIPE	PVC
	DR	REINFORCED CONCRETE PIPE	RCP
	DIP	RESTRAINED MECHANICAL JOINT	RMJ
	EOP	RIGHT of WAY	R/W
	FOC	TOP of PIPE	TOP
RTATION	FDOT	VERIFIED VERT. AND HORZ. LOCATION	Vvh
	FM	VITRIFIED CLAY PIPE	VCP
PIPE	HDPE	WASTEWATER	WW
	IE or INV		


**ABBREVIATIONS** 









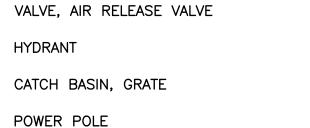



OTHER FEATURES

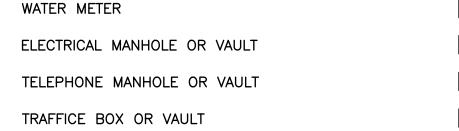

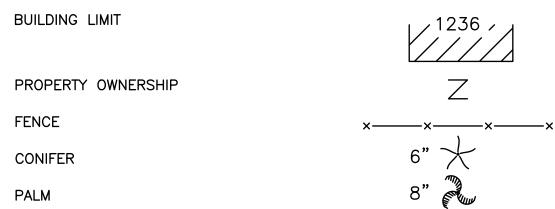





EXISTING WYE

PROPOSED WYE

CLEAN OUT

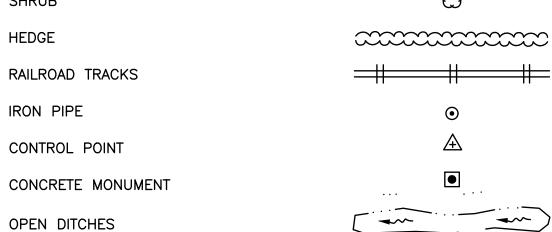





GRECO SOFTBALL COMPLEX PS PROJECT LOCATION 11000 N 50TH ST

GRECO SOFTBALL COMPLEX PS LOCATION MAP

#### PAGE INDEX OF PLANS SHEET NO. SHEET DESCRIPTION COVER SHEET 2 LEGEND, INDEX AND LOCATION GENERAL NOTES EXISTING AND PROPOSED SITE PLANS - GRECO SOFTBALL COMPLEX DEMOLITION PLAN AND SECTION VIEW - GRECO SOFTBALL COMPLEX PROPOSED PLAN VIEW - GRECO SOFTBALL COMPLEX PROPOSED SECTION VIEW - GRECO SOFTBALL COMPLEX DETAIL SHEET (1 OF 3) DETAIL SHEET (2 OF 3) 9 10 DETAIL SHEET (3 OF 3) E1 ELECTRICAL SYMBOL LEGEND (SHT. 1 OF 2) E2 ELECTRICAL SYMBOL LEGEND (SHT. 2 OF 2) E3 GENERAL NOTES AND SCOPE OF WORK E4 SITE PLAN E5 NOT USED E6 NOT USED E7 GRECO SOFTBALL COMPLEX PUMP STATION ONE LINE DIAGRAM E8 ELECTRICAL SCHEMATIC (1 OF 4) MOTOR CONTROL PANEL E9 ELECTRICAL SCHEMATIC (2 OF 4) PUMP CONTROL PANEL E10 ELECTRICAL SCHEMATIC (3 OF 4) MOTOR CONTROL PANEL E10A ELECTRICAL SCHEMATIC (4 OF 4) MOTOR CONTROL PANEL E11 MCP TO PCP INTERCONNECTION WIRING DIAGRAM E12 ELECTRICAL SCHEMATIC LEGEND (SHT. 1 OF 2) E13 ELECTRICAL SCHEMATIC LEGEND (SHT. 2 OF 2) E14 PARTS SCHEDULE (SHT. 1 OF 2) E15 PARTS SCHEDULE (SHT. 2 OF 2) E16 ELECTRICAL DETAILS (SHT. 1 OF 5) E17 ELECTRICAL DETAILS (SHT. 2 OF 5) E18 ELECTRICAL DETAILS (SHT. 3 OF 5) ELECTRICAL DETAILS (SHT. 4 OF 5) E18A E18B ELECTRICAL DETAILS (SHT. 5 OF 5) E18C ELECTRICAL KEYNOTES

E19

E20

E21

LEGEND, INDEX AND LOCATION

DATE DESCRIPTION BY





CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION PUMP CONTROL PANEL DETAILS

MOTOR CONTROL PANEL DETAILS

PM1 ENCLOSURE DETAIL

#### DEMOLITION NOTES

- D-1 SALVAGEABLE MATERIAL, AS DETERMINED BY DEPARTMENT PERSONNEL, SHALL BE DELIVERED TO A LOCATION DESIGNATED BY THE CITY. NON-SALVAGEABLE MATERIALS ARE TO BE REMOVED FROM THE SITE AND PROPERLY DISPOSED OF AT THE CONTRACTORS EXPENSE.
- D-2 THE CONSTRUCTION SITES SHALL BE MAINTAINED IN AS NEAT AND ORDERLY CONDITION AS POSSIBLE DURING CONSTRUCTION OPERATIONS. SITES SHALL BE SECURED WITH TEMPORARY FENCING AND STRUCTURES DURING HOURS WHEN CONTRACTOR IS NOT PRESENT TO ENSURE SAFETY OF CITY EMPLOYEES AND THE PUBLIC.

#### GENERAL NOTES

- G-1 CONTRACTOR SHALL COORDINATE ALL CONSTRUCTION ACTIVITIES WITH THE WASTEWATER INSPECTOR, WASTEWATER PERSONNEL AND PUMPING STATION OPERATIONS.
- G-2 CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL NECESSARY RIGHT-OF-WAY PERMITS AND BUILDING PERMITS FOR THE PUMP STATION
- G-3 THE CITY WILL OBTAIN ALL NECESSARY FDEP WASTEWATER PERMITS.
- G-4 CONTRACTOR SHALL CALL SUNSHINE (1-800-432-4770) AT LEAST 48 HOURS PRIOR TO ANY CONSTRUCTION ACTIVITY.
- G-5 AFTER WET WELL IS DEWATERED, THE CONTRACTOR SHALL CLEAN WET WELL OF ALL DEBRIS. DEBRIS MAY BE DELIVERED AND DISPOSED OF AT THE CITY OF TAMPA HOWARD F. CURREN AWTP, 2700 MARITIME BOULEVARD, TAMPA, FL 33605.
- G-6 TWO NEW PUMPS PER STATION SHALL BE SUPPLIED FOR THIS PROJECT. PROPOSED PUMPS ARE FLYGT PUMPS. AS SHOWN ON THE SHEETS HEREIN. ALL PROPOSED PUMP BASES SHALL BE 4-INCH DIAMETER DISCHARGE ELBOWS.
- G-7 IT IS THE ENGINEERS INTENT THAT CONTINUOUS SERVICE WILL BE MAINTAINED THROUGHOUT THE PROJECT.
- G-8 CONTRACTOR SHALL VERIFY QUANTITIES OF ALL NECESSARY PIPES, REDUCERS, FITTINGS, SUPPORTS, AND ANY MISCELLANEOUS BRACKETS.
- G-9 DIMENSIONS SHOWN ARE NOT NECESSARILY ACCURATE TO THE DEGREE REQUIRED FOR FABRICATION. EXISTING DIMENSIONS AND VIEWS ARE SHOWN BASED ON THE BEST INFORMATION AVAILABLE. CONTRACTOR SHALL FIELD VERIFY ALL PERTINENT DIMENSIONS AND REFLECT THEM ON DETAILED SHOP DRAWINGS FOR APPROVAL BEFORE ANY FABRICATION.
- G-10 SHOP DRAWINGS SHALL BE SUBMITTED AND APPROVED BY THE CITY FOR ALL PROPOSED ITEMS. ALL SUBMITTALS AND SHOP DRAWINGS SHALL BE ORIGINALS OR HIGH QUALITY COPIES (CLEARLY LEGIBLE). NO FAXED SHEETS OR POOR QUALITY COPIES WILL BE ACCEPTED FOR SUBMITTAL REVIEW.
- G-11 PUMP DISCHARGE PIPING IN THE WET WELL SHALL BE 4-INCH DIAMETER 316 STAINLESS STEEL.
- G-12 PLUG VALVES SHALL BE DEZURIK, PEF 100% PORT, ECCENTRIC PLUG VALVES OR APPROVED EQUAL. ALL ABOVE GROUND PLUG VALVES SHALL BE PROVIDED WITH 2" NUTS AND NO HANDWHEELS.
- G-13 CHECK VALVES SHALL BE DEZURIK APCO RUBBER FLAPPER SWING CHECK VALVES, SERIES 100, MODEL 104P3, THIS EQUIPMENT IS A STANDARDIZED ITEM AT THIS FACILITY AND NO "OR EQUAL" SUBMITTALS WILL BE CONSIDERED.
- G-14 ALL HARDWARE, UNLESS OTHERWISE NOTED, SHALL BE TYPE 316 STAINLESS STEEL.
- G-15 PIPE SUPPORTS SHALL BE CONSTRUCTED AS SHOWN IN THE PIPE SUPPORT DETAIL.
- G-16 ALL CEMENTITIOUS CONCRETE AND GROUT, UNLESS OTHERWISE NOTED, SHALL BE CLASS "B", 4000 PSI COMPRESSIVE STRENGTH AT 28 DAYS. ALL REINFORCING STEEL SHALL BE GRADE 60.
- G-17 OSHA STANDARD SAFETY EQUIPMENT SUCH AS SAFETY HARNESSES, GAS MONITORS, LOWER EXPLOSIVE LIMIT (LEL) DETECTORS, BREATHING APPARATUS, ETC. SHALL BE UTILIZED WHERE THE WORK DICTATES THEIR USE.

- G-18 BACKFILL (NO CLAY OR CLAYEY MATERIAL) SHALL BE COMPACTED IN 6-INCH LAYERS (MAX.) TO 98% MAXIMUM DRY DENSITY OF MODIFIED PROCTOR IN CONFORMANCE WITH AASHTO T-180, METHOD A.
- G-19 ALL STAINLESS STEEL PARTS TO BE WELDED SHALL BE THE LOW-CARBON VERSION OF THE GRADE OF STAINLESS STEEL THAT IS CALLED FOR, SUCH AS: T-316L OR T-304L.
- G-20 ALL CONCRETE PAVEMENT, UNLESS OTHERWISE NOTED, SHALL BE MIN 8" THICK CONCRETE WITH 4X4 W6 x W6 WWF. CONCRETE SHALL BE CONSTRUCTED ON COMPACTED SUBBASE (MINIMUM 98% MODIFIED PROCTOR) WITH 1.5" DEEP CONTROL JOINTS SAWCUT @ 15' MAX, CUT WITHIN 12 HRS OF CONCRETE PLACEMENT.
- G-21 CONTRACTOR TO SUBMIT METHOD FOR 100% WATERTIGHT SEALING AT PIPE PENETRATIONS THROUGH STRUCTURES. PROPOSED LINK SEAL OR APPROVED EQUAL.
- G-22 CONTRACTOR SHALL PROVIDE A REDUCED PRESSURE BACKFLOW-PREVENTION DEVICE IN WATER SERVICE LINE, AS SHOWN IN DETAILS, AT A PLACE TO BE SPECIFIED DURING CONSTRUCTION. BACKFLOW PREVENTION DEVICE SHALL BE 1" WILKINS. MODEL #975 XL. OR EQUAL.
- G-23 ALL DIP PIPE AND FITTING SHALL BE CLASS 53 WITH PROTECTO 401 INTERIOR COATING.
- G-24 REMOVE ALL REMNANTS OF COAL TAR EPOXY IN EXISTING WET WELLS PRIOR TO LINING.
- G-25 ALL METAL PIPE, FITTINGS, VALVES, ETC. SHALL RECIEVE:
  - 1) SHOP COAT ONE COAT, 4-6 MILS (DRY) TNEMEC N140-1211 EPOXY PRIMER
  - 2) FIELD COAT ONE COAT, 5-7 MILS (DRY) TNEMEC SERIES 446 PERMA-SHIELD MCU
  - 3) FIELD COAT
  - A) ABOVE GRADE : ONE COAT, 4-6 MILS (DRY) TNEMEC 1074U ENDURASHIELD (WITH FACTORY ADDED UV BLOCKER) B) BELOW GRADE: ONE COAT, 5-7 MILS (DRY) TNEMEC SERIES 446 PERMA-SHIELD MCU
- G-26 ALL CONCRETE TOP SLABS AND RISER EXTENSIONS SHALL BE 4,000 PSI, CLASS B, CAST IN PLACE CONCRETE. REBAR REINFORCEMENT SHALL BE #6 AT 6" EW. TWO (2) #5 DIAGONAL BARS, EACH 3-FT LONG, SHALL BE PLACED AT EACH CORNER OF EVERY TOP SLAB OPENING.
- G-27 CONTRACTOR WILL BE REQUIRED TO BYPASS PUMP STATION DURING CONSTRUCTION PER SPECIFICATIONS REQUIREMENTS.

#### BUILDING CODE REFERENCES:

FLORIDA BUILDING CODE, 6TH EDITION, 2017

CITY OF TAMPA CODE OF ORDINANCES, CHAPTER 5 BUILDING CODE

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), SERIES 70


NATIONAL ELECTRICAL CODE (NEC), 2014 EDITION


DATE DESCRIPTION

201 North Franklin Street, Suite 1350 Tampa, FL 33602 www.wadetrim.com

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB JOB NO. TPA2007-01M

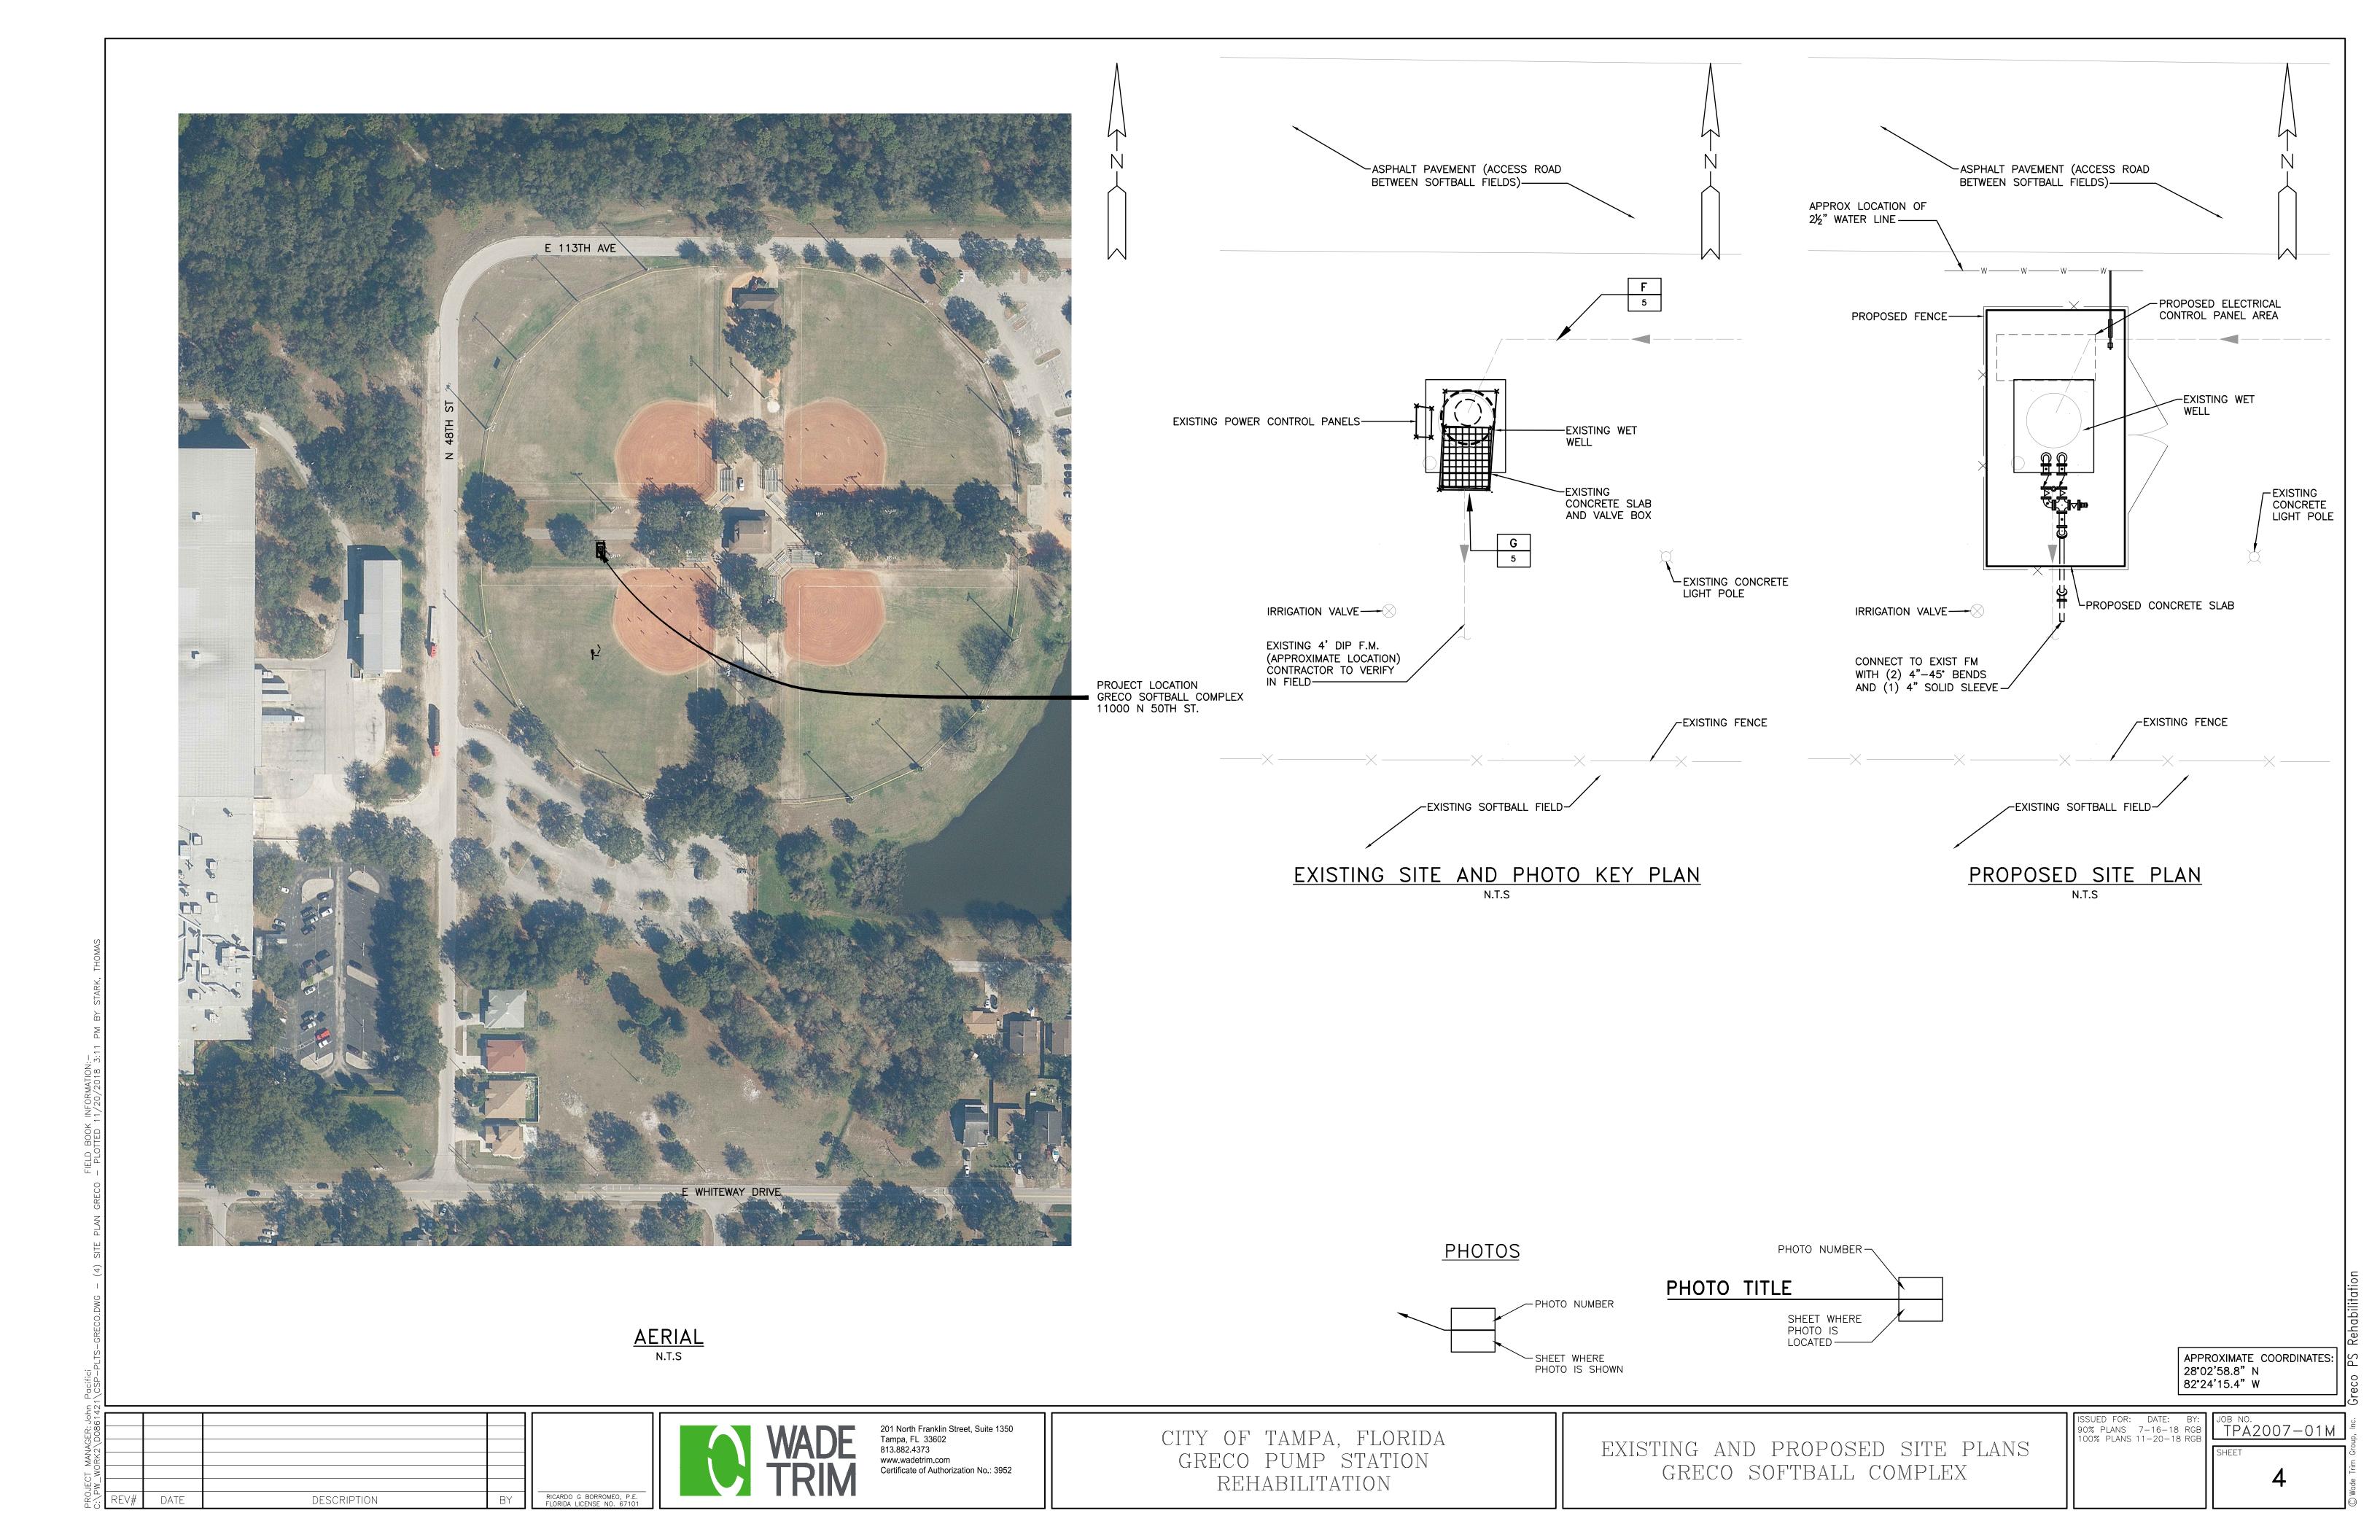



-REMOVE EXISTING ELECTRICAL

EQUIPMENT AND STRUCTURES

-REMOVE EXISTING CONCRETE SLAB

-REMOVE EXISTING PUMPS

-EXISTING FIBERGLASS WET WELL TO REMAIN

-EXISTING INFLUENT PIPING TO REMAIN

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

TPA2007-01M


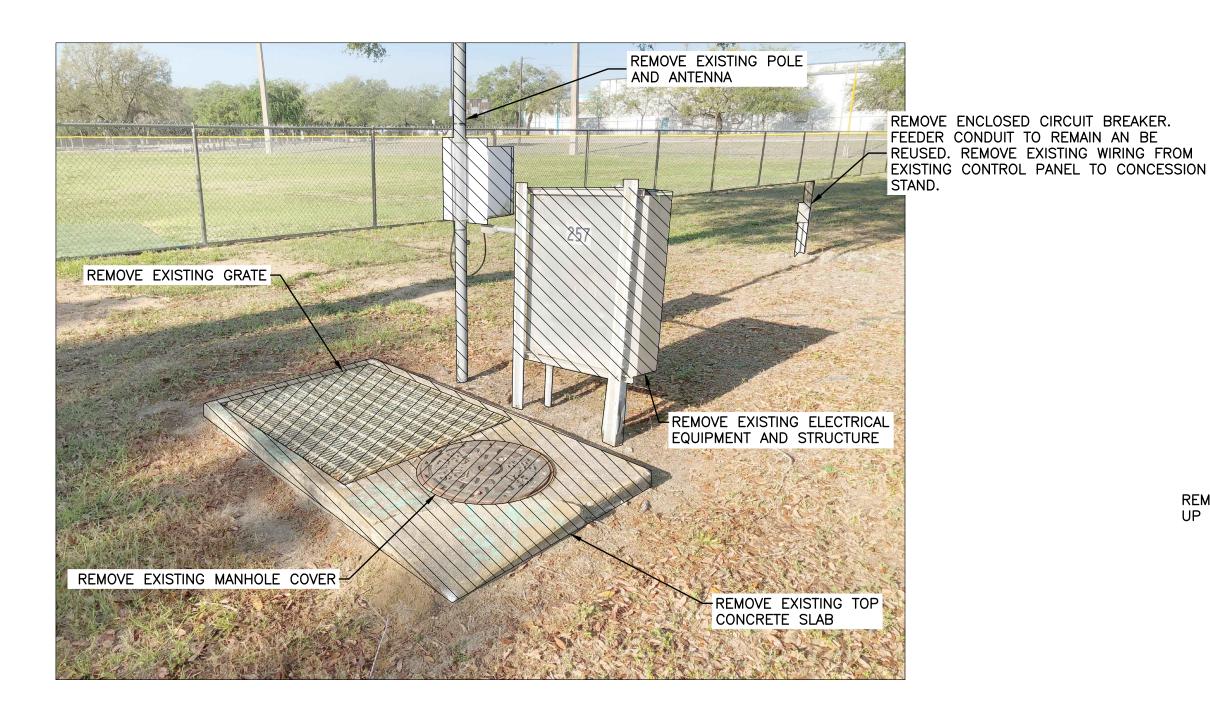


PHOTO F

RICARDO G BORROMEO, P.E FLORIDA LICENSE NO. 6710

DATE

DESCRIPTION

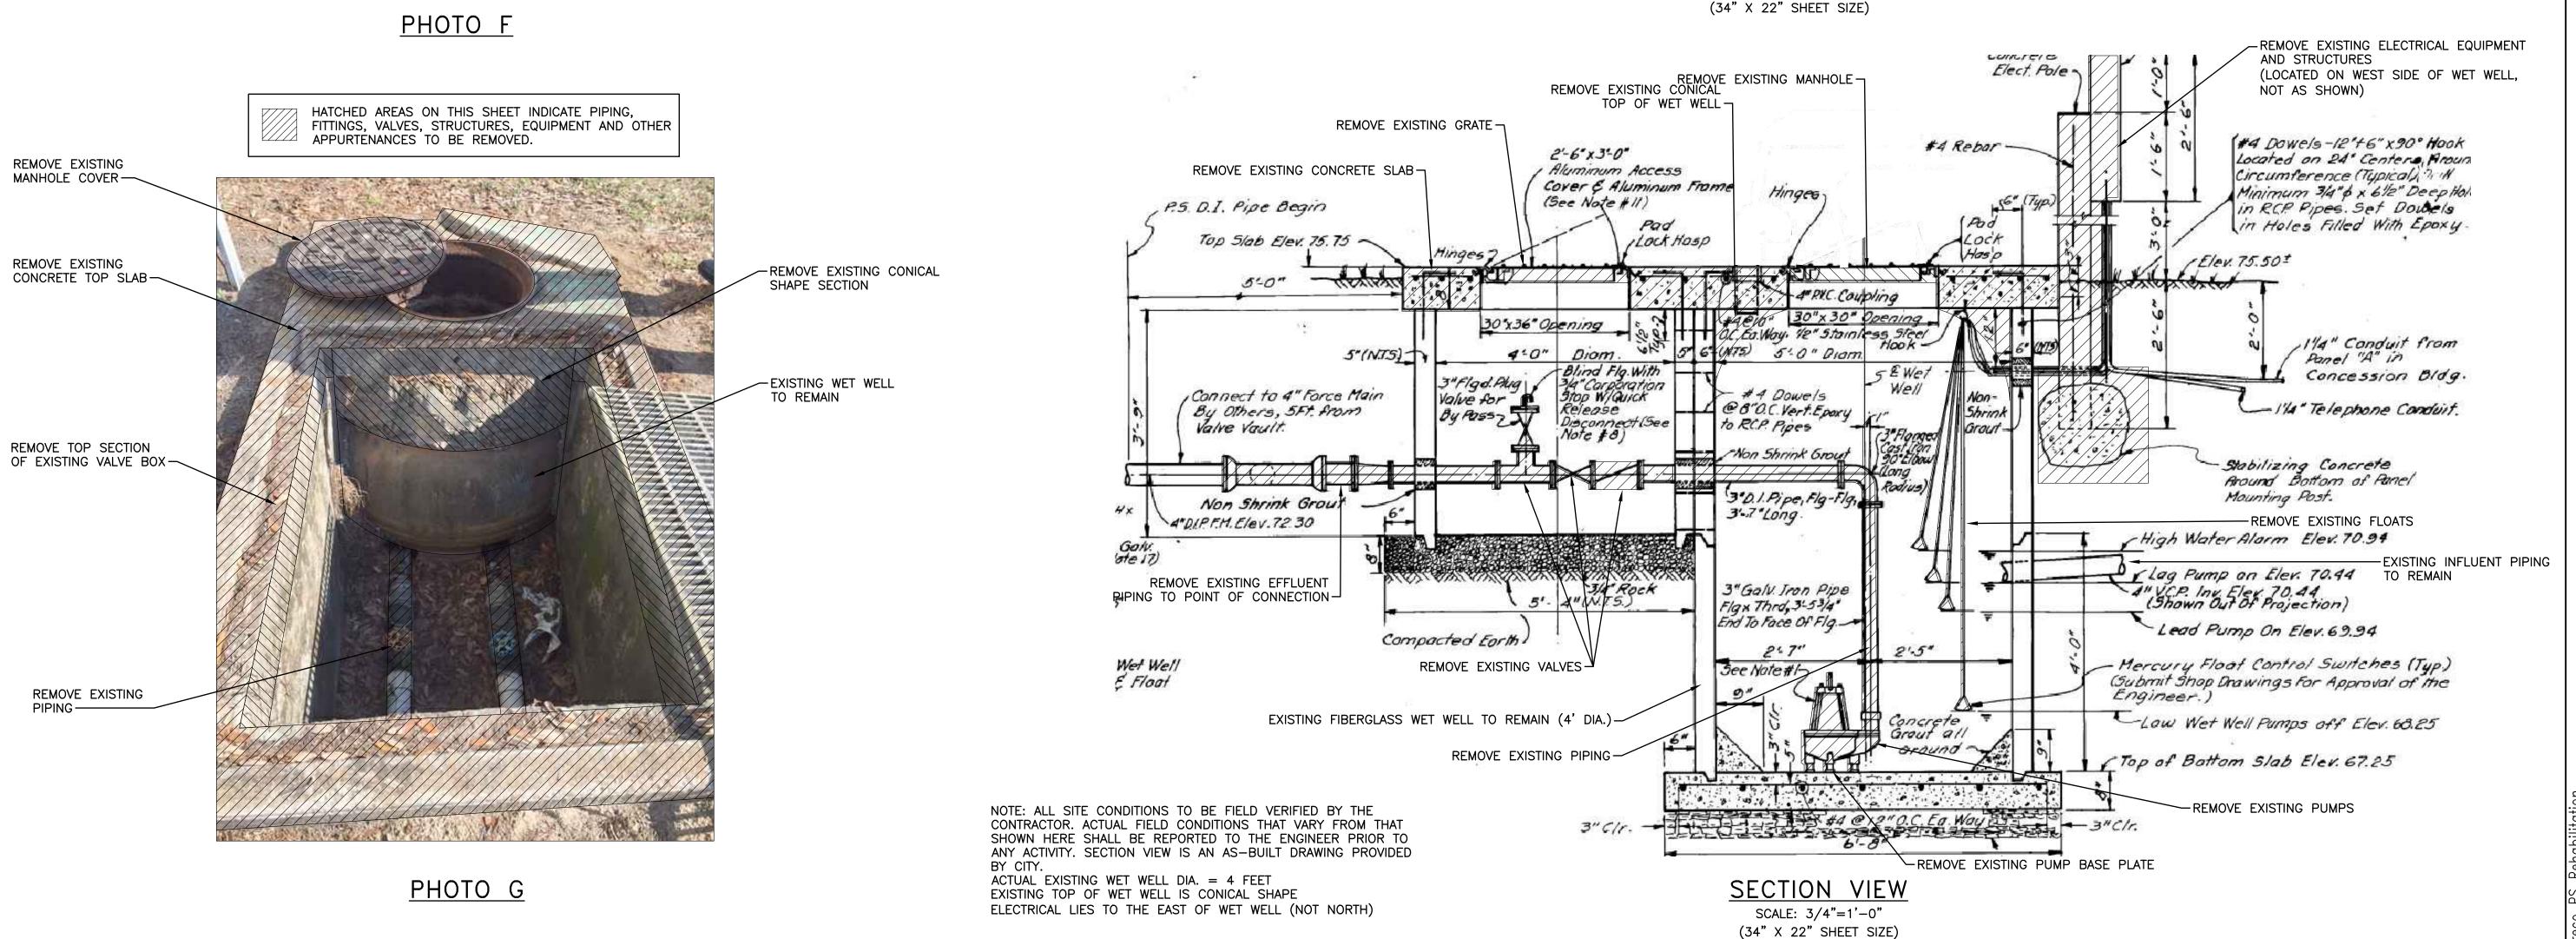

CITY OF TAMPA, FLORIDA

GRECO PUMP STATION

REHABILITATION

201 North Franklin Street, Suite 1350

Certificate of Authorization No.: 3952

Tampa, FL 33602

www.wadetrim.com

REMOVE EXISTING EFFLUENT PIPING

UP TO PROPOSED POINT OF CONNECTION-

REMOVE EXISTING POLE AND ANTENNA -


REMOVE TOP SECTION OF VALVE BOX, VALVE PIPING, AND VALVE


> PLAN VIEW SCALE: 3/4"=1'-0"

DEMOLITION PLAN AND SECTION VIEW

GRECO SOFTBALL COMPLEX

GRATE COVER -

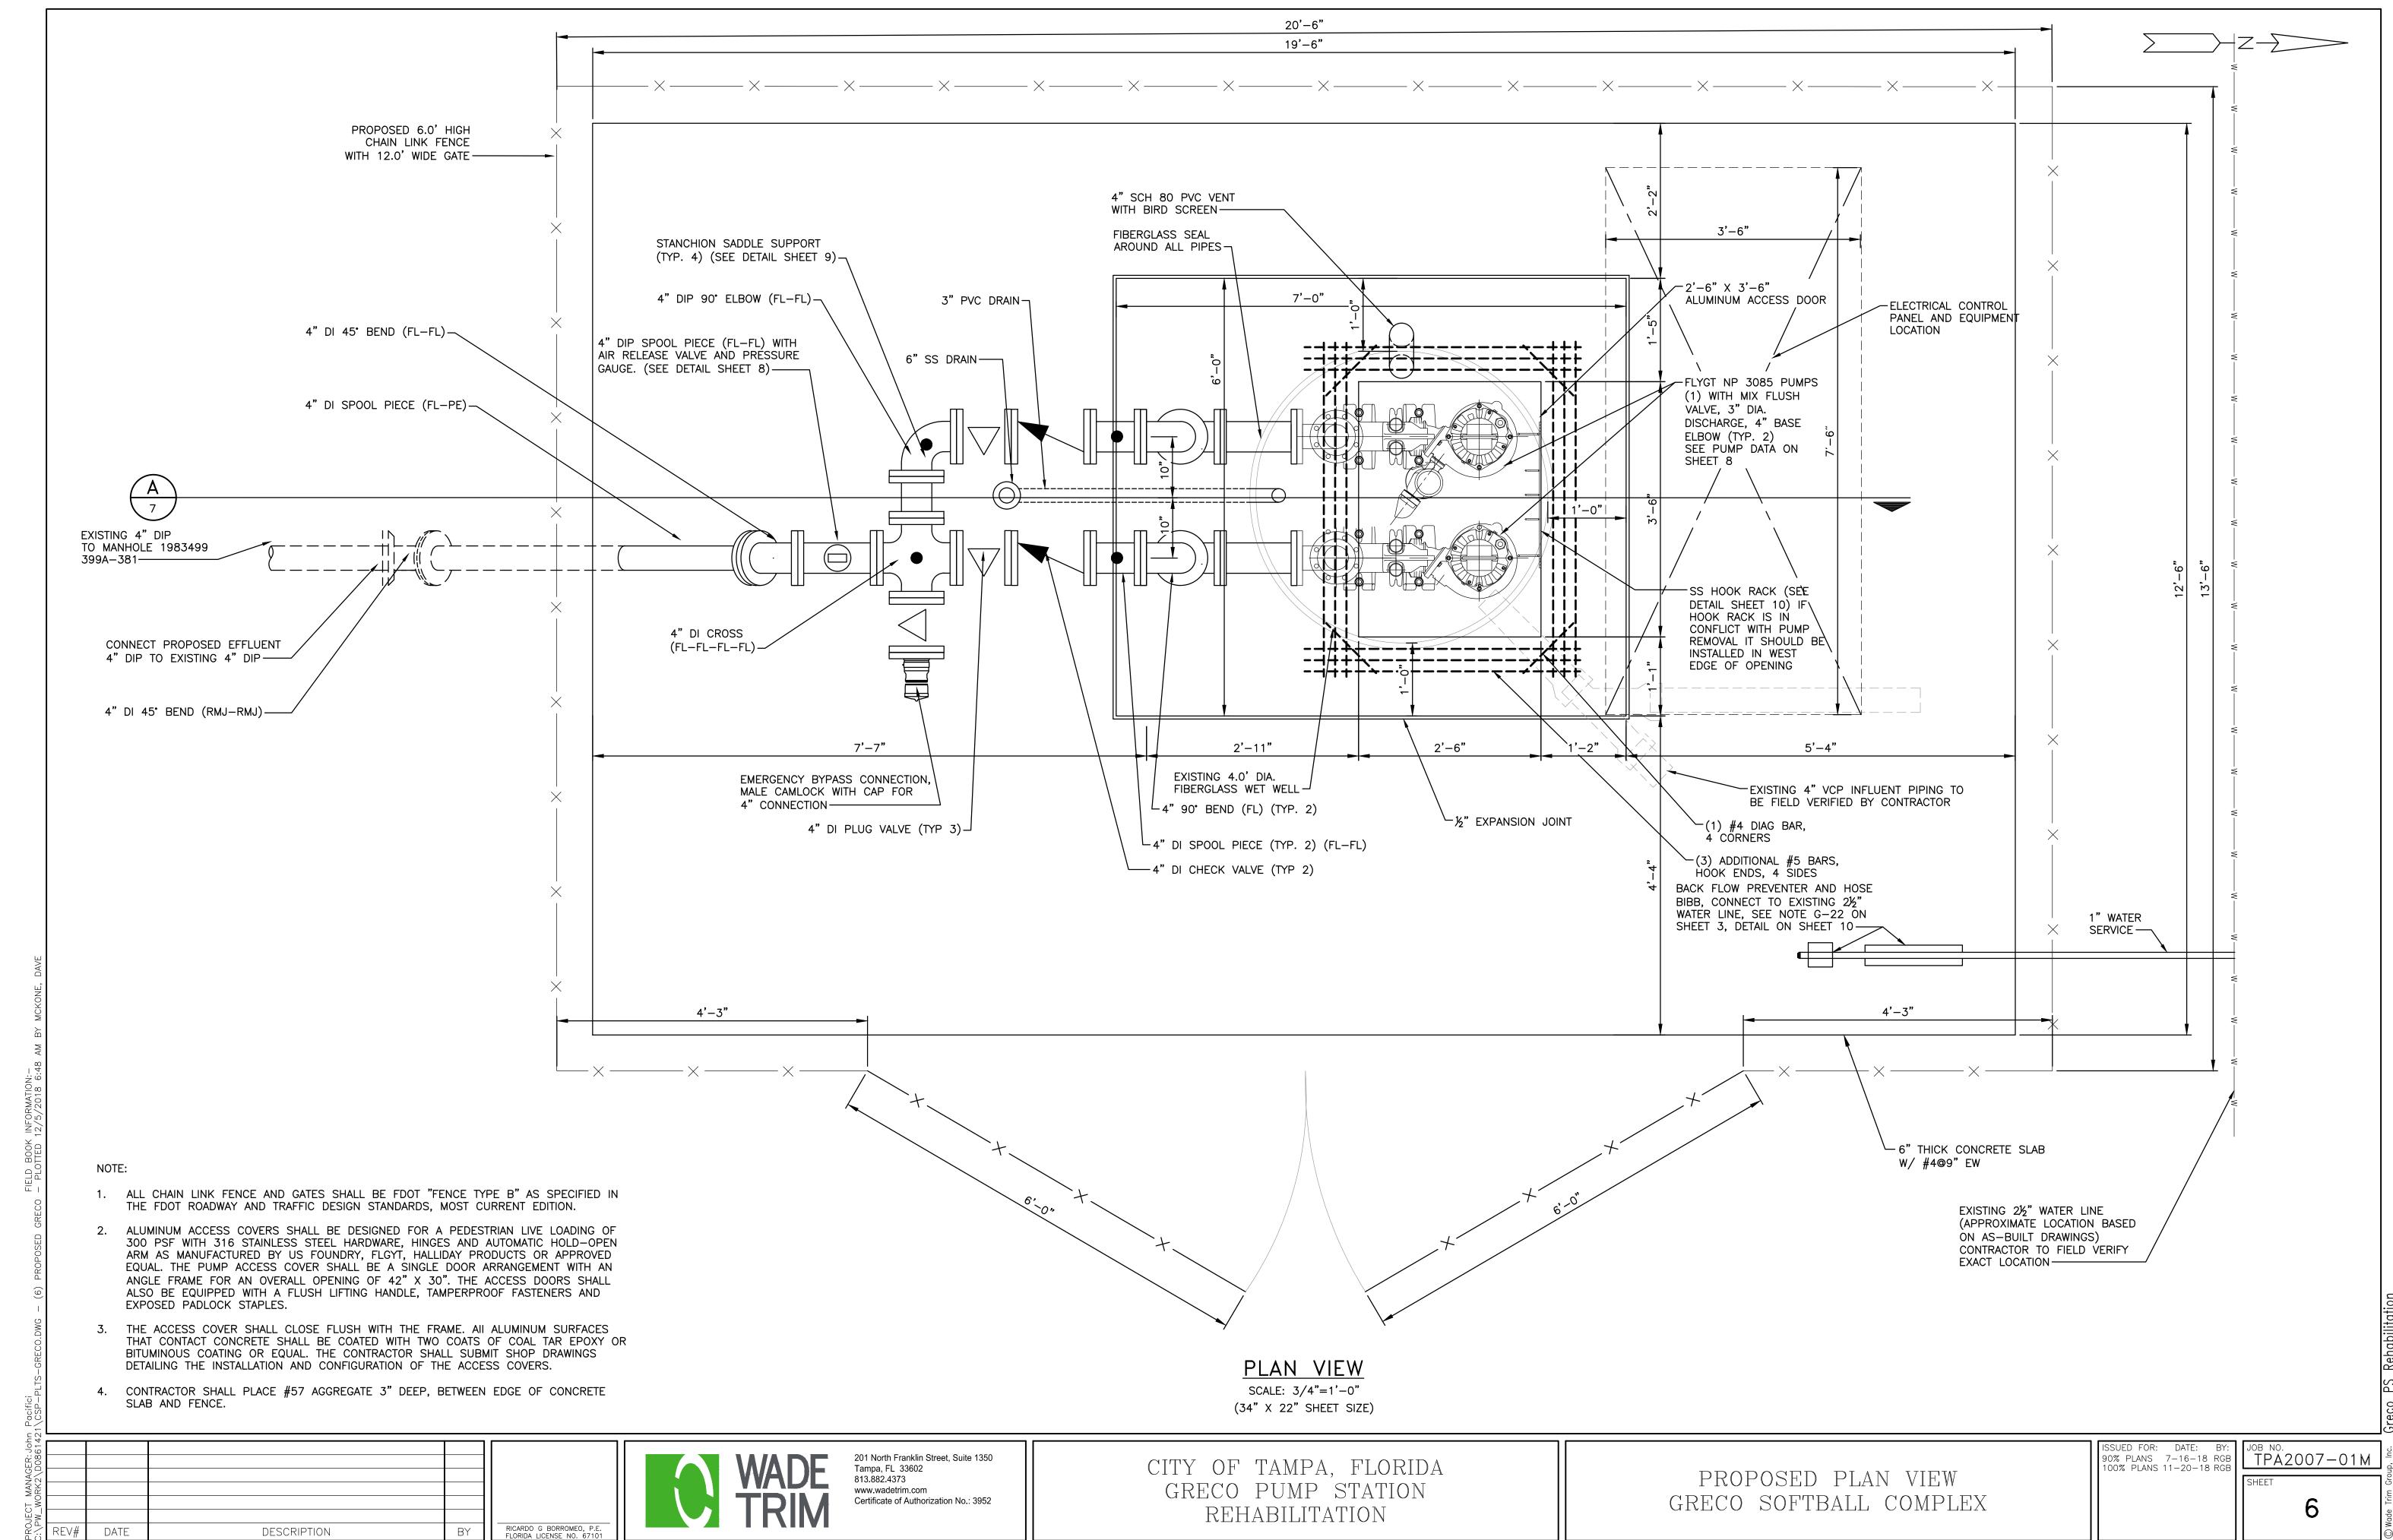

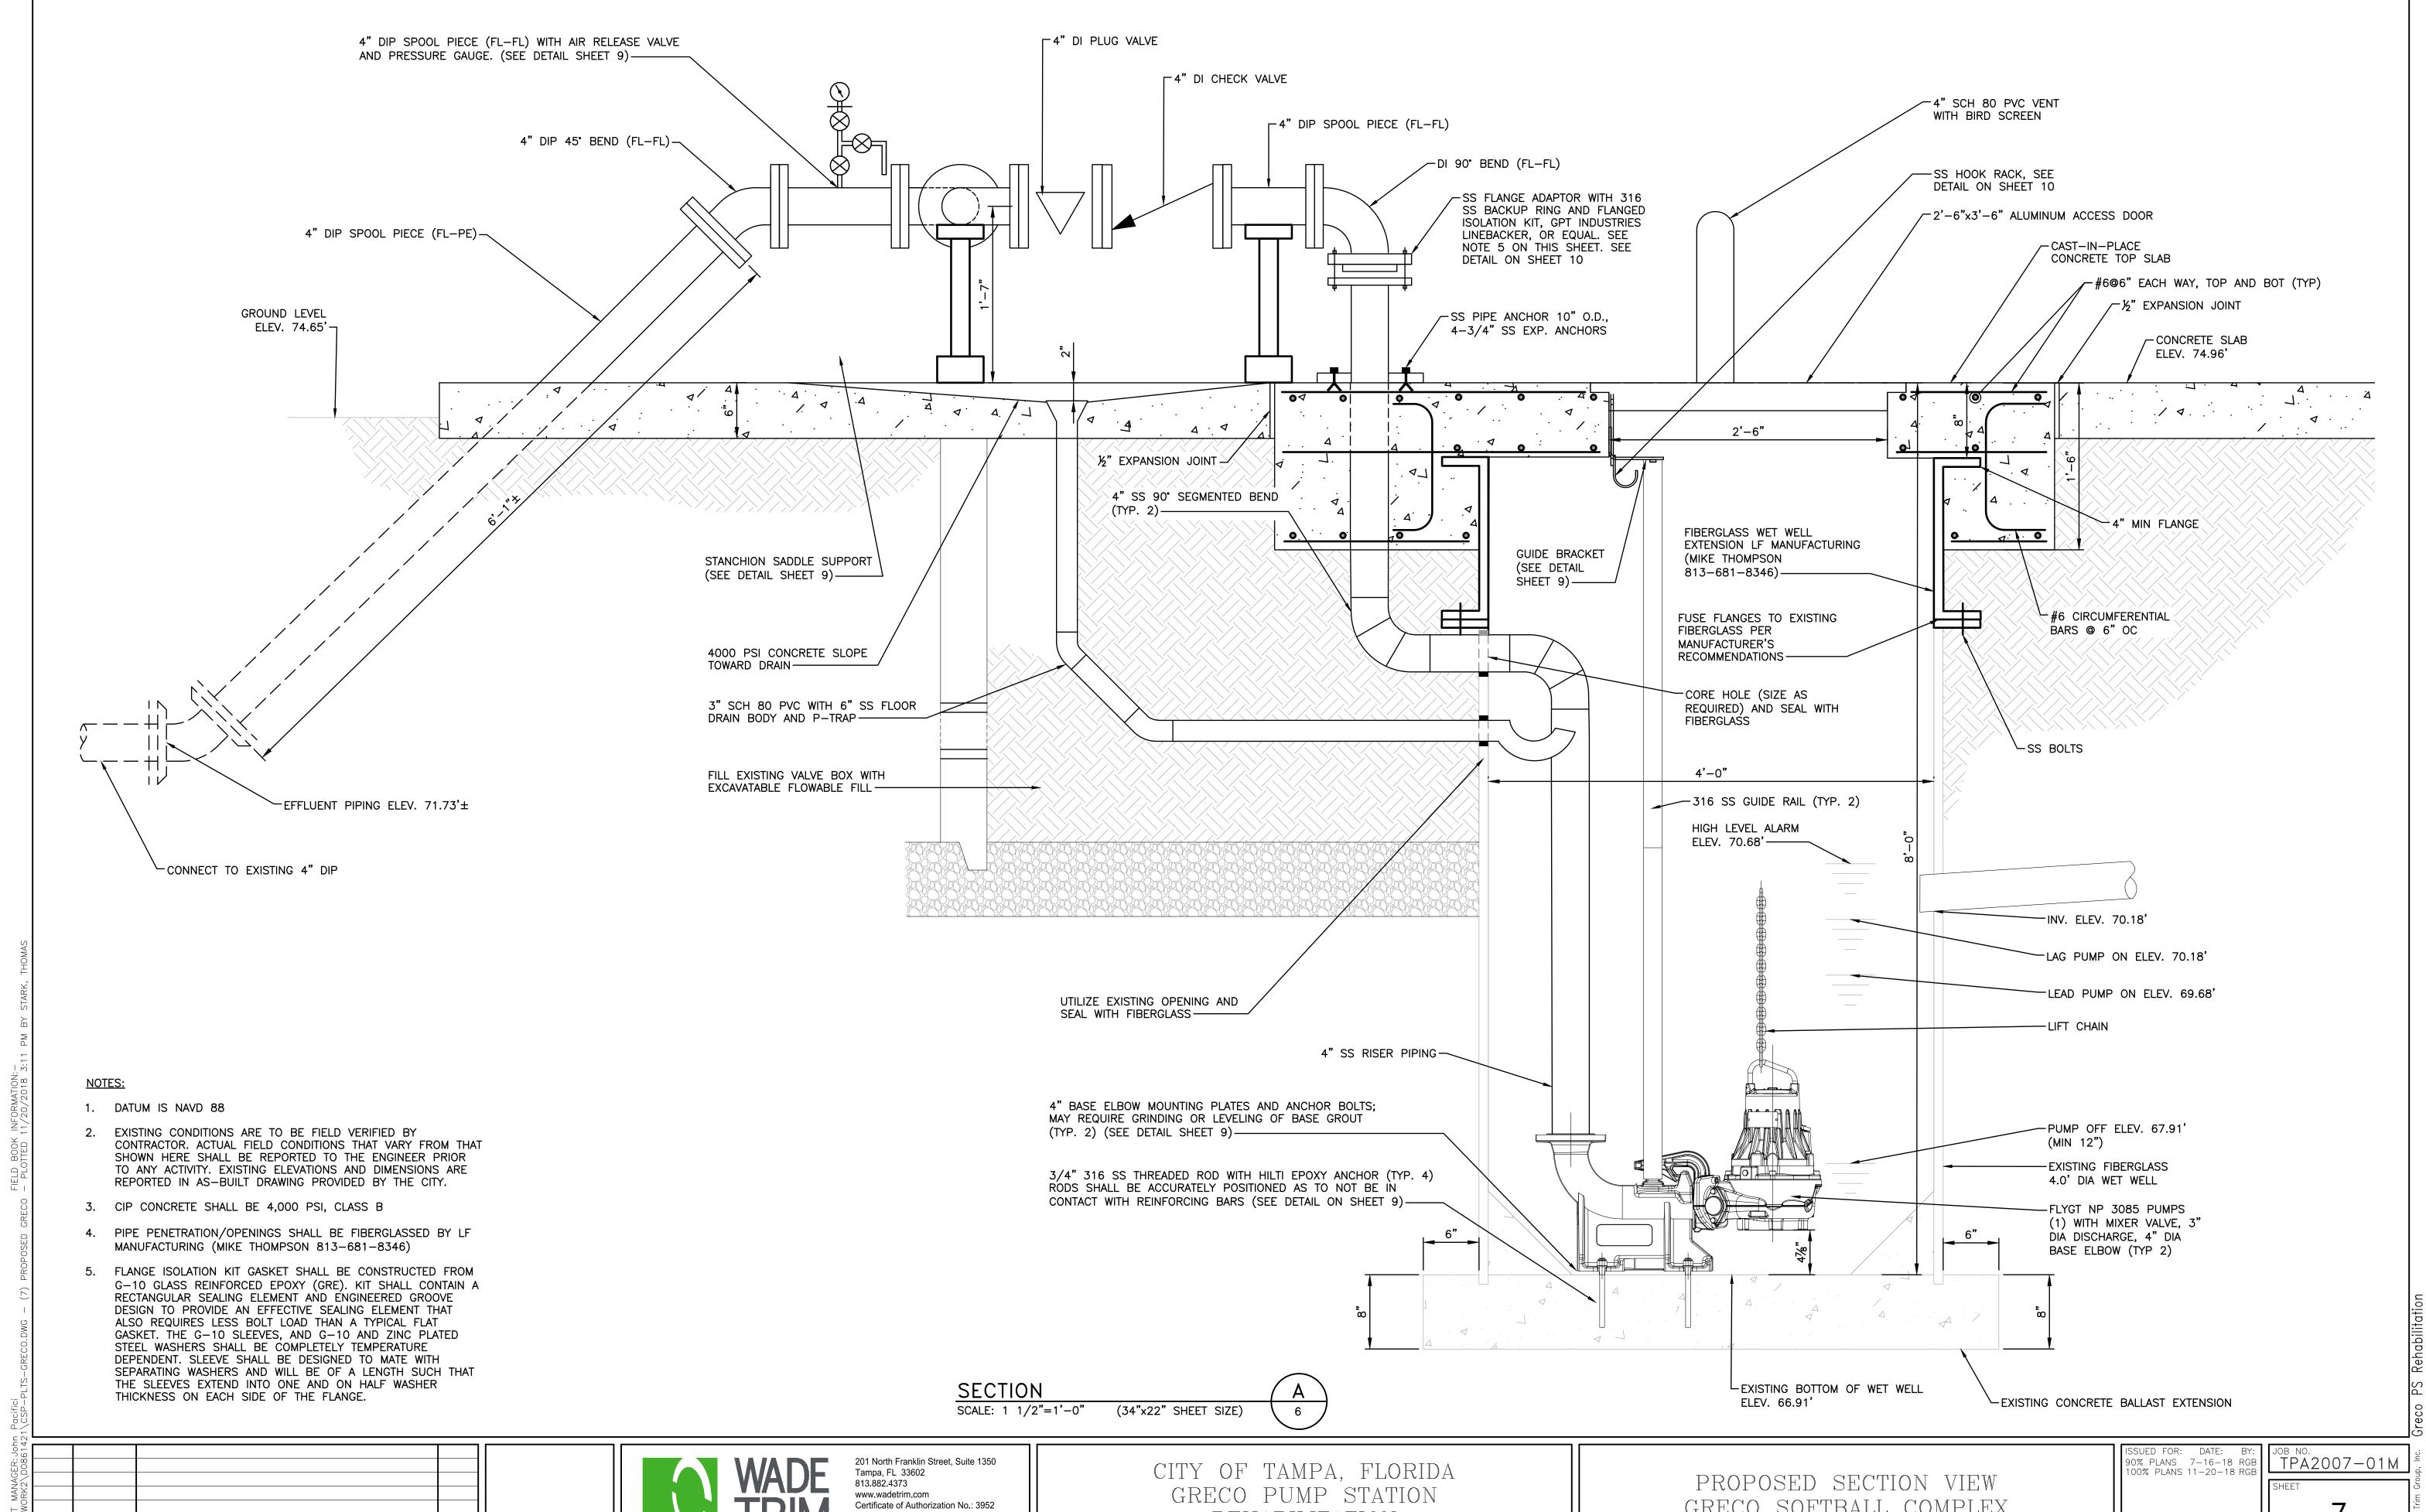


REHABILITATION

RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 6710


DATE

DESCRIPTION

GRECO SOFTBALL COMPLEX

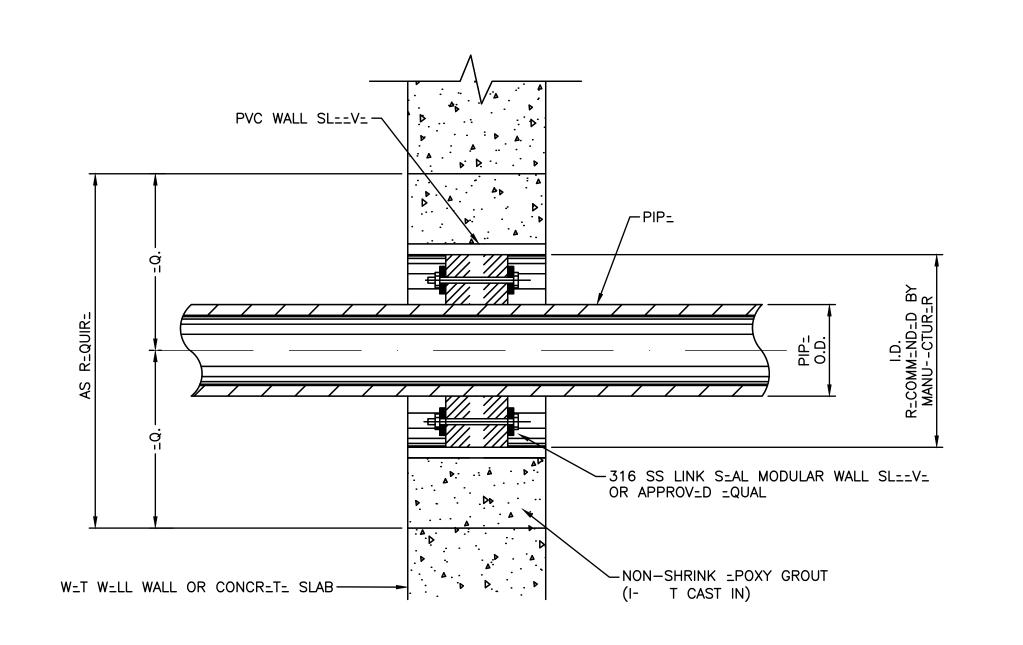


LINK SF-L DFTAIL
N.T.S.

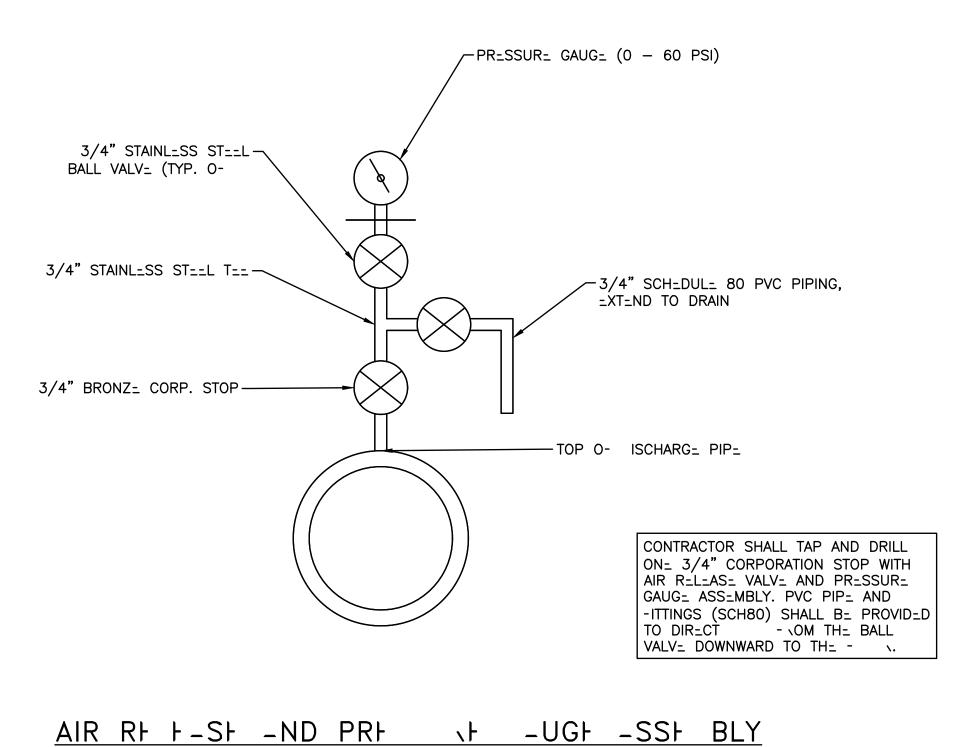


FLYGT NP 3085 MT 3~ Adaptive 463 Performance curve Discharge Flange Diameter 3 1/8 inch Suction Flange Diameter 80 mm Impeller diameter 5<sup>5</sup>/<sub>16</sub>" Stator var Number of blades 2 Frequency Power factor 1/1 Load 0.83 N3085.060 15-10-4AL-W 3hp Stator variant Frequency Rated voltage Number of poles 12 60 Hz 230 V 4 3/4 Load 0.77 1/2 Load 0.66 Motor efficiency 1/1 Load 78.1 % 3/4 Load 79.1 % 1/2 Load 77.4 % Phases Rated power Rated current 3 hp 8.7 A 44 A Starting current Rated speed 1700 rpm Pump Efficiency
Overall Efficiency -463 135mm -463 135mm [hp] Pow er input P1 <del>46</del>3 135mm (P1) 2.0 Shaft power P2 ΦρΩ NPSH-values 450 [US g.p.m.]

PUMP CURVE


REV# DATE DESCRIPTION BY






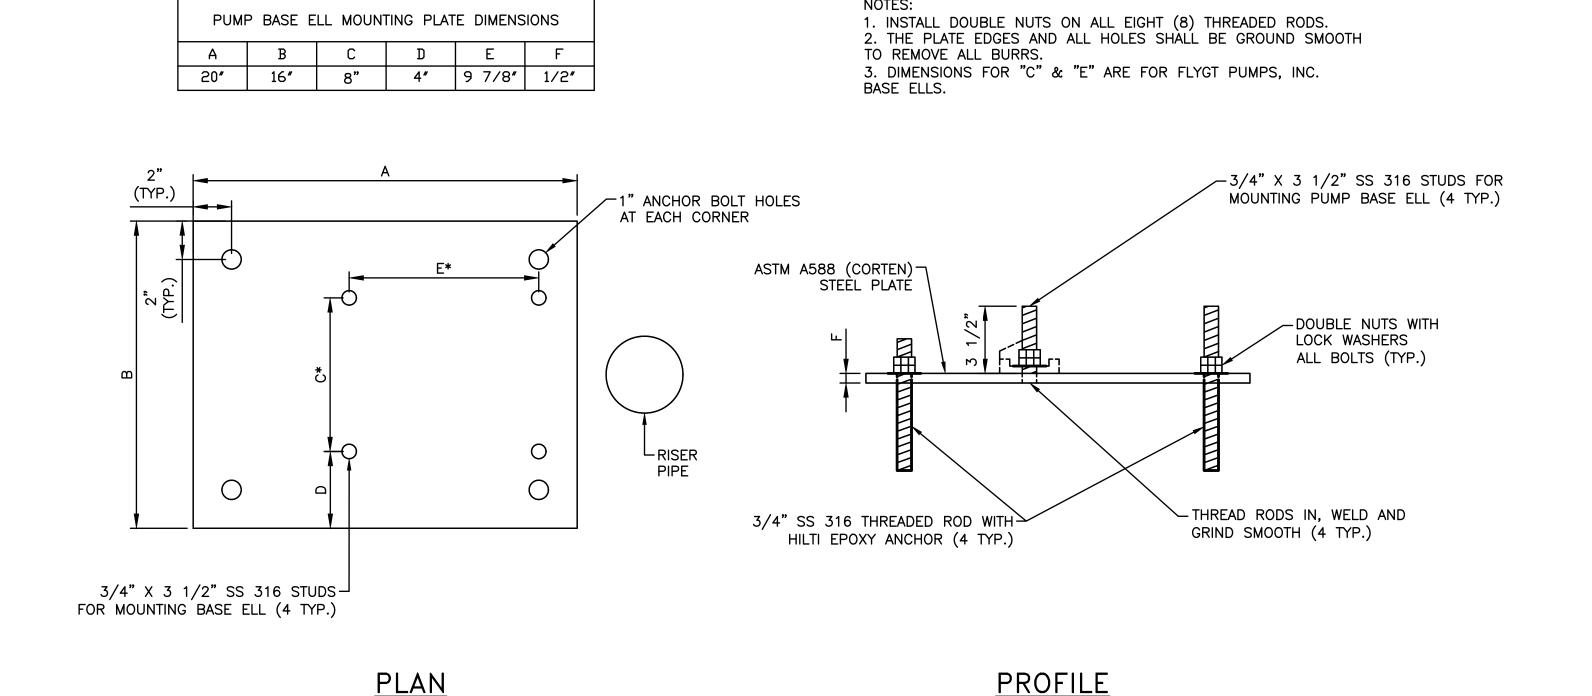

# PUMP BASE ELL MOUNTING PLATE DETAIL

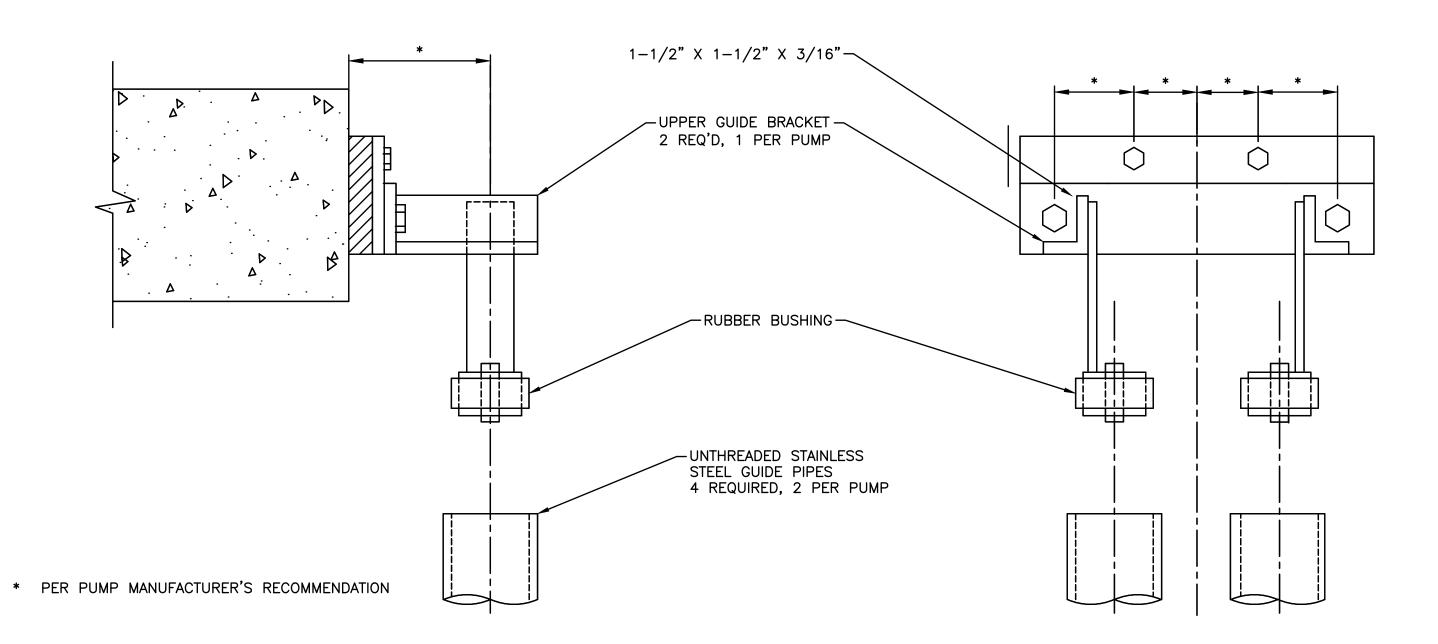


GUIDE BRACKET DETAIL (SUPPLIED WITH PUMPS)

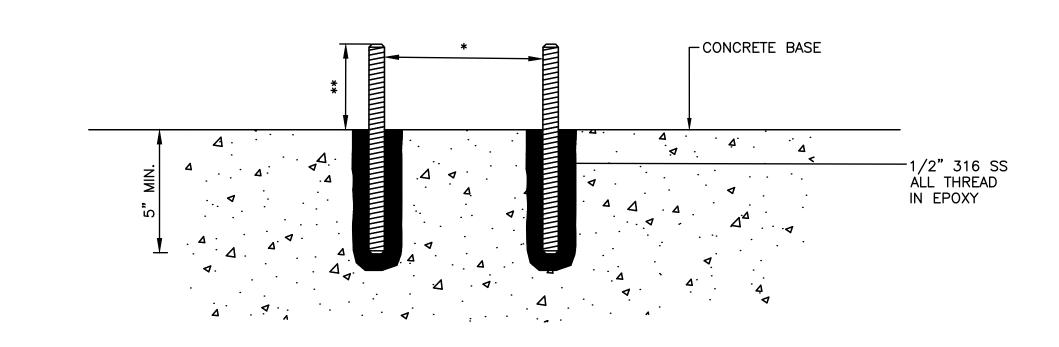

- \* ALIGNMENT OF ANCHOR BOLTS SHALL BE AS RECOMMENDED BY PUMP MANUFACTURER.
- \*\* CONTRACTOR SHALL PROVIDE A MINIMUM 1/2 INCH BOLT PROTRUSION ABOVE THE FINAL NUT LOCATION AFTER THE NUT IS TIGHTENED TO MANUFACTURE'S RECOMMENDATION.

#### ANCHOR BOLT DETAIL N.T.S.

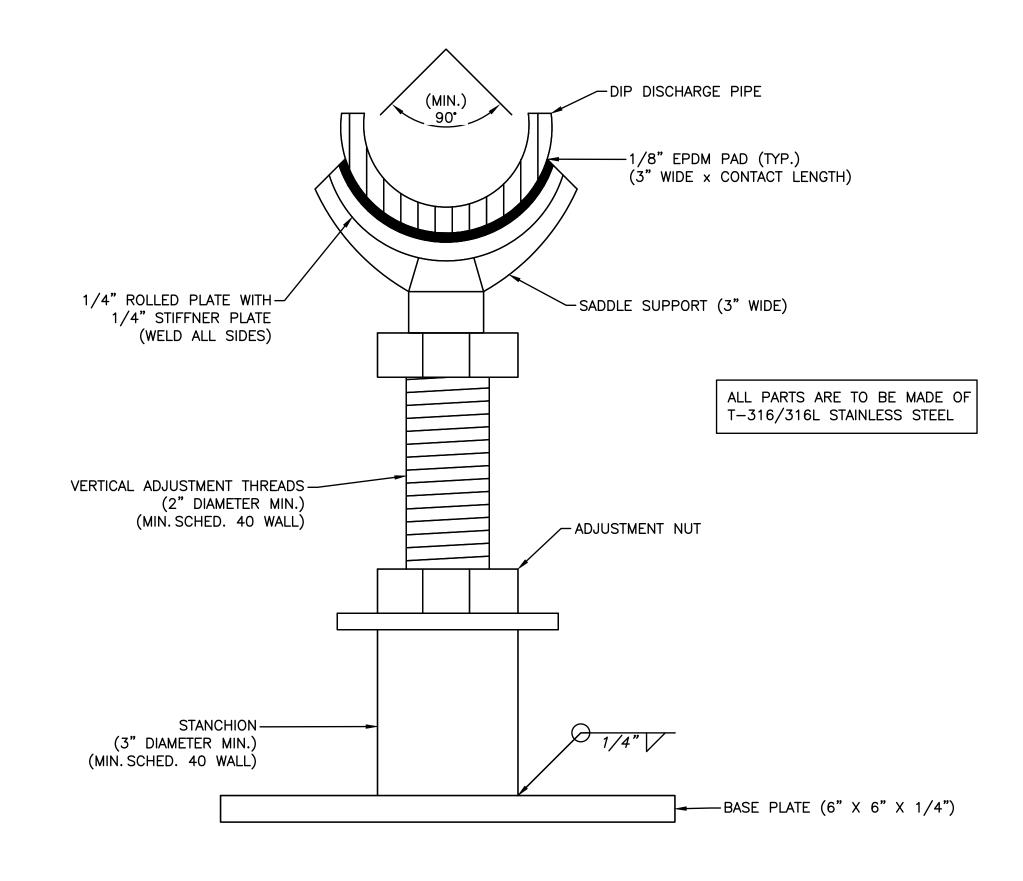

# SECTION VIEW - STAINLESS STEEL STANCHION SADDLE SUPPORT

DESCRIPTION


RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 6710

201 North Franklin Street, Suite 1350 Tampa, FL 33602 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION


DETAIL SHEET (2 OF 3)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB JOB NO. TPA2007-01M

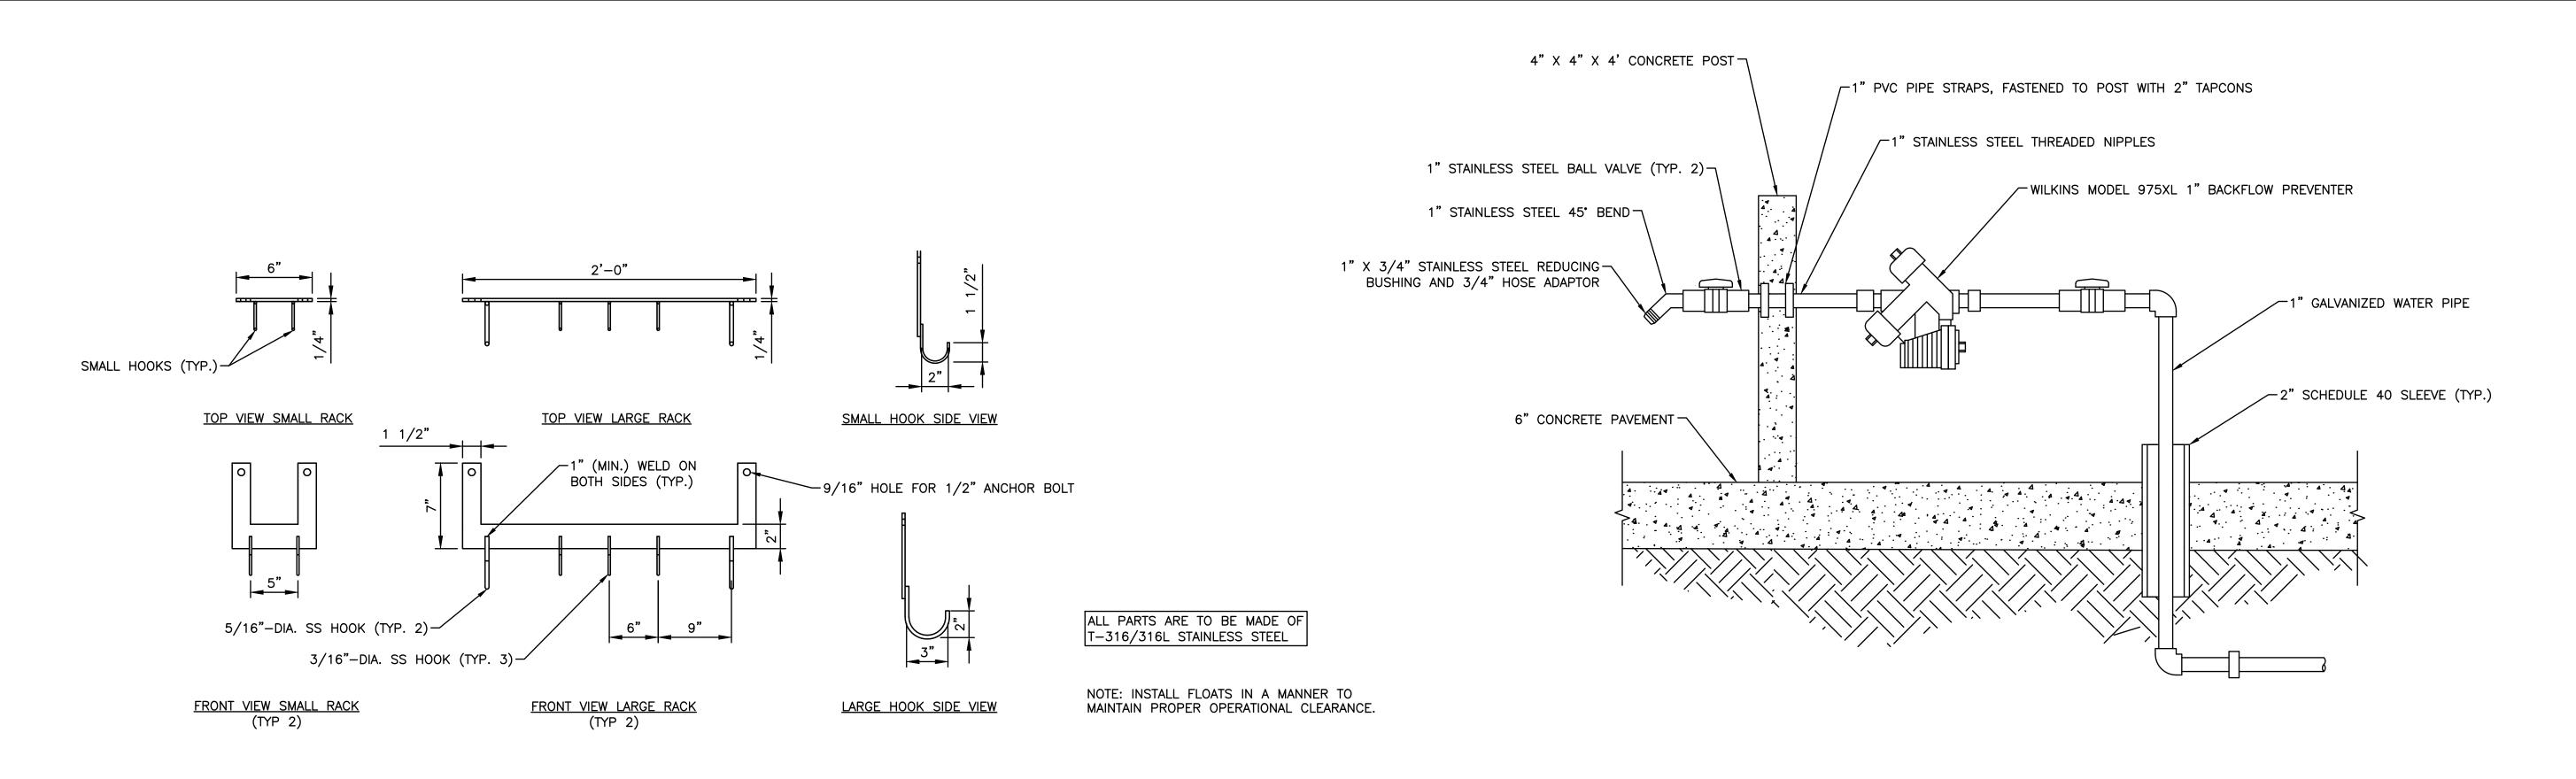


PROPOSED STAINLESS STEEL HOOK RACKS



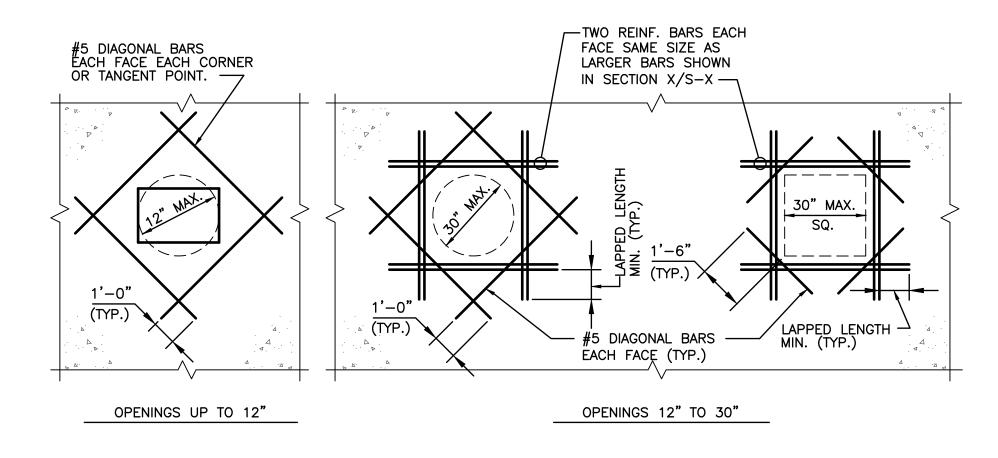

REINFORCEMENT DETAILS FOR SMALL OPENINGS

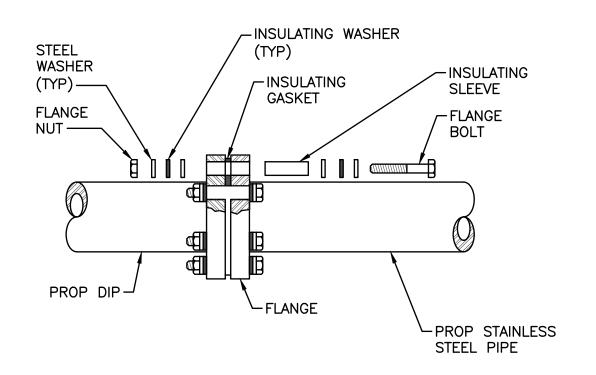

 $\underset{\text{N.T.S.}}{\underline{\mathsf{INSULATING}}} \;\; \underset{\text{N.T.S.}}{\underline{\mathsf{FLANGE}}}$ 

REV# DATE DESCRIPTION BY

RICARDO G BORROMEO, P.E. FLORIDA LICENSE NO. 67101 WADE TRIM


201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION

DETAIL SHEET (3 OF 3)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB SHEET

10

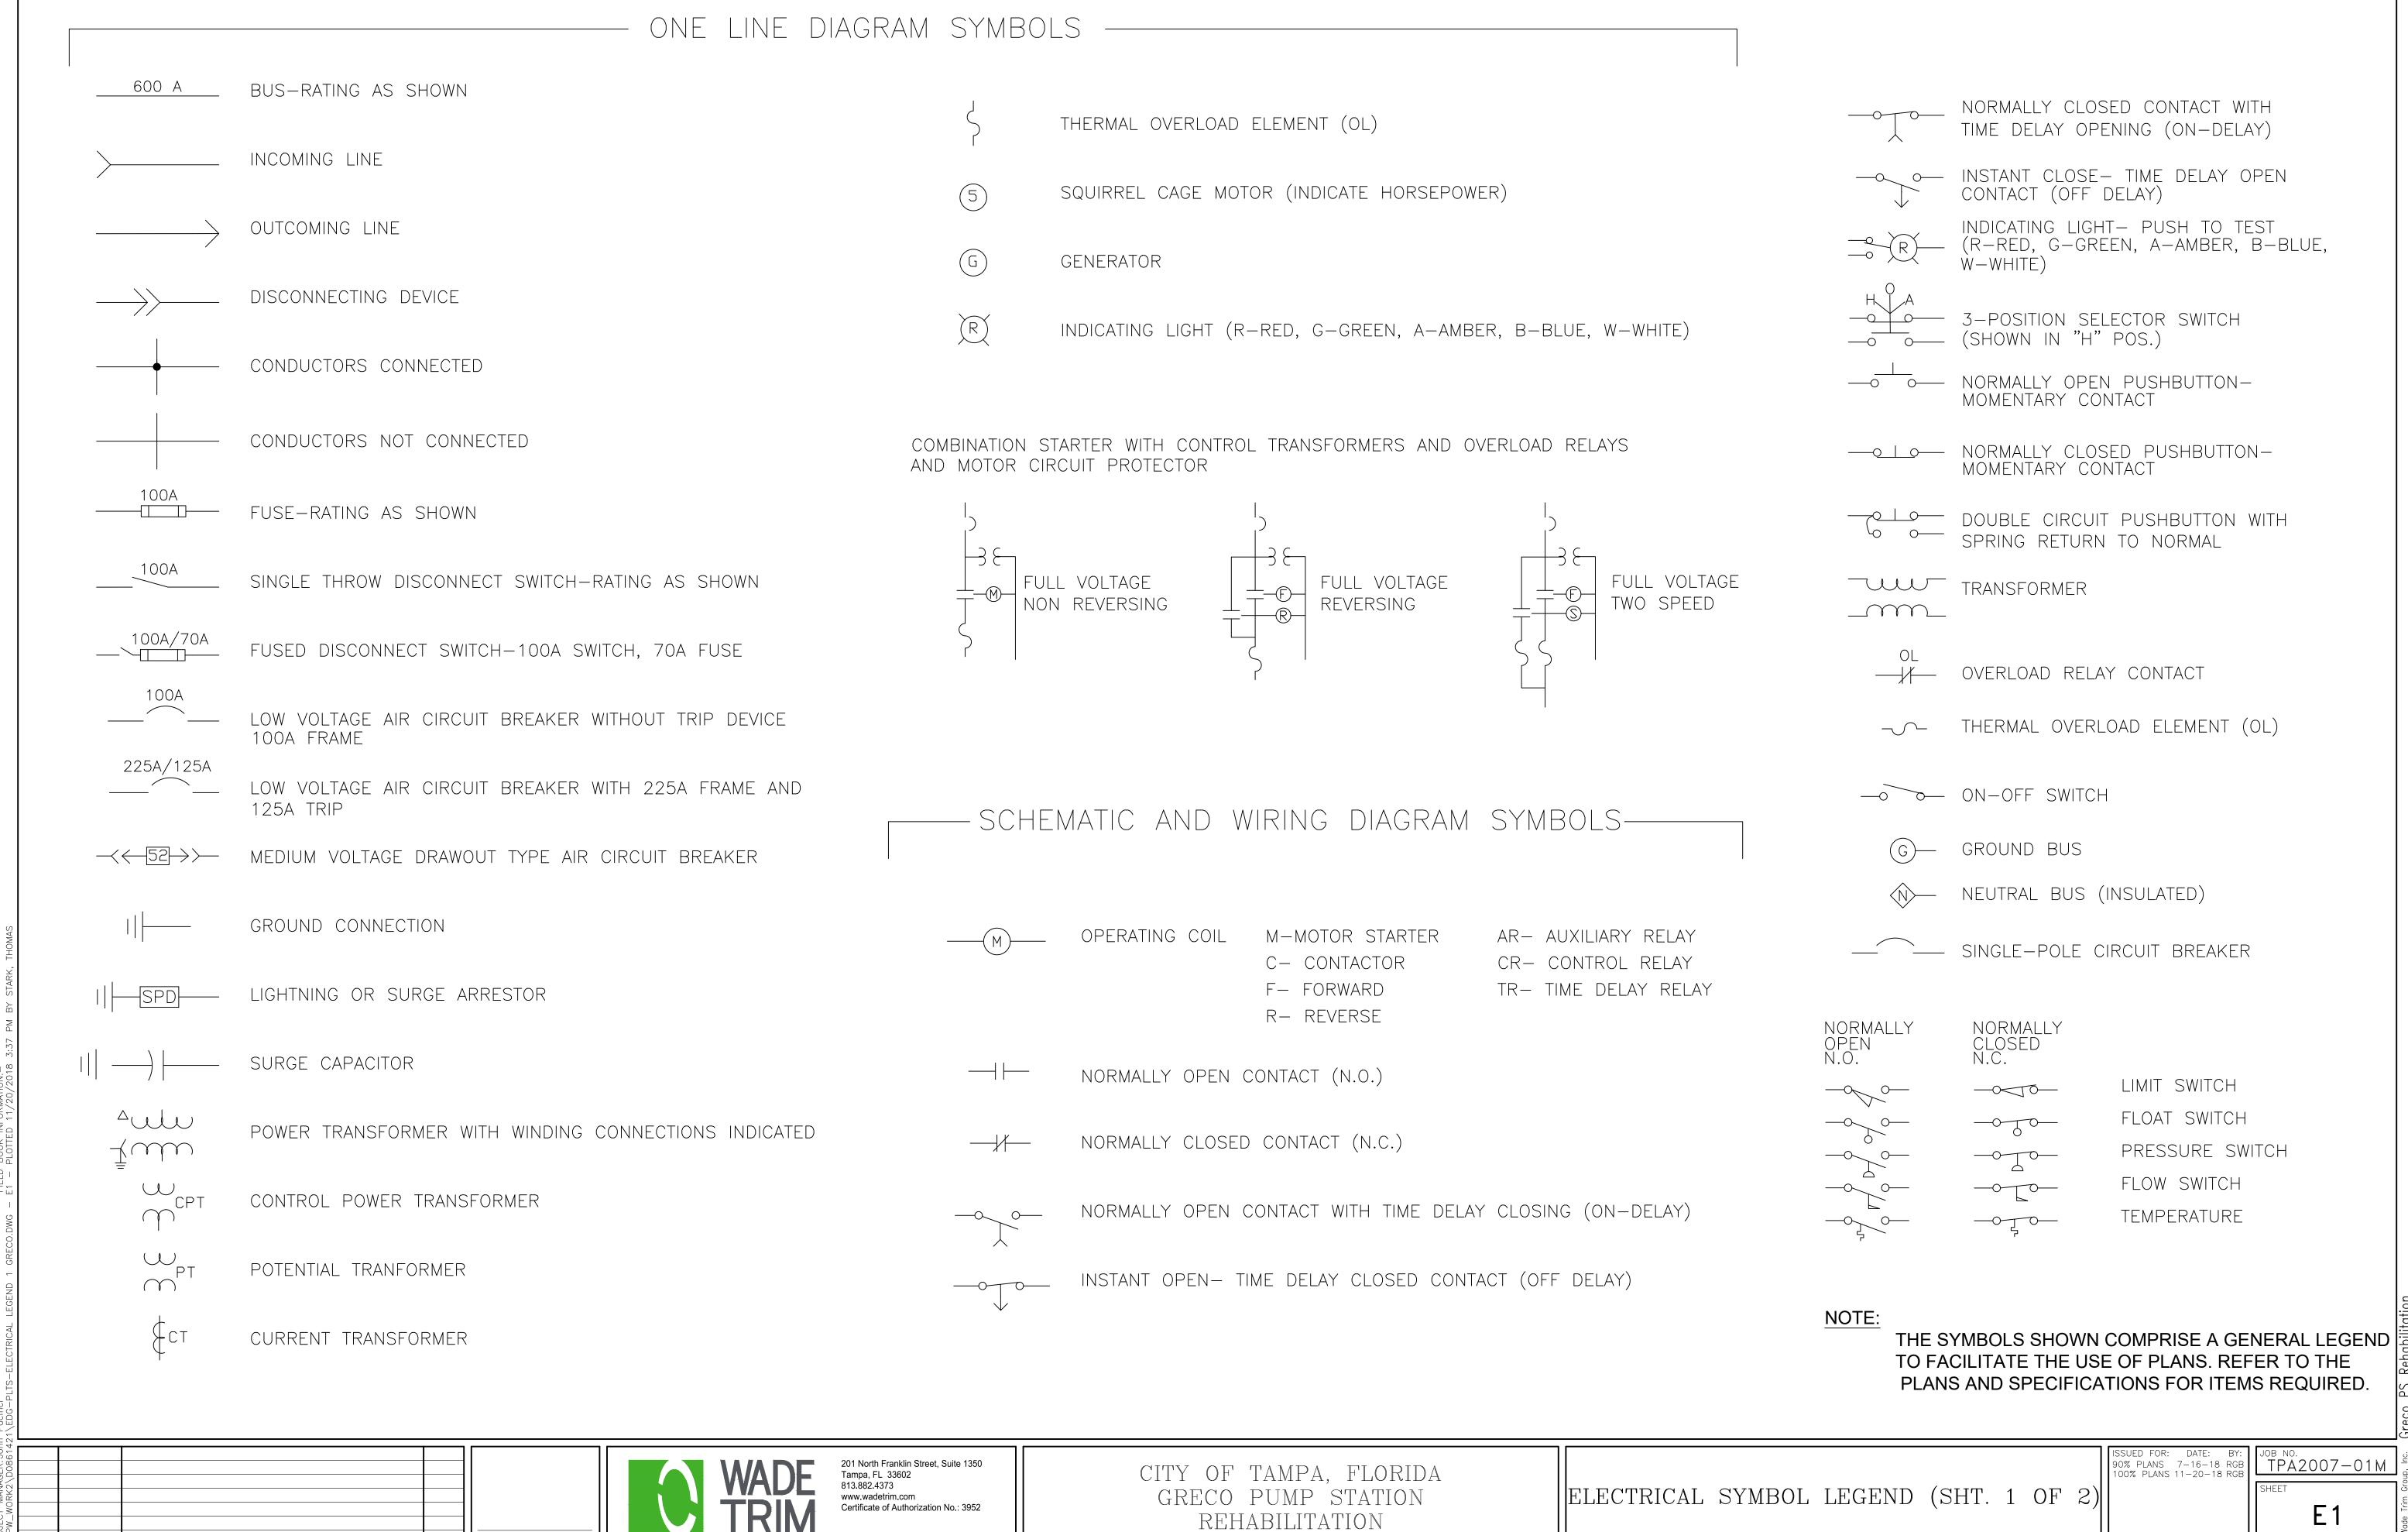

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613

DATE

DESCRIPTION

# POWER AND LIGHTING SYMBOLS

			ON-OFF SWITCH WITH LOCK ATTACHMENT ON OFF POSITION	THE SYM TO FACIL	BOLS SHOWN COMPRISE A GENERAL LEGEND ITATE THE USE OF PLANS. REFER TO THE ND SPECIFICATIONS FOR ITEMS REQUIRED.
	EMERGENCY FLUORESCENT FIXTURE		SELECTOR SWITCH ("HOA" INDICATES HAND, OFF, AND AUTO; "MOR" INDICATES MANUAL, OFF, AND REMOTE; ETC) NOT	· <b>E</b> :	
	FLUORESCENT FIXTURE	RESUME STOP/L	PUSH/PULL BUTTON WITH STOP LOCK. (PULL TO RESUME— PUSH TO STOP) -	PROP.	DESIGNATES PROPOSED EQUIPMENT
	EMERGENCY INCANDESCENT OR MERCURY VAPOR LIGHTING FIXTURE	• • • S/L	INDICATING LIGHT AND START-STOP PUSHBUTTON WITH LOCK ATTACHMENT ON STOP	EX.	DESIGNATES EXISTING EQUIPMENT
	EXIT SIGN	ON/OF	ON-OFF MAINTAINED CONTACT PUSHBUTTON WITH LOCK ATTACHMENT	MOV	DESIGNATES MOTOR OPERATED VALVE
	WALL MOUNTED LIGHTING FIXTURE	•	START-STOP PUSHBUTTON	XP	DESIGNATES EXPLOSIONPROOF EQUIPMENT
	CEILING MOUNTED INCANDESCENT OR MERCURY VAPOR FIXTURE. "A" INDICATES FIXTURE TYPE LISTED IN SCHEDULE		GENERAL SYMBOLS	WP	DESIGNATES WATERPROOF EQUIPMENT
X	LIGHTNING ROD	ТВ	TERMINAL BOX	МН	DESIGNATES MOUNTING HEIGHT
	GROUND ROD	PB	PULL BOX	FT	FLOW TRANSMITTER
	GROUNDING CONDUCTOR	JB	JUNCTION BOX	Т	TEMPERATURE TRANSMITTER
•	CONDUIT-DOWN (OR AWAY FROM VIEWER)	J	OUTLET BOX WITH BLANK COVER	LC	LEVEL TRANSMITTER (FLOAT TYPE)
	CONDUIT-UP (OR TOWARDS VIEWER)	<del></del>	THREE WAY SWITCH	L	LEVEL TRANSMITTER (PRESSURE ANALOG TYPE)
	FLEXIBLE LIQUIDTIGHT CONDUIT	<del></del>	TWO POLE SWITCH	F	FLOAT SWITCH
PNL-1 1,3,5	HOMERUN TO LIGHTING PANELBOARD (PNL-1 INDICATES PANELBOARD AND 1, 3, 5 INDICATES 20A-1P CKTS. 1, 3 AND 5)	<del>()-</del>	SINGLE POLE SWITCH	T	TEMPERATURE SWITCH
	CONDUIT WITH HOT, NEUTRAL AND GROUND WIRES (LONG LINE IS NEUTRAL; LONG LINE WITH DOTS DENOTE GROUND)	60 A	3 POLE, 4 WIRE, 240V WELDING OUTLET (60 A)	S	SOLENOID OPERATED VALVE
	CONDUIT RUN CONCEALED IN WALLS, ABOVE SUSPENDED CEILING, OR IN ROOF SLAB		SINGLE RECEPTACLE — 2 POLE, 3 WIRE, 240V, RATING NOTED	P	PRESSURE SWITCH
	CONDUIT RUN CONCEALED IN FLOOR OR UNDERGROUND	4	DUPLEX RECEPTACLE— 20 A, 120 V, 3 WIRE (TO PNL— CIRCUIT No.4)	LS	LIMIT SWITCH
	EXPOSED CONDUIT RUN		POLE MOUNTED LIGHTING FIXTURE	(FL)	FLOW SWITCH

DESCRIPTION

201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION

| ELECTRICAL SYMBOL LEGEND (SHT. 2 OF 2)

| ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB | TPA2007-01M


- 3. ALL WIRING SHALL BE IDENTIFIED W/NUMBERS AT ALL TERMINALS AND ON WIRING DIAGRAMS.
- 4. VERIFY ALL MECHANICAL EQUIPMENT SIZES AND RATING PRIOR TO CONNECTING.
- 5. FIELD VERIFY ALL EQUIPMENT LOCATIONS AND CONNECTIONS PRIOR TO COMMENCING CONSTRUCTION.
- 6. PLANS ARE DESIGNED IN ACCORDANCE WITH THE 6TH EDITION 2017 OF THE FLORIDA BUILDING CODE AND THE 2014 EDITION OF THE NATIONAL ELECTRICAL CODE. CONTRACTOR SHALL ENSURE THAT ALL ELECTRICAL WORK PERFORMED SHALL ADHERE TO THE SAME ACCORDANCE AND ALL APPLICABLE LOCAL ORDINANCES.
- 7. ALL THREADED CONNECTIONS SHALL BE COATED W/ ALUMA—SHIELD ANTI—SIEZE COMPOUND MANUFACTURED BY THOMAS & BETTS (T & B) OR EQUAL.
- 8. ALL PANELS, DISCONNECTS, SWITCHES, AND EQUIPMENT COVERPLATES SHALL BE LABELED W/
  NAMEPLATES. NAMEPLATES SHALL BE THREE—PLY PHENOLIC BLACK—WHITE—BLACK ENGRAVED
  THROUGH THE FIRST BLACK LAYER. LETTERING SHALL BE 0.5 CM (3/16") MIN. EDGE OF
  NAMEPLATE SHALL BE BEVELED 45 DEG.
- 9. ALL CONDUIT SHALL BE SUPPORTED AT MAXIMUM 5'-0" INTERVALS.
- 10. ALL CIRCUITS SHALL HAVE A PROPERLY SIZED GROUNDING CONDUCTOR ROUTED INSIDE EACH CONDUIT W/ POWER CONDUCTORS.
- 11. ALL CONDUCTOR LENGTHS SHALL BE CONTINUOUS, NO SPLICES OR CONDUCTOR TERMINATIONS SHALL BE PERMITTED UNLESS SPECIFICALLY DESIGNED IN THE DRAWINGS.
- 12. NEATLY COIL ALL SPARE CONDUCTORS & TAPE W/ VINYL ELECTRICAL TAPE (SCOTCH 33+).
- 13. PROVIDE A MINIMUM OF 3'-6" CLEARANCE IN FRONT OF ALL ELECTRICAL EQUIPMENT IN ACCORDANCE W/ ARTICLE 110 OF THE NEC.
- 14. ALL FASTENING HARDWARE (SCREW, BOLTS NUTS ETC.) SHALL BE 316—STAINLESS STEEL. FASTENING HARDWARE CONSTRUCTED OF FERROUS MATERIAL ARE NOT ACCEPTABLE.
- 15. EXPOSED CONDUITS SHALL BE NON—COATED RIGID ALUMINUM CONDUIT, UNLESS OTHERWISE NOTED (UON), INSTALL PVC COATED RIGID ALUMINUM CONDUIT TO THE WET WELL, UNLESS OTHERWISE NOTED (UON).
- 16. DIRECT BURIED AND CONCRETE ENCASED CONDUIT SHALL BE SCHEDULE 80 PVC, UNLESS OTHERWISE NOTED. TRANSITIONS FROM ABOVE—GRADE RIGID ALUMINUM CONDUIT TO NONMETALLIC CONDUIT SHALL BE ACCOMPLISHED WITH A THREADED ADAPTER. RIGID ALUMINUM CONDUIT INSTALLED ABOVE GRADE AND EXTENDING BELOW GRADE SHALL INCLUDE THE FIRST 90° ELBOW. ALL RIGID ALUMINUM CONDUITS EXTENDING BELOW GRADE SHALL BE COATED WITH TWO COATS OF ASPHALTUM—TYPE PAINT ALONG ITS ENTIRE LENGTH BELOW GRADE AND EXTENDING 6" ABOVE GRADE OR ABOVE THE TOP OF THE FINISHED SLAB.
- 17. ABOVE GRADE INDOOR, AND NON-WASHDOWN AREAS, RIGID ALUMINUM CONDUIT CONNECTIONS TO CONTROL BOXES, ETC. SHALL BE MADE WITH ALUMINUM DOUBLE LOCKNUTS AND BUSHINGS. TURN DOWN ON THREADS TO SOLIDLY CONNECT RACEWAY TO BOX OR ENCLOSURE.
- 18. ALUMINUM WATERTIGHT HUBS (MYERS HUBS) SHALL BE USED FOR CONNECTIONS TO CONTROL BOXES, ETC. MOUNTED OUTDOORS, BELOW GRADE, OR WASHDOWN AREAS.
- 19. A 316-STAINLESS STEEL CHANNEL ERECTOR SYSTEM SHALL BE USED TO SUPPORT ALL CONDUITS, BOXES ETC. USE 316 STAINLESS STEEL MOUNTING HARDWARE.
- 20. THE CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND MAKE ADJUSTMENTS AS NECESSARY TO EXECUTE THE PROPOSED INSTALLATIONS.
- 21. ALL EXISTING INSTALLATIONS DENOTED ON THE DRAWINGS ARE FOR THE CONTRACTORS REFERENCE ONLY. ALL EXISTING INSTALLATIONS SHALL BE FIELD VERIFIED PRIOR TO SUBMITTING A BID AND PRIOR TO COMMENCING CONSTRUCTION.
- 22. PULL BOXES SHALL BE INSTALLED AS NECESSARY TO FACILITATE WIRE PULLS AND AVOID EXCESSIVE PULLING TENSION ON WIRING. IN NO CASE SHALL CONDUIT LENGTHS EXCEED 150' OR THE EQUIVALENT OF FOUR QUARTER BENDS (360 DEGREES TOTAL) WITHOUT A PULL BOX. PULL BOXES SHALL BE SIZED IN ACCORDANCE WITH ARTICLE 314 OF THE NEC.

- 23. THE WET WELL CLASSIFICATION IS CLASS 1, DIVISION 1, GROUP D, (HAZARDOUS AREA)
  NEC CHAPTER 5 IS APPLICABLE FOR INTERFACING WET WELL AND THE CONTROL
  ENCLOSURE.
- 24. ALL ELECTRICAL WORK SHALL BE PERFORMED WITHIN 2014 NEC AND CITY OF TAMPA/ HILLSBOROUGH COUNTY CODES AND SHALL BE INSPECTED BY CITY OF TAMPA/ HILLSBOROUGH COUNTY ELECTRICAL INSPECTORS AS APPLICABLE.
- 25. ALL ELECTRICAL COMPONENTS SHALL BE UL LISTED AND AS SPECIFIED, OR AS APPROVED BY THE ENGINEER. THE PANEL BUILDER SHALL BE UL-508A CERTIFIED AND A UL LABEL SHALL BE ATTACHED TO THE INSIDE OF THE ENCLOSURE. THE DOUBLE THROW DISCONNECT MUST BE LABELED "SUITABLE FOR USE AS SERVICE EQUIPMENT."
- 26. THE ENCLOSURES SHALL BE NEMA 4X, THEY SHALL BE CONSTRUCTED OF MINIMUM 14 GAUGE 304SS, THEY SHALL HAVE RAL 9003 WHITE POWDER COAT AND THE CLOSING SURFACES SHALL HAVE ROLLED LIPS, PROVIDE HINGED DOORS WITH 3—POINT LATCHED AND LOCKABLE HANDLES.
- 27. ALL COMPONENTS TO BE MOUNTED ON PANEL USING TAPPED HOLES.
- 28. ALL CONTROL WIRING SHALL BE STRANDED XHHW-2 COPPER, MINIMUM AWG #14 AND SHALL HAVE SPADE LUG TERMINATIONS.
- 29. ALARM FLOAT SWITCH WILL BE SUPPLIED BY THE CITY, BUT INSTALLED BY CONTRACTOR.
- 30. DIMENSIONS, ITEMS, OR ELEVATIONS MARKED "\*" TO BE DETERMINED AFTER EQUIPMENT SELECTION.
- 31. ALL MECHANICAL CONNECTORS SHALL BE TORQUED PER NEC, UL OR MANUFACTURES SPECIFICATIONS.
- 32. INSTALL LAMINATED SCHEMATIC, LAMINATED DATA SHEET AND LAMINATED SOFT STARTER SETUP PARAMETERS ON BACK FACE OF THE DOOR INSIDE THE ENCLOSURE.
- 33. ENSURE THAT LINE CONNECTIONS TO METER SOCKET PROVIDE CORRECT MOTOR ROTATION.
- 34. CONDUCTORS WITHIN THE ENCLOSURE AND NOT ROUTED IN WIREWAYS, SHALL BE SECURED TO THE BACK PANEL WITH MECHANICAL FASTENERS, FASTENERS SECURED WITH ADHESIVE ARE NOT ACCEPTABLE.
- 35. ALL HINGED SURFACES SHALL BE GROUNDED WITH A BONDING JUMPER SECURED TO THE ENCLOSURE OR BACKPANEL.
- 36. THE PCSR SHALL BE MOTOROLA ACE 3600 PACKAGE AS DISTRIBUTED BY DCR ENGINEERING SERVICES INC. OR REVERE CONTROL SYSTEMS. THE PUMPING STATION CONTRACTOR SHALL COORDINATE HIS EFFORTS WITH DCR, OR REVERE CONTROL SYSTEMS TO ENSURE SYSTEM COMPATIBILITY. THE CONTRACTOR SHALL PROVIDE AND INSTALL A COMPLETE DUPLEX CONTROL SYSTEM/SCADA PACKAGE, AS PROGRAMMED BY DCR OR REVERE CONTROLS THE EXISTING PUMPING STATION DCR CONTROLS SHALL REVERT TO THE CITY AS A SPARE.
- 37. A WET WELL LEVEL DETECTION SYSTEM SHALL BE PROVIDED AND INSTALLED BY THE CONTRACTOR. THE OUTPUT SHALL BE A LINEAR 4-20mA SIGNAL WITH RANGE AND CALIBRATION SUITABLE FOR THIS APPLICATION. THE SYSTEM SHALL BE OF THE ULTRASONIC TYPE-PULSAR, INC. MODEL dB10 W/ BLACKBOX 130 TRANSMITTER. CITY INSTRUMENTATION PERSONNEL WILL ASSIST THE CONTRACTOR WITH SPECIFYING THE TRANSDUCER MOUNTING LOCATION AND CALIBRATION. THE dB10 TRANSDUCER SHALL BE MOUNTED USING A 2 1/2" x 1/4" S.S. BRACKET, SEE dB10 MOUNTING BRACKET DETAIL, SHEET E18.
- 38. PROVIDE 1/4" MINIMUM THICKNESS LEXAN SHIELDS OVER POWER DISTRIBUTION BLOCK AND OTHER EXPOSED CABLE TERMINATIONS.
- 39. XHHW-2 CONDUCTORS (3-#10 AWG + 1-#10 AWG GND. CU FOR EACH MOTOR) SHALL EXTEND FROM THE CONTROL PANEL TO ASSOCIATED HIGH VOLTAGE JUNCTION BOX. PROVIDE SEAL-OFF BETWEEN CONTROL PANEL AND JUNCTION BOX AS INDICATED. THE SHOWN SEAL-OFFS SHALL BE ALUMINUM BODY, CROUSE-HINDS, OR EQUIVALENT.
- 40. ALUMINUM CONDUIT SURFACE THAT IS A CONTACT WITH SOIL OR CONCRETE SHALL BE COATED WITH TWO COATS ASPALT VARNISH (FED. SPEC. TT-V-51) EXTENDING 4" BEYOND FINAL CONTACT POINT.
- 41. STAINLESS STEEL HANGERS TO SUPPORT THE EXCESS LENGTH OF MOTOR CABLES SHALL BE INSTALLED IN THE WET WELL. THESE HANGERS SHALL BE LOCATED IN A SEPARATE AREA FROM THE HANGERS SUPPORTING THE PUMP CHAINS.

SCOPE OF WORK:

- 1. THE CONTRACTOR SHALL COORDINATE ELECTRICAL SERVICE REQUIREMENTS WITH TAMPA ELECTRIC COMPANY (TECO). THE PROPOSED SERVICE VOLTAGE SHALL REMAIN 120/208 VAC, 3PH, 4W.
- 2. REMOVE THE EXISTING, LIGHTNING ARRESTOR, EMERGENCY CONNECTOR, CONTROL PANEL, CONCRETE PEDESTAL AND ALL ASSOCIATED CONDUIT AND CONDUCTORS. AS SHOWN ON PLANS.
- 3. CAREFULLY REMOVE THE EXISTING DCR SCADA RTU CABINET MOUNTED ON THE EXISTING SCADA ANTENNA. DELIVER THIS RTU PACKAGE TO THE CITY FOR MAINTENANCE INVENTORY.
- 4. ANY SALVAGEABLE MATERIALS, AS DETERMINED BY THE ENGINEER, SHALL BE DELIVERED, BY THE CONTRACTOR, TO THE HOWARD F. CURREN AWTP. THE CONTRACTOR SHALL PROPERLY DISPOSE OF ALL OTHER REMOVED EQUIPMENT.
- 5. PREPARE THE SITE FOR THE INSTALLATION OF THE PROPOSED CONTROL EQUIPMENT.
- 6. PROVIDE AND INSTALL A NEW DUPLEX PUMP CONTROL PANEL. THE PUMP CONTROL PANEL SHALL CONTAIN CONTROL COMPONENTS, INDICATOR LIGHTS, AND SCADA RTU, AS SHOWN ON PLANS AND DETAILED IN SPECIFICATIONS.
- 7. PROVIDE AND INSTALL A WET WELL ISOLATION JUNCTION BOX FOR PUMP MOTOR CONNECTIONS.
- 8. PROVIDE AND INSTALL A NEW DUPLEX MOTOR CONTROL PANEL. THE MOTOR CONTROL PANEL SHALL CONTAIN CIRCUIT BREAKERS AND MOTOR STARTERS, AS SHOWN ON PLANS AND DETAILED IN SPECIFICATIONS.
- 9. PROVIDE AND INSTALL WET WELL ISOLATION BOX FOR INSTRUMENTATION AND CONTROL CONNECTIONS.
- 10. PROVIDE AND INSTALL A NEMA 4X, SERVICE ENTRANCE RATED, FUSED DOUBLE THROW SWITCH. AS SHOWN ON PLANS.
- 11. PROVIDE AND INSTALL EMERGENCY POWER CONNECTOR, AS SHOWN ON PLANS.
- 12. REUSE EXISTING SCADA ANTENNA MAST, AS INDICATED.
- 13. PROVIDE AND INSTALL AREA LIGHT, AS SHOWN ON PLANS.
- 14. CALIBRATE AND ADJUST SETPOINTS FOR ALL SENSING DEVICES, ALARM DEVICES, AND TIMERS. CALIBRATION AND SETPOINTS SHALL BE PROVIDED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- 15. FURNISH AND INSTALL NEMA 4X JUNCTION BOXES, AS SHOWN ON PLANS.
- 16. PROVIDE FOR PROPER GROUNDING AS SHOWN, SPECIFIED, AND REQUIRED.
- 17. PROVIDE AND INSTALL ALL NECESSARY CONDUITS AND CONDUCTORS, AS SHOWN, SPECIFIED AND REQUIRED.
- 18. ALL ELECTRICAL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE 2014 EDITION OF THE NATIONAL ELECTRIC CODE AND CHAPTER 5 OF THE CITY OF TAMPA CODE.
- 19. REFER TO CIVIL/MECHANICAL SHEETS FOR BYPASS PUMPING REQUIREMENTS. IF ELECTRICALLY DRIVEN BYPASS PUMPS ARE UTILIZED, THE CONTRACTOR SHALL COORDINATE ALL TEMPORARY ELECTRICAL SERVICE REQUIREMENTS WITH TAMPA ELECTRIC COMPANY (TECO). ANY COSTS ASSOCIATED WITH TEMPORARY ELECTRIC POWER ARE TO BE INCLUDED IN THE LUMP SUM PRICE AND NO SEPERATE PAYMENT WILL BE MADE.



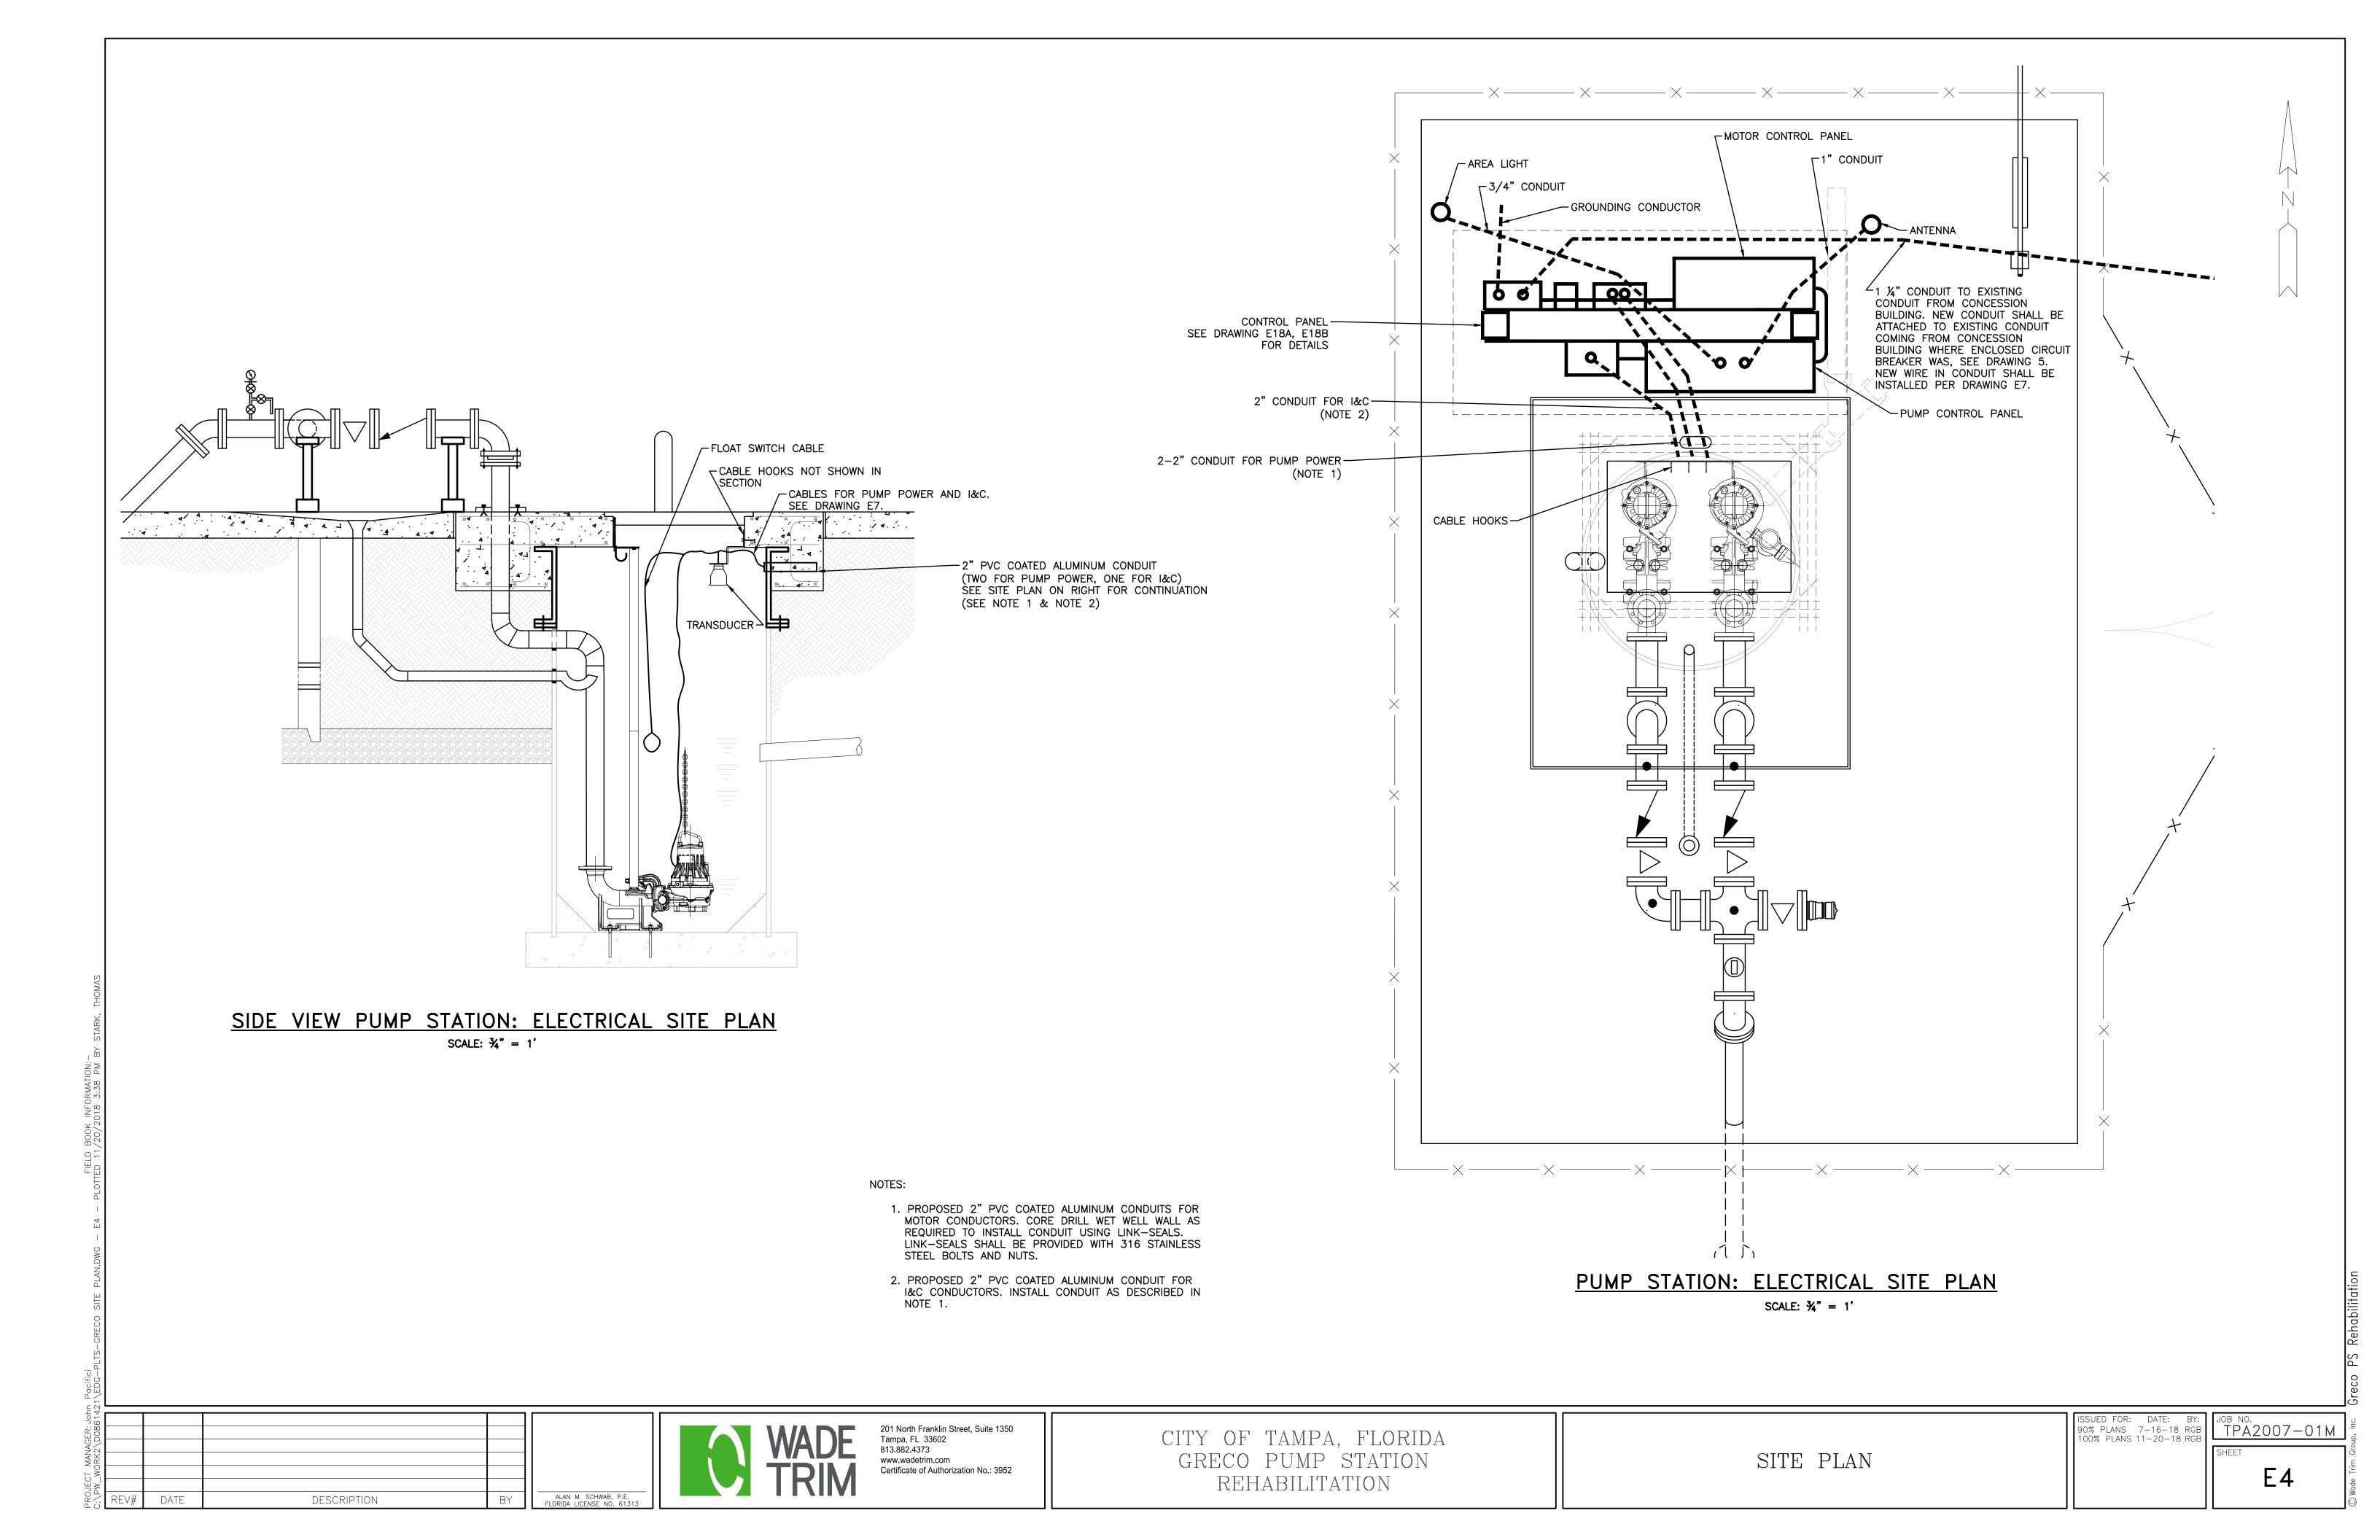


THIS SHEET HAS BEEN LEFT INTENTIONALLY BLANK. CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION BLANK SHEET

DESCRIPTION

THIS SHEET HAS BEEN LEFT INTENTIONALLY BLANK. CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION BLANK SHEET

DESCRIPTION

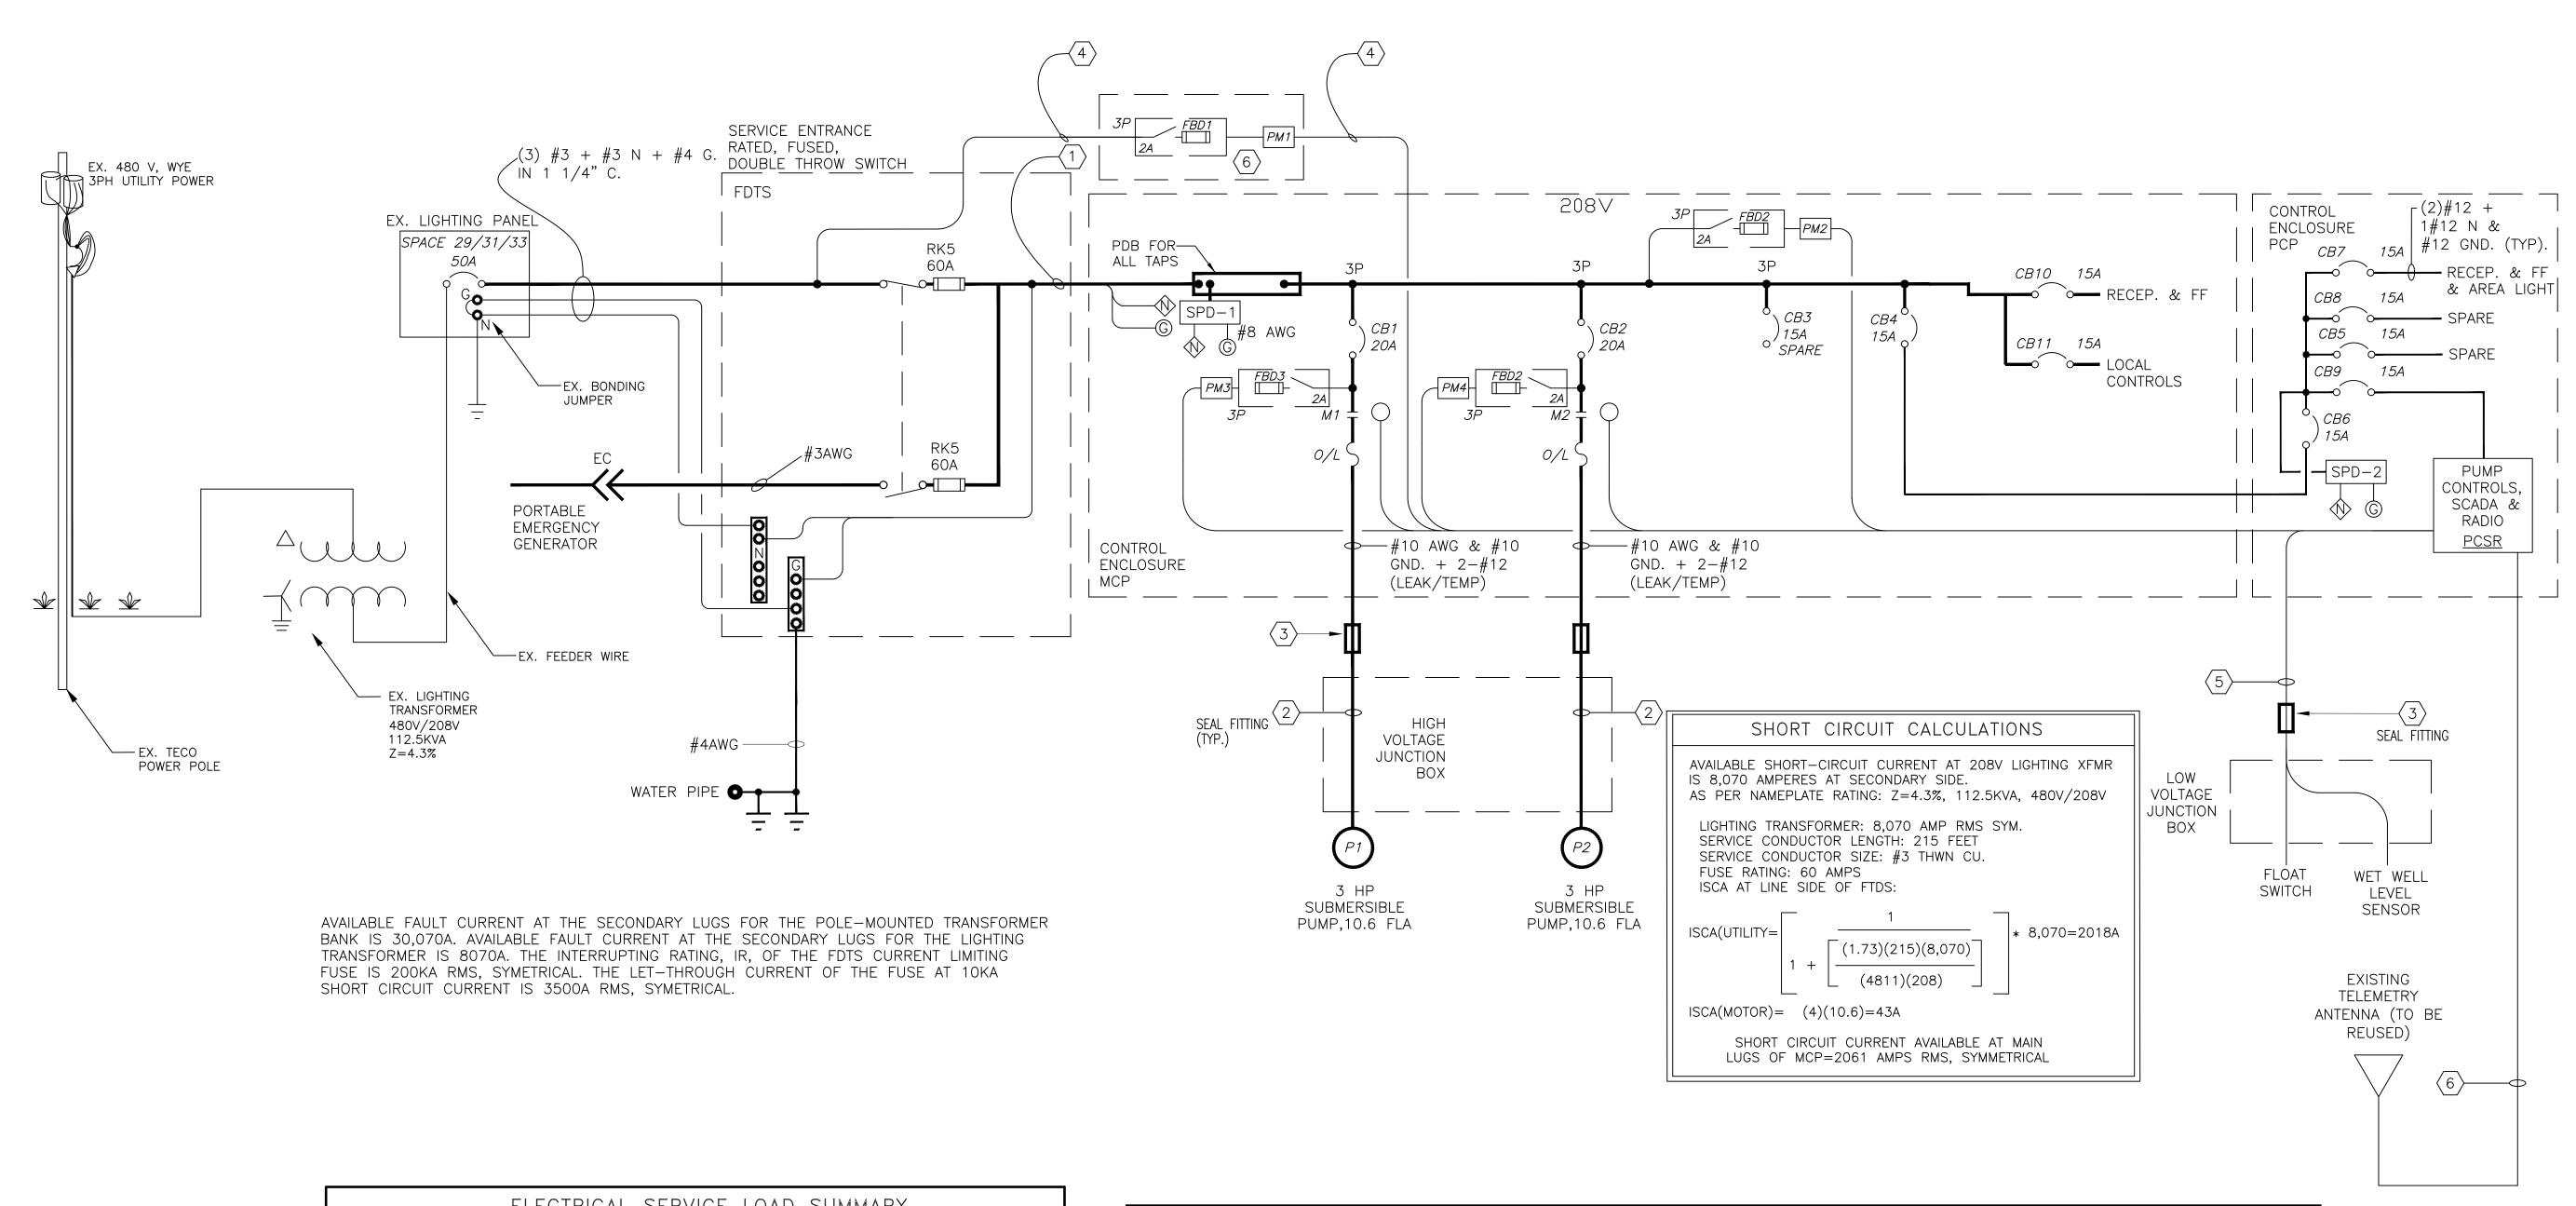

<u>El</u>	ECTRICAL S	SERVICE LOA 3 VAC, 3ø, 4		<u>1ARY</u>	
LOAD	CONNECTED	DEMAND		. PHASE CU	
PUMP #1	3.9 KVA	3.9 KVA	<u>L1</u> 10.6 A	<u>L2</u> 10.6 A	<u>L3</u> 10.6 A
PUMP #2	3.9 KVA	3.9 KVA	10.6 A	10.6 A	10.6 A
PUMP CONTROL PANEL	2.0 KVA	2.0 KVA	8.3 A	0	8.3 A
TOTAL	9.8 KVA	9.8 KVA	29.5 A	21.2 A	29.5 A

#### ONE LINE DIAGRAM NOTES:

- PROVIDE AND INSTALL 3-#3+1-#3 NEUTRAL +1-#4 GND IN 1 ¼"C. CONDUIT, REFER TO DETAILS ON SHEET E4, E18A & E18B.
- PROVIDE AND INSTALL 2"C FOR SUBMERSIBLE PUMP CABLE (PROVIDE W/ PUMP)—SEE SHEET E4, E18A & E18B
- $\left\langle \overline{3}\right\rangle$  PROVIDE SEAL FITTING, REFER TO DETAIL ON SHEET E18B.
- 4 PROVIDE AND INSTALL 3-#12 + 1-#12 GND. IN  $\frac{3}{4}$ " CONDUIT, REFER TO DETAILS ON SHEET E20.
- PROVIDE 2" CONDUIT FROM NEW PUMP CONTROL JB CABINET TO WET WELL FOR FLOAT SWITCH AND LEVEL SENSOR CABLES. REFER TO DETAILS ON SHEET E4 & E18A.
- PROVIDE 1" CONDUIT FROM NEW PUMP CONTROL CABINET TO EXISTING ANTENNA MAST FOR NEW COAX CABLE, REFER TO DETAIL ON SHEET E5 & E18.
- 7 PM1 JUNCTION BOX, SEE SHEETS E18A AND E20 FOR DETAILS.

REV# DATE DESCRIPTION BY ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 6131





201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION

GRECO SOFTBALL PUMP STATION ONE LINE DIAGRAM ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO.
TPA2007-01M
SHEET

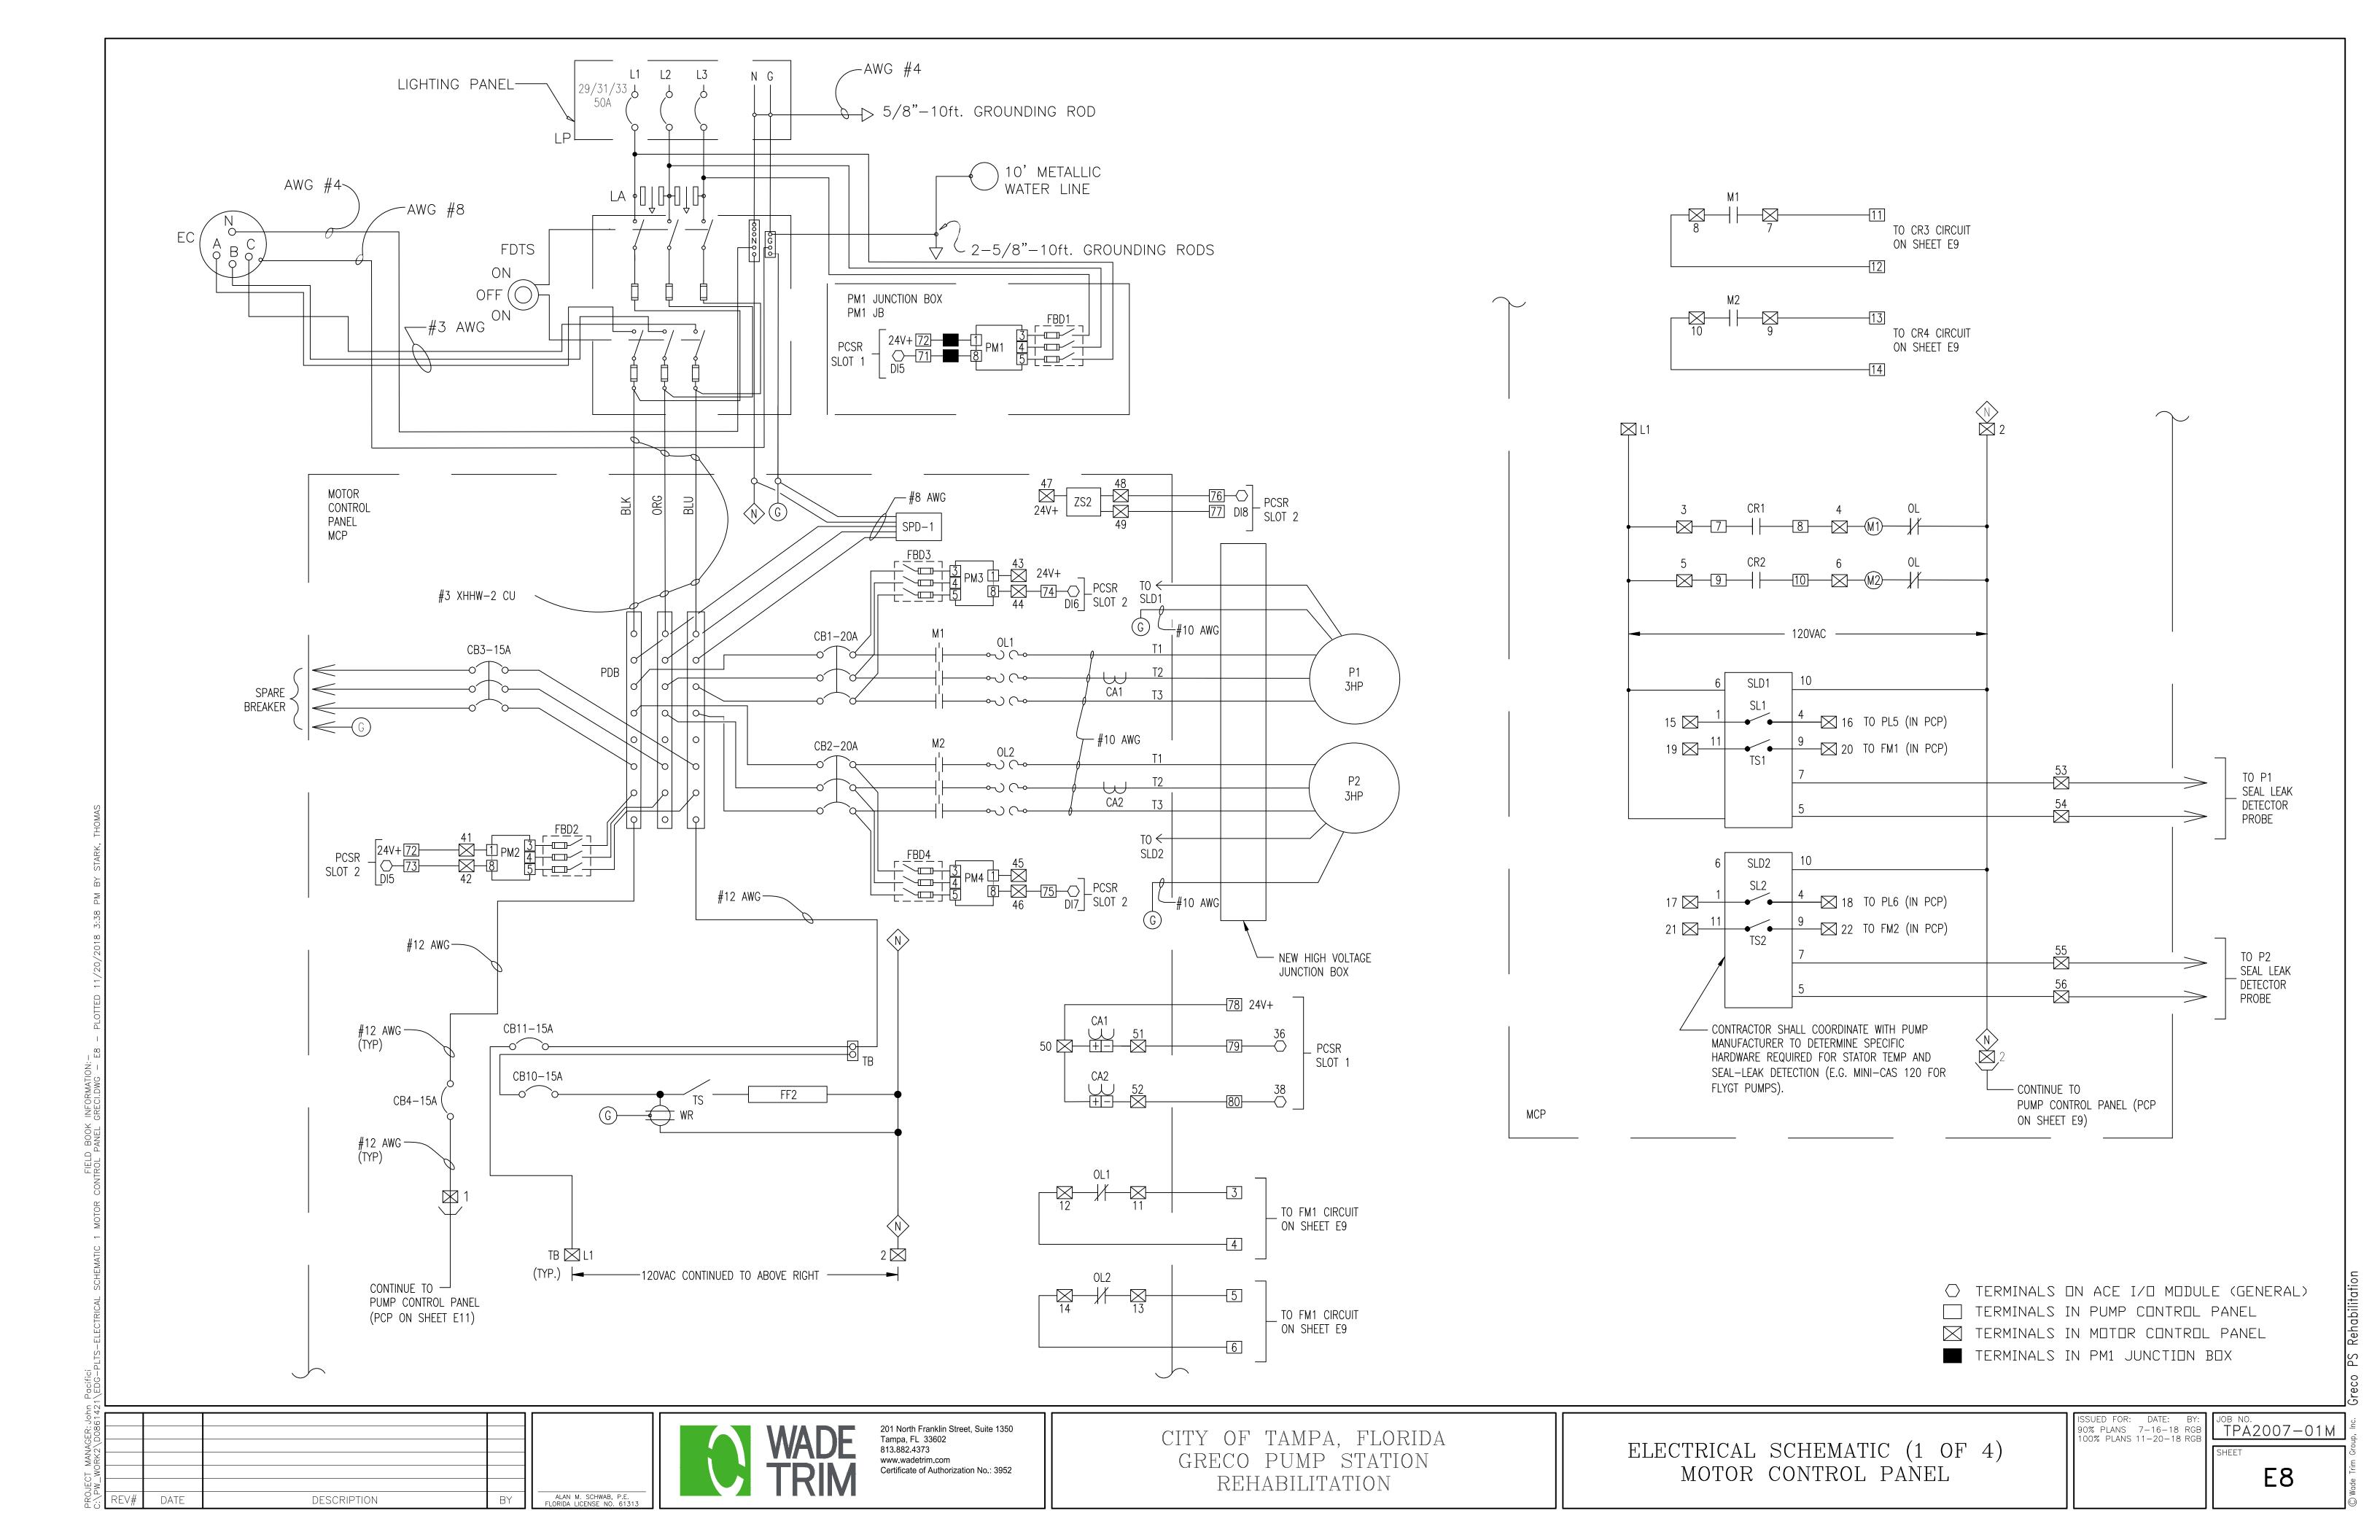

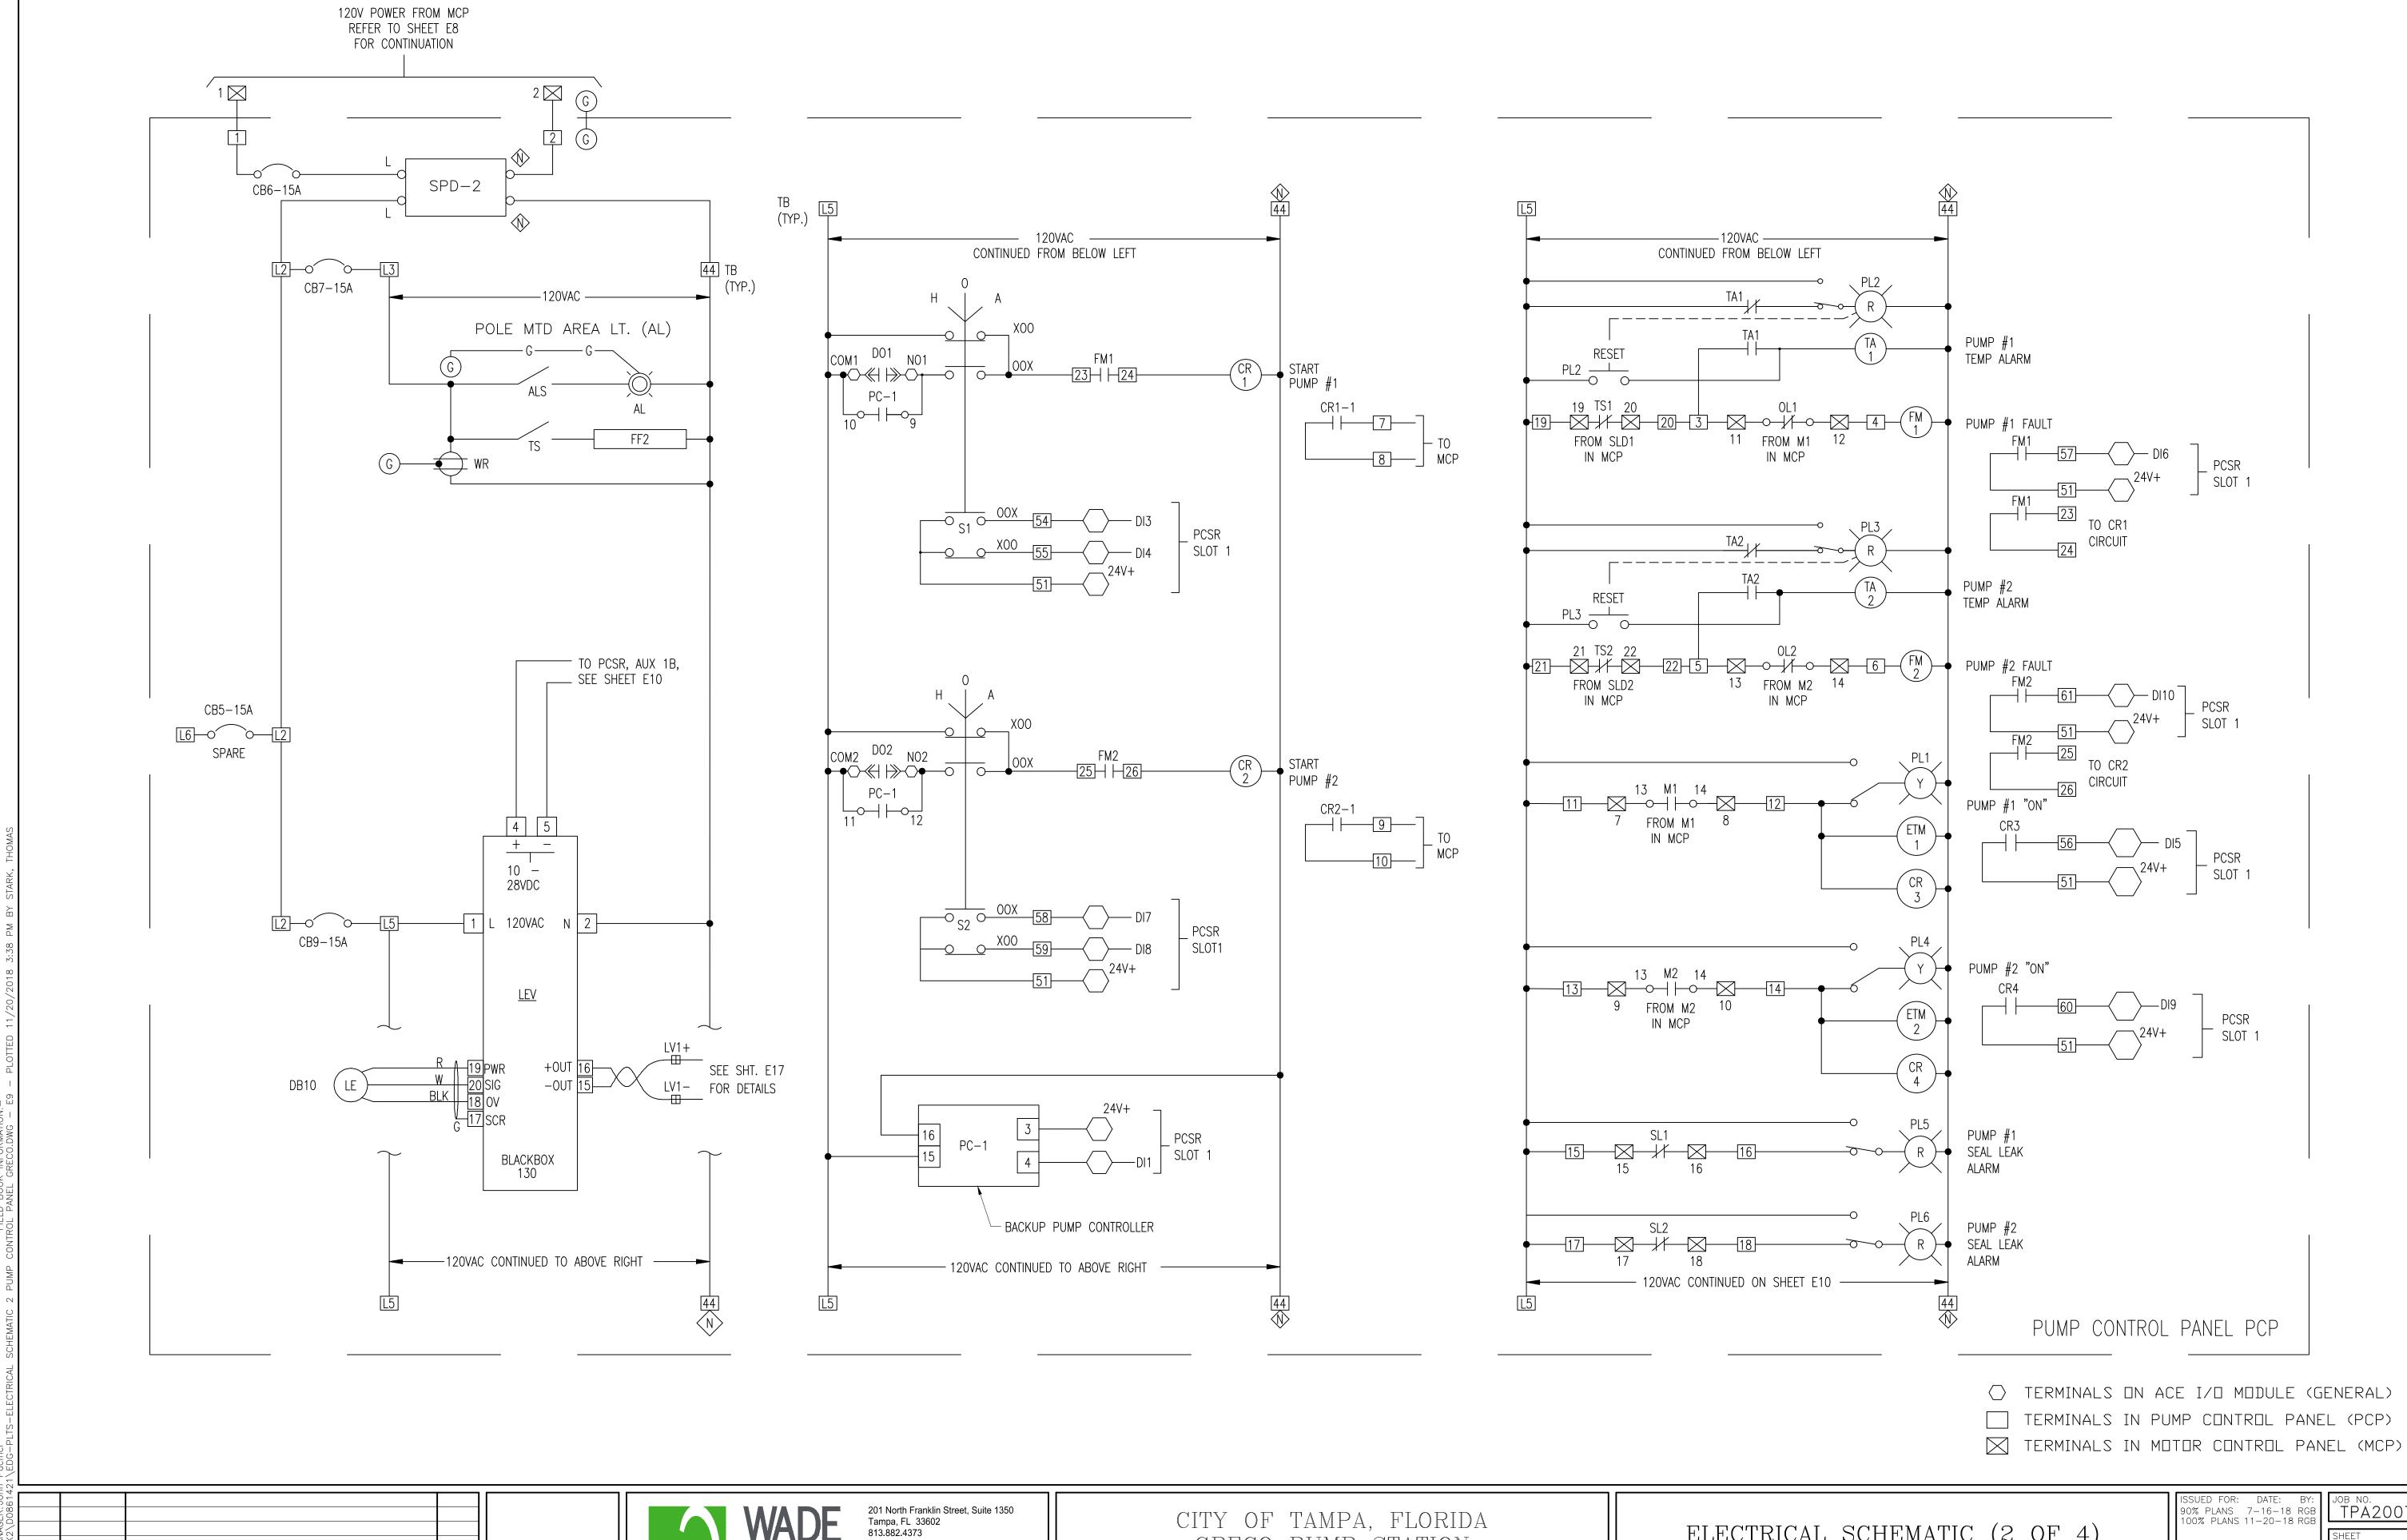

GRECO PUMP STATION

REHABILITATION


Certificate of Authorization No.: 3952

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613

DESCRIPTION

ELECTRICAL SCHEMATIC (2 OF 4) PUMP CONTROL PANEL


JOB NO. TPA2007-01M E9

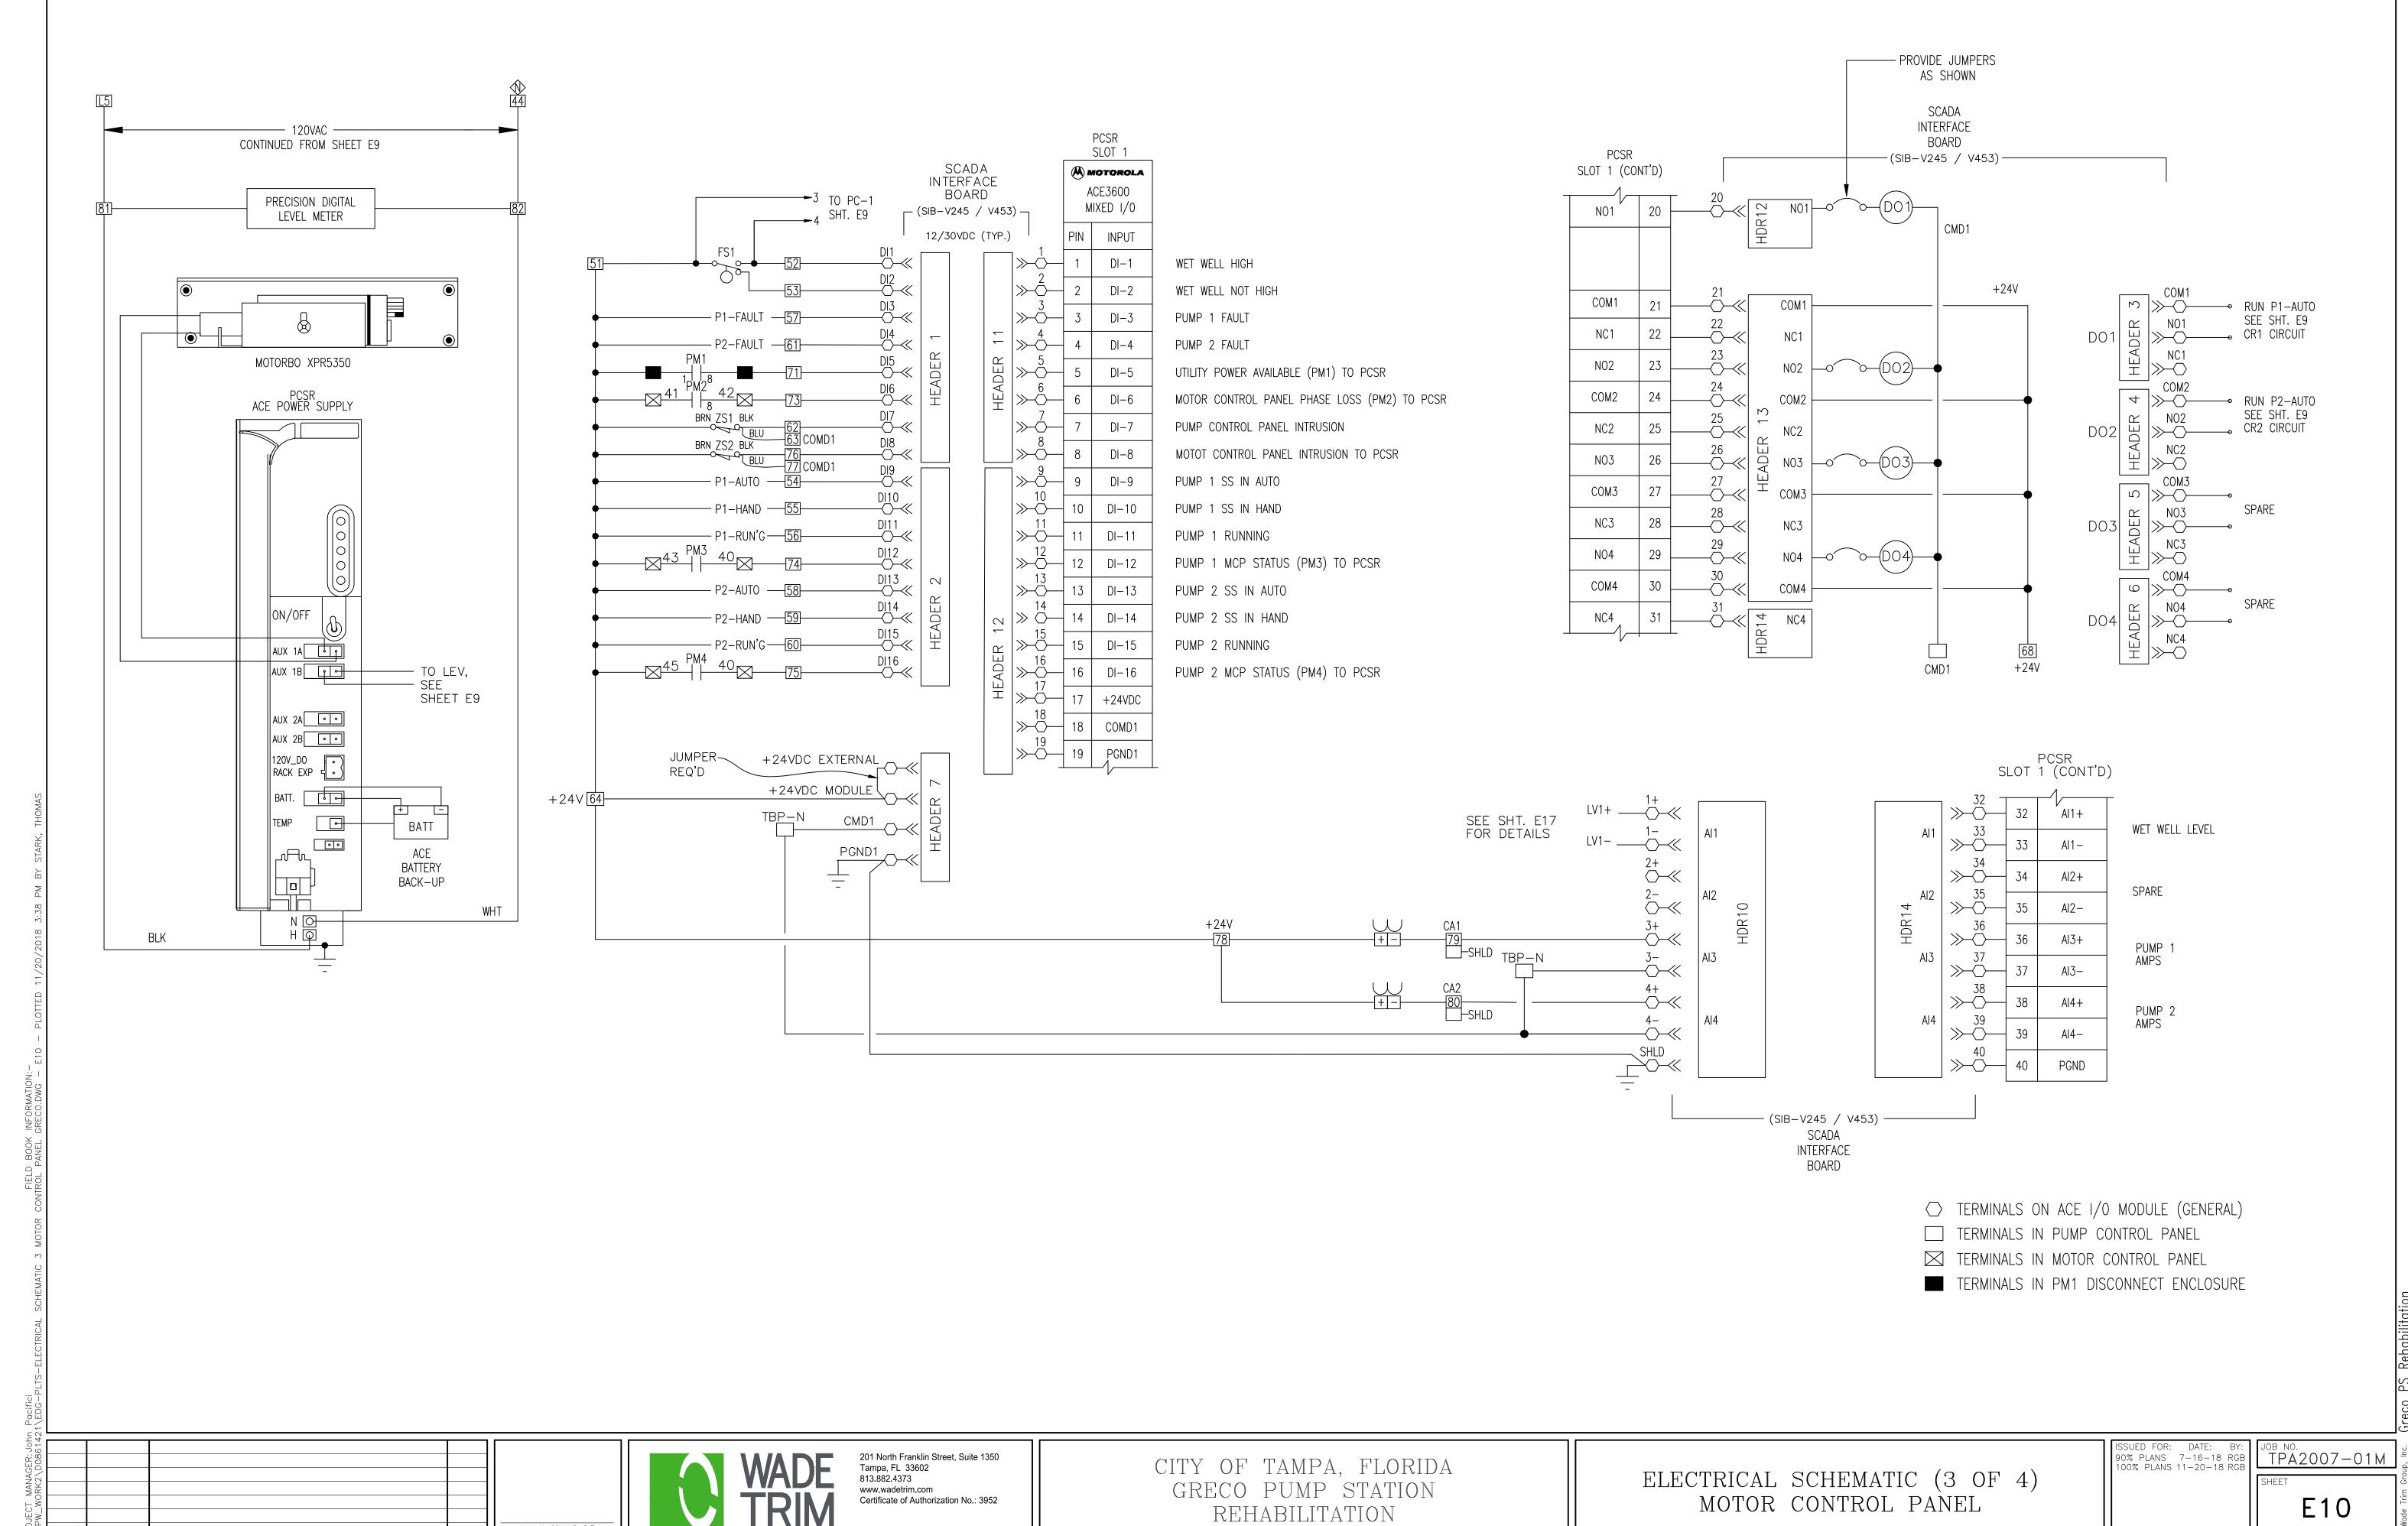

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613

DATE

DESCRIPTION

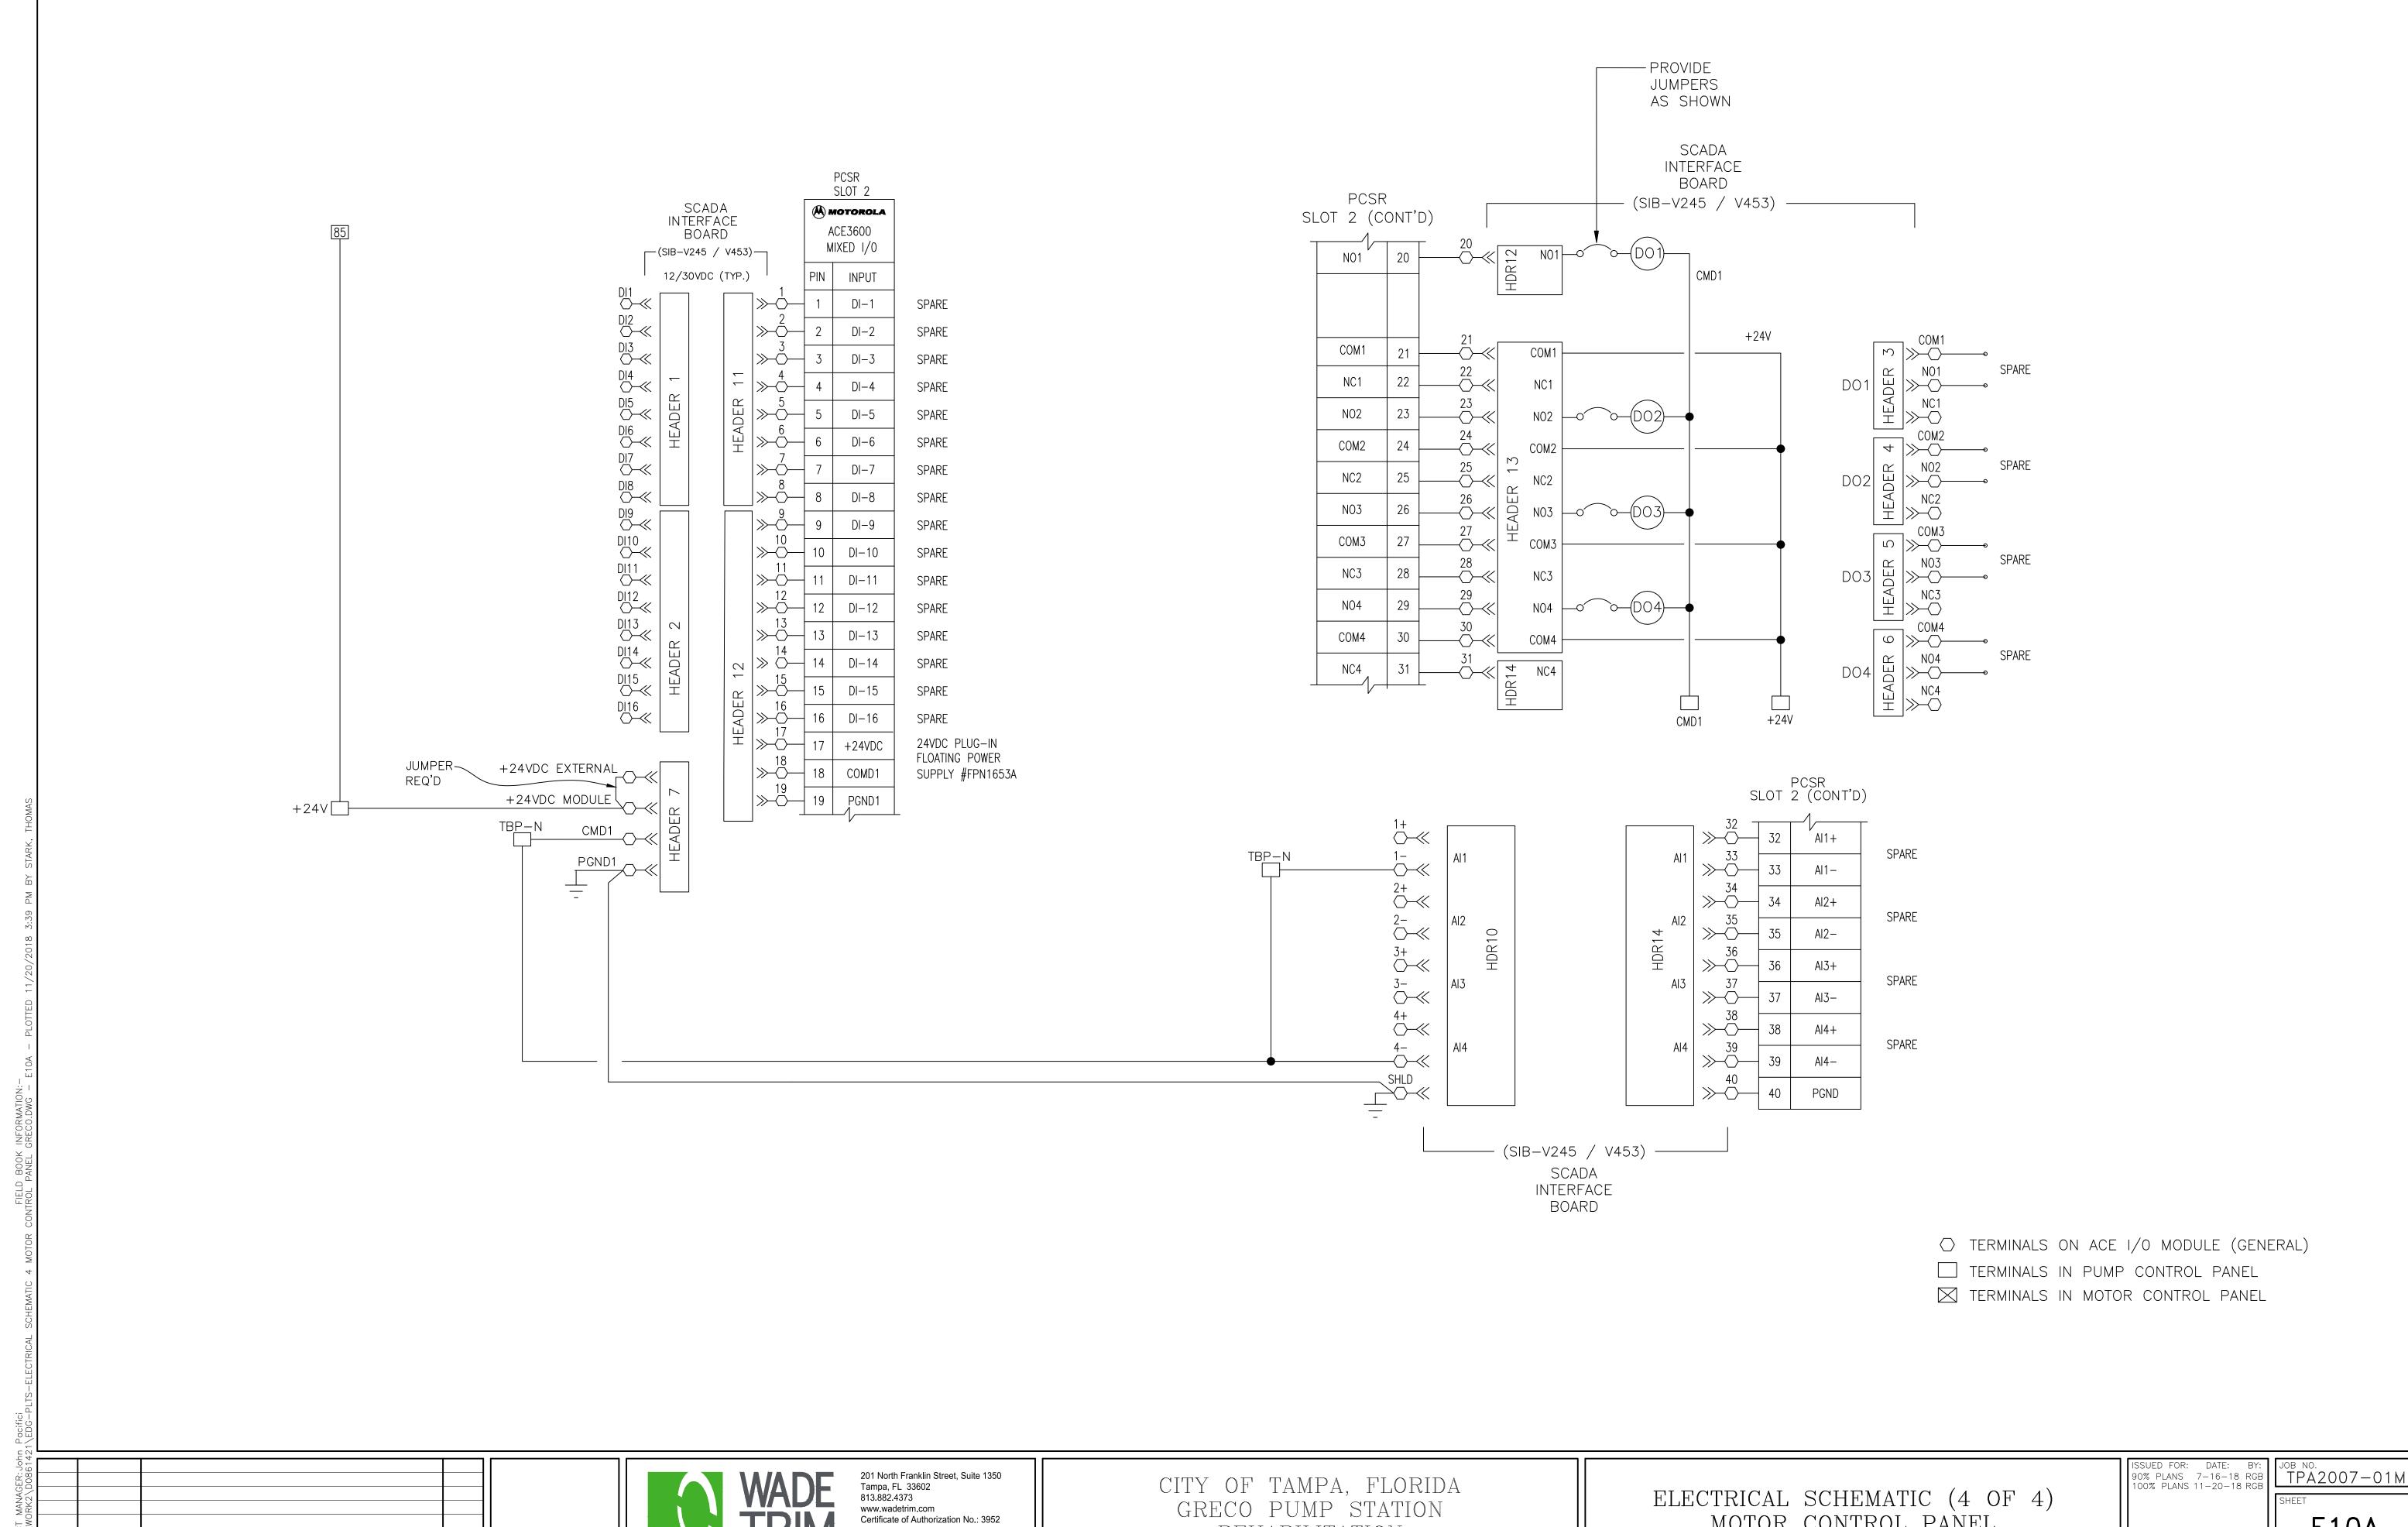

REHABILITATION

DESCRIPTION

E10A


MOTOR CONTROL PANEL

DATE

DESCRIPTION

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 613







TB1 ( ) (120V AC) MOUNTED ON PUMP CONTROL PANEL (PCP) TERM. DESCRIPTION 120V FROM MOTOR CONTROL PANEL NEUTRAL FROM MOTOR CONTROL PANEL M1 OVERLOAD M1 OVERLOAD M2 OVERLOAD M2 OVERLOAD PUMP 1 START COMMAND TO M1 (IN MCP) PUMP 1 START COMMAND TO M1 (IN MCP) PUMP 2 START COMMAND TO M2 (IN MCP) 10 PUMP 2 START COMMAND TO M2 (IN MCP) 11 P1 "ON" SIGNAL FROM M1 (IN MCP) 12 P1 "ON" SIGNAL FROM M1 (IN MCP) 13 | P2 "ON" SIGNAL FROM M2 (IN MCP) 14 | P2 "ON" SIGNAL FROM M2 (IN MCP) 15 | PUMP 1 LEAK ALARM FROM MCP PUMP 1 LEAK ALARM FROM MCP 17 PUMP 2 LEAK ALARM FROM MCP PUMP 2 LEAK ALARM FROM MCP PUMP 1 TEMPERATURE ALARM FROM MCP PUMP 1 TEMPERATURE ALARM FROM MCP PUMP 2 TEMPERATURE ALARM FROM MCP PUMP 2 TEMPERATURE ALARM FROM MCP PUMP 1 FAULT RELAY CONTACT PUMP 1 FAULT RELAY CONTACT 24 PUMP 2 FAULT RELAY CONTACT PUMP 2 FAULT RELAY CONTACT 28 SPARE 29 SPARE SPARE 31-43 SPARE

	V
44	SPD-2 NUETRAL OUT
L1	SPD-2 NUETRAL OUT
L2	MAIN BREAKER CB6
L3	CB7 OUT
L4	SPARE CB8 BREAKER
L5	CB9 OUT
L6	SPARE CB5 BREAKER
	-

TB1 CONTINUED

TERM.	DESCRIPTION		
TEI VIVI.			
51	SLOT 1 PCSR 24V+		
52	WET WELL HIGH		
53	WET WELL NOT HIGH		
54	PUMP 1 "AUTO" TO PCSR		
55	PUMP 1 "HAND" TO PCSR		
56	PUMP 1 "ON" TO PCSR		
57	PUMP 1 "FAULT" TO PCSR		
58	PUMP 2 "AUTO" TO PCSR		
59	PUMP 2 "HAND" TO PCSR		
60	PUMP 2 "ON" TO PCSR		
61	PUMP 2 "FAULT" TO PCSR		
62	DUMP CONTROL PANEL INTRUCION		
63	PUMP CONTROL PANEL INTRUSION		
64	SLOT 1 PCSR 24V+		
65	SPARE		
66	SLOT 1 PCSR 24V+		
67	SPARE		
68	SLOT 1 PCSR 24V+		
69	SPARE		
70	SLOT 1 PCSR 24V+		
71	UTIL POWER AVAILABLE (PM1) TO PCSR		
72	SLOT 1 PCSR 24V+		
73	MOTOR CONTROL PANEL PHASE LOSS (PM2)		
74	PUMP #1 MCP STATUS (PM3) TO PCSR		
75	PUMP #2 MCP STATUS (PM4) TO PCSR		
76	MOTOR CONTROL DANIEL INTRUCION		
77	MOTOR CONTROL PANEL INTRUSION		
78	SLOT 1 PCSR 24V+		
79	PUMP 1 AMPS		
80	PUMP 2 AMPS		
81	PROCESS METER FOR LEVEL 120V-POWER		
82	PROCESS METER FOR LEVEL 120V-NEUTRAL		
83 SPARE SLOT 1 TERMINALS			

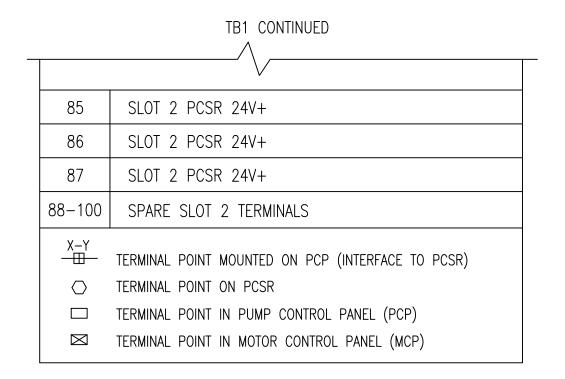

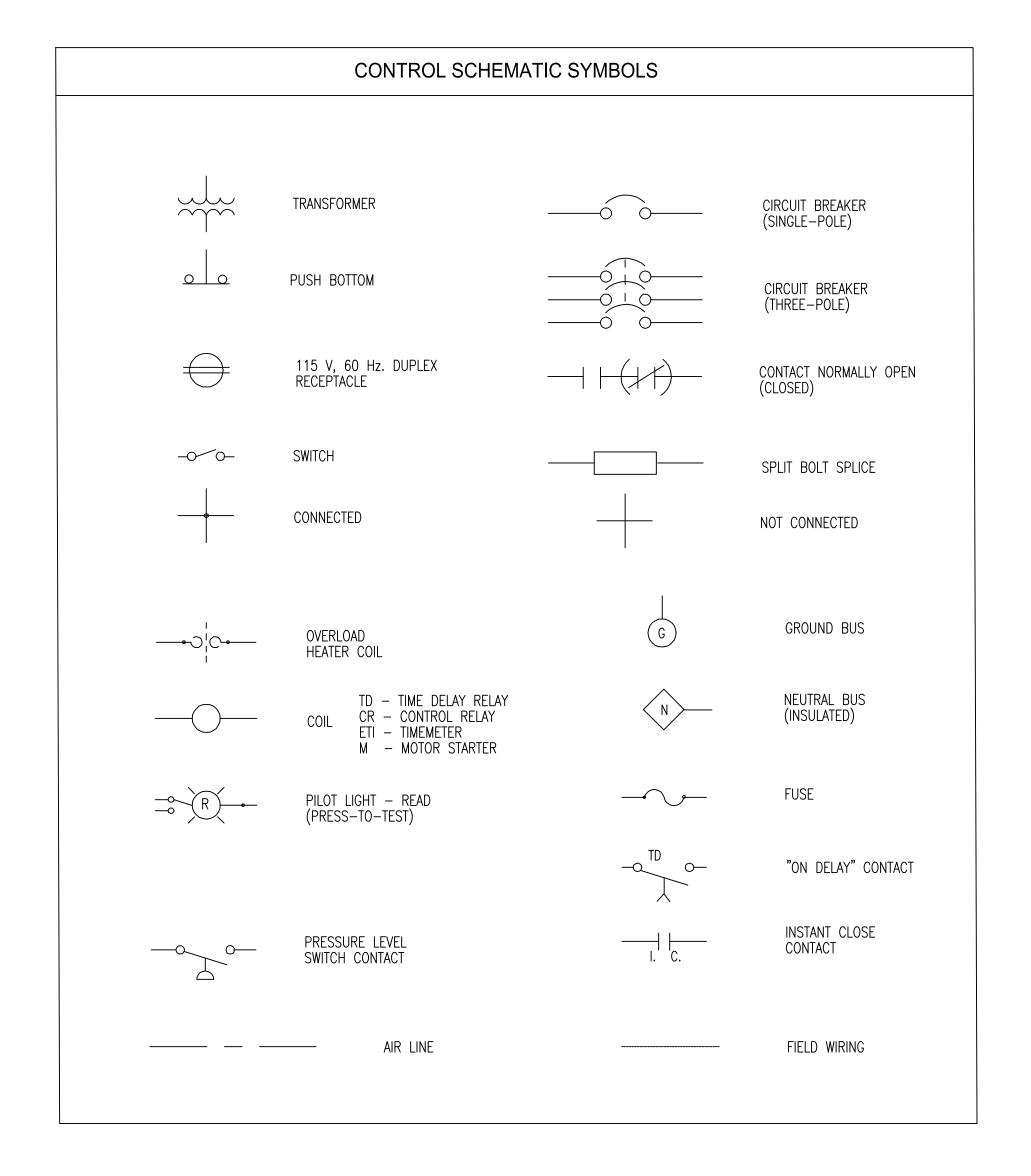

REV# DATE DESCRIPTION BY

IN M. SCHWAB, P.E. JA LICENSE NO. 61313



201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION


ELECTRICAL SCHEMATIC LEGEND (SHT. 1 OF 2)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO. TPA2007-01M

T-RM.	D_SCRIPTION	
39	SPARE	
40	SPARE	
41	SLOT 1 PCSR 24V+	
42	MOTOR CONTROL PAN-L PHAS- LOSS (PM2) TO PCSR	
43	SLOT 1 PCSR 24V+	
44	PUMP #1 MCP STATUS PHAS: LOSS (PM3) TO PCSR	
45	SLOT 1 PCSR 24V+	
46	PUMP #2 MCP STATUS PHAS= LOSS (PM4) TO PCSR	
47	SLOT 1 PCSR 24V+	
49	MOTOR CONTROL PAN-L INTRUSION	
50	SLOT 1 PCSR 24V+	
 51	PUMP 1 AMPS	
52	PUMP 2 AMPS	
53	PUMP 1 S-AL LEAK DET-CTOR PROBE	
54	PUMP 1 SEAL L-AK D-TECTOR PROBE	
55	PUMP 1 SEAL L-AK DETECTOR PROBE	
56	PUMP 1 SEAL L-AK D-TECTOR PROBE	
57–66	SPAR_	
X-Y 	TERMINAL POINT MOUNTED ON PCP (INTERFECT TO PCSR)  TERMINAL POINT ON PCSR  TERMINAL POINT IN PUMP CONTROL PANEL (PCP)  TERMINAL POINT IN MOTOR CONTROL PANEL (MCP	

TV# DATE DESCRIPTION BY







PARTS SCHEDULE IS CONTINUED ON SHEET E15

#### NOTES:

- 1. ALARM FLOAT SWITCH WILL BE SUPPLIED BY WWD AND INSTALLED BY CONTRACTOR.
- 2. DIMENSIONS, ITEMS, OR ELEVATIONS MARKED "\*" SHALL BE DETERMINED AFTER EQUIPMENT SELECTION.

DATE DESCRIPTION

ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 6131

201 North Franklin Street, Suite 1350 Tampa, FL 33602 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION

PARTS SCHEDULE (SHT. 1 OF 2)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

JOB NO. TPA2007-01M

#### NOTES:

- ALARM FLOAT SWITCH WILL BE SUPPLIED BY WWD AND INSTALLED BY CONTRACTOR.
- 2. DIMENSIONS, ITEMS, OR ELEVATIONS MARKED "\*" SHALL BE DETERMINED AFTER EQUIPMENT SELECTION.

REV#	DATE	DESCRIPTION	BY






ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB TPA2007-01M

E15

FIELD BOOK INFORMATION:— S-PARTS SCHEDULE 2 GRECO.DWG — E15 — PLOTTED 11/20/2018 3:39 PM

KZ (DU861421 (EDG—PLIS—PARIS SCHEDULE Z GRECU.DWG — E15 —

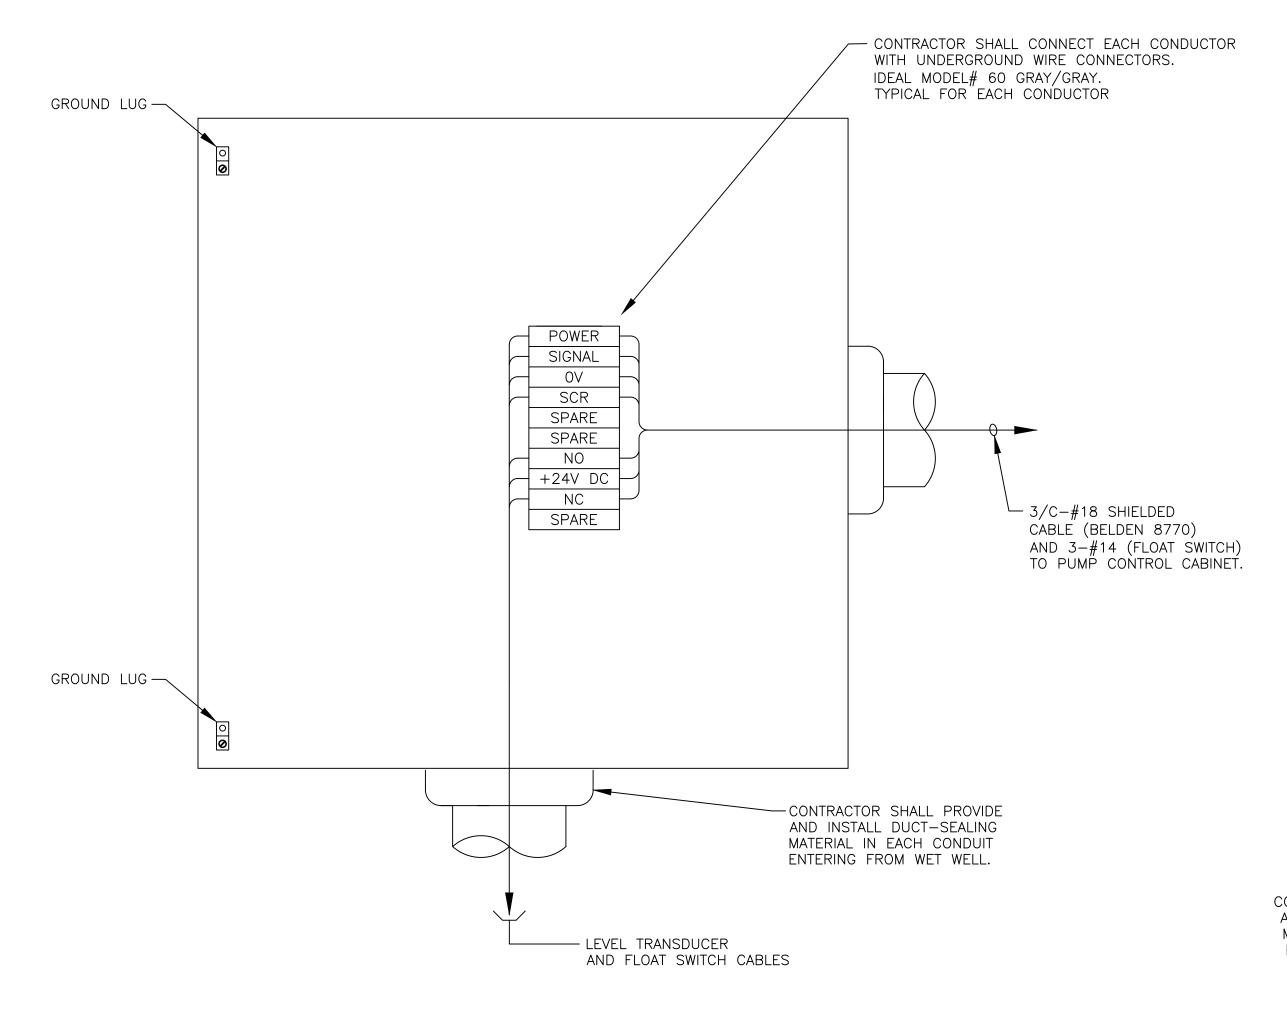

<u></u>3−#10 + #10 GND + 2-#12 (CAS) TO "MOTÒR CONTROL PANEL POB DIRECTLY MOUNT TO BACK PANEL - OOO CONTRACTOR SHALL CONNECT——EACH CONDUCTOR WITH BARRIER POWER DISTRIBUTION BLOCKS. TYPICAL FOR EACH CONDUCTOR. <u></u>3−#10 + #10 GND + GB3— 2-#12 (CAS) TO MOTOR CONTROL PANEL CONTRACTOR SHALL PROVIDE—
AND INSTALL DUCT—SEALING
MATERIAL IN EACH CONDUIT
ENTERING FROM WET WELL. SUBMERSIBLE PUMP
CABLE TO PUMP #2 — SUBMERSIBLE PUMP CABLE TO PUMP #1

#### NOTES:

- 1. COVER NOT SHOWN FOR CLARITY
- BOND GROUNDING CONDUCTORS TO ENCLOSURE BACK PANEL.

#### INSTRUMENTATION AND CONTROLS JUNCTION BOX DETAIL N.T.S.

ALL HINGED SURFACES SHALL BE GROUNDED WITH A BONDING JUMPER SECURED TO THE ENCLOSURE OR BACKPANEL.

#### NOTES:

- 1. COVER NOT SHOWN FOR CLARITY
- BOND GROUNDING CONDUCTORS TO ENCLOSURE BACK PANEL.

PUMP MOTOR CONNECTIONS JUNCTION BOX DETAIL N.T.S.

DATE DESCRIPTION



201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION


ELECTRICAL DETAILS (SHT. 1 OF 5)


| ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB | TPA2007-01M

E16

REHABILITATION

GROUND LUG —

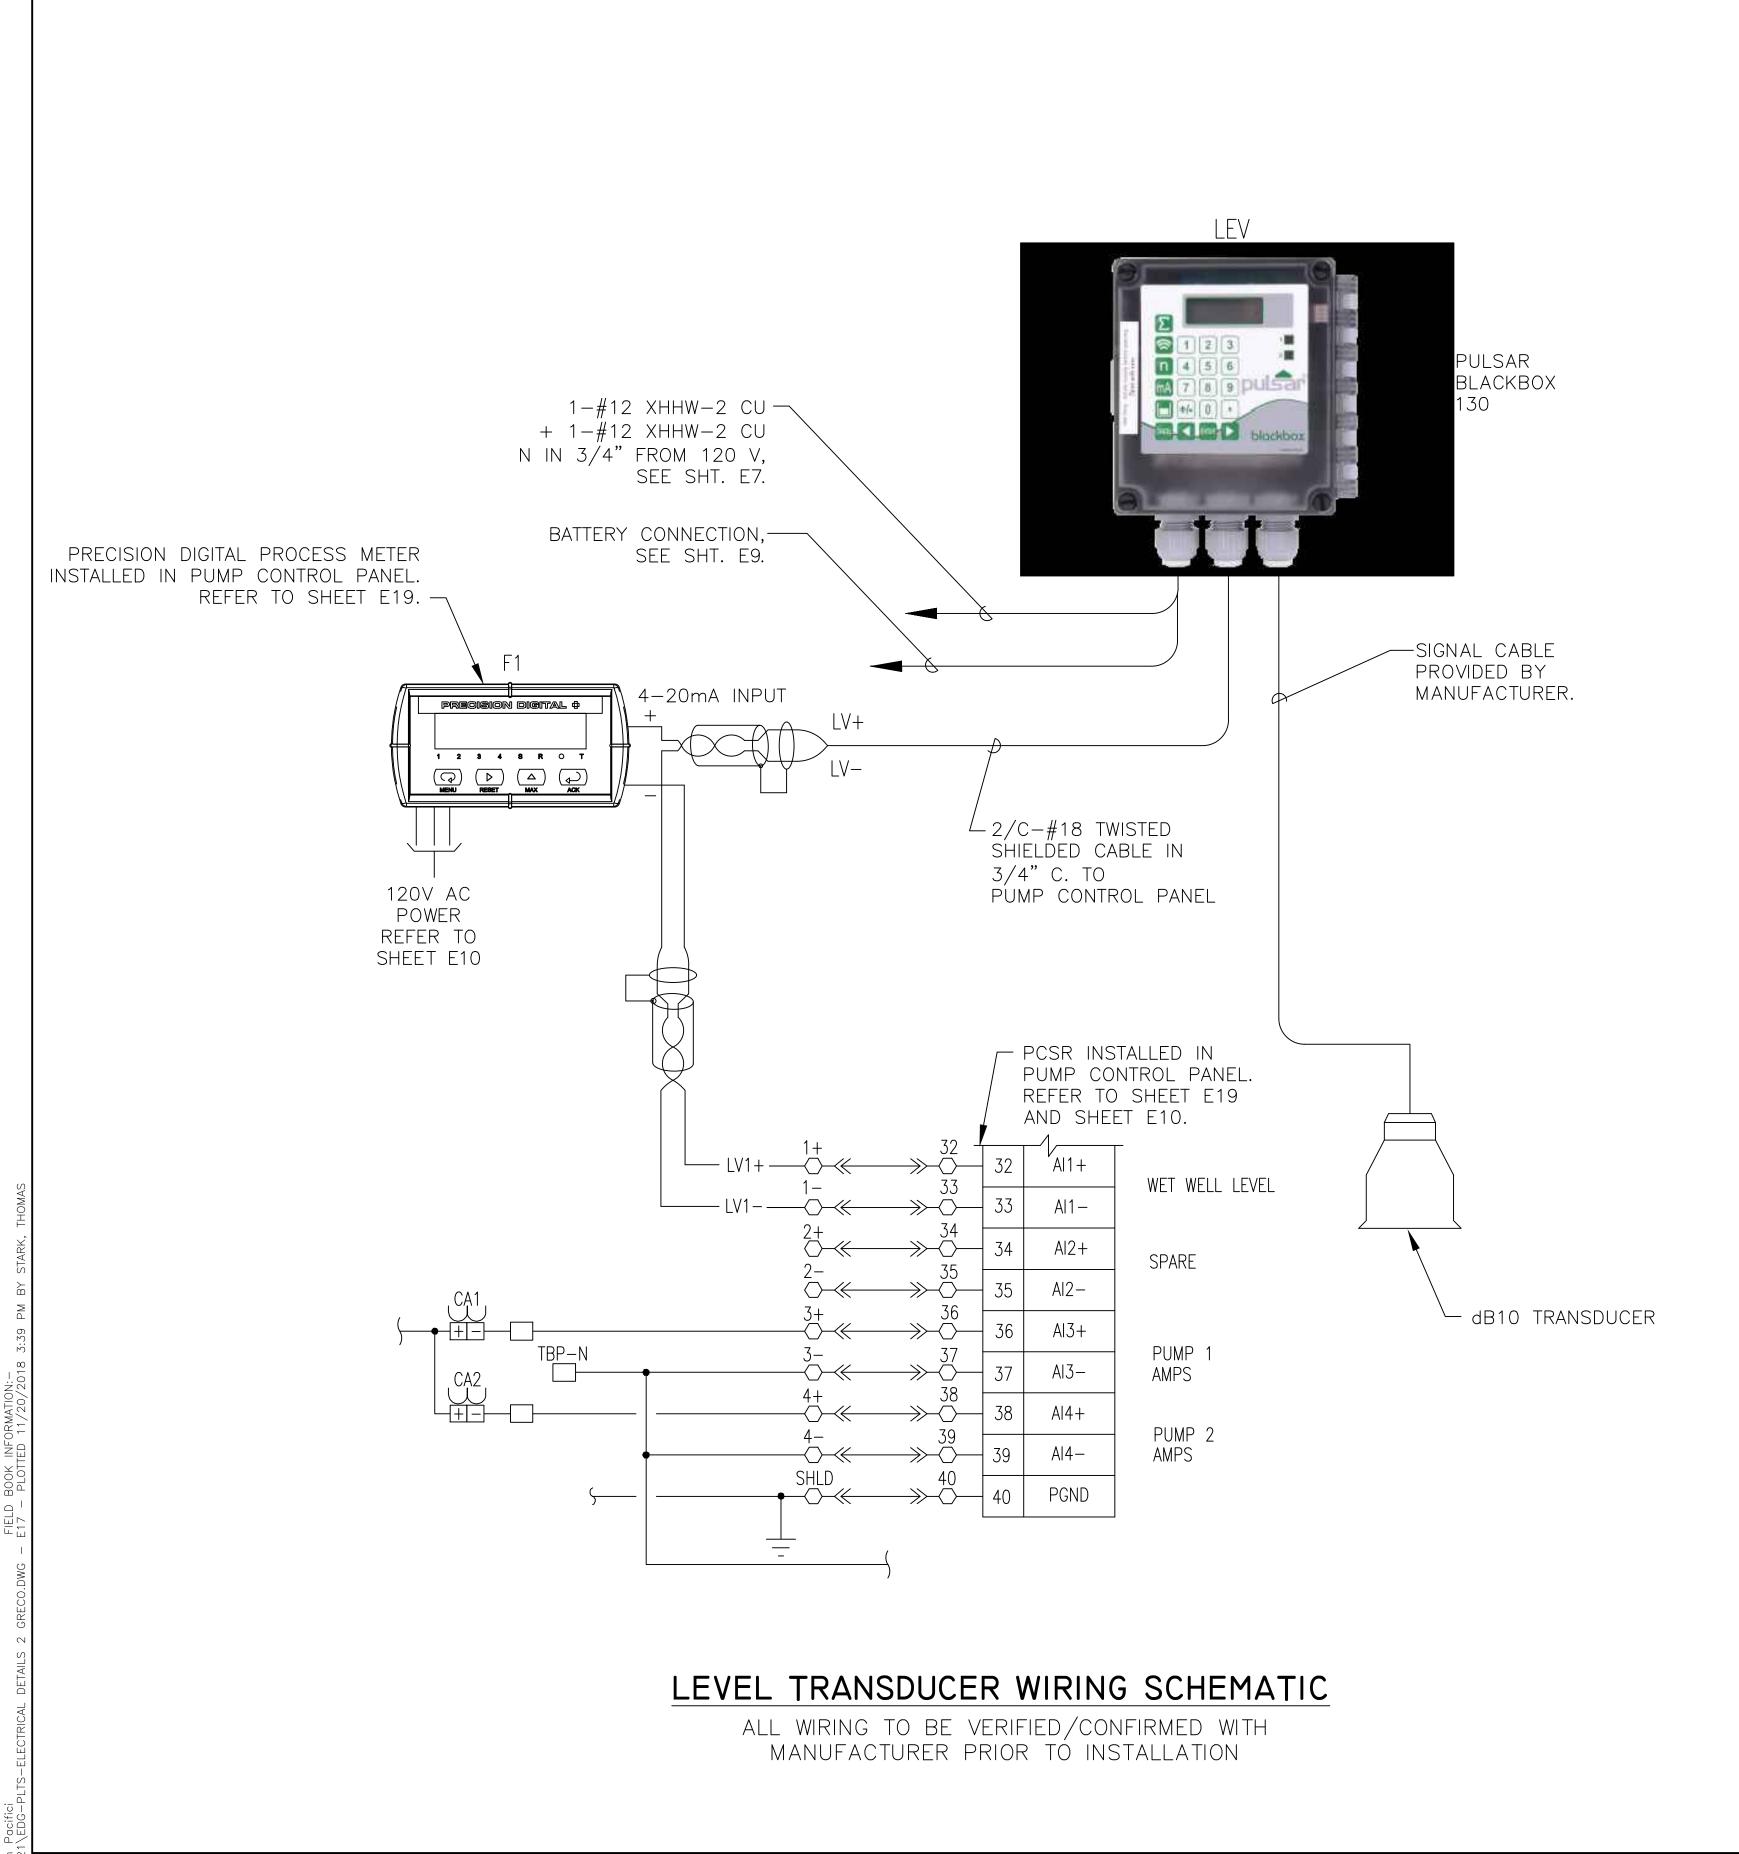

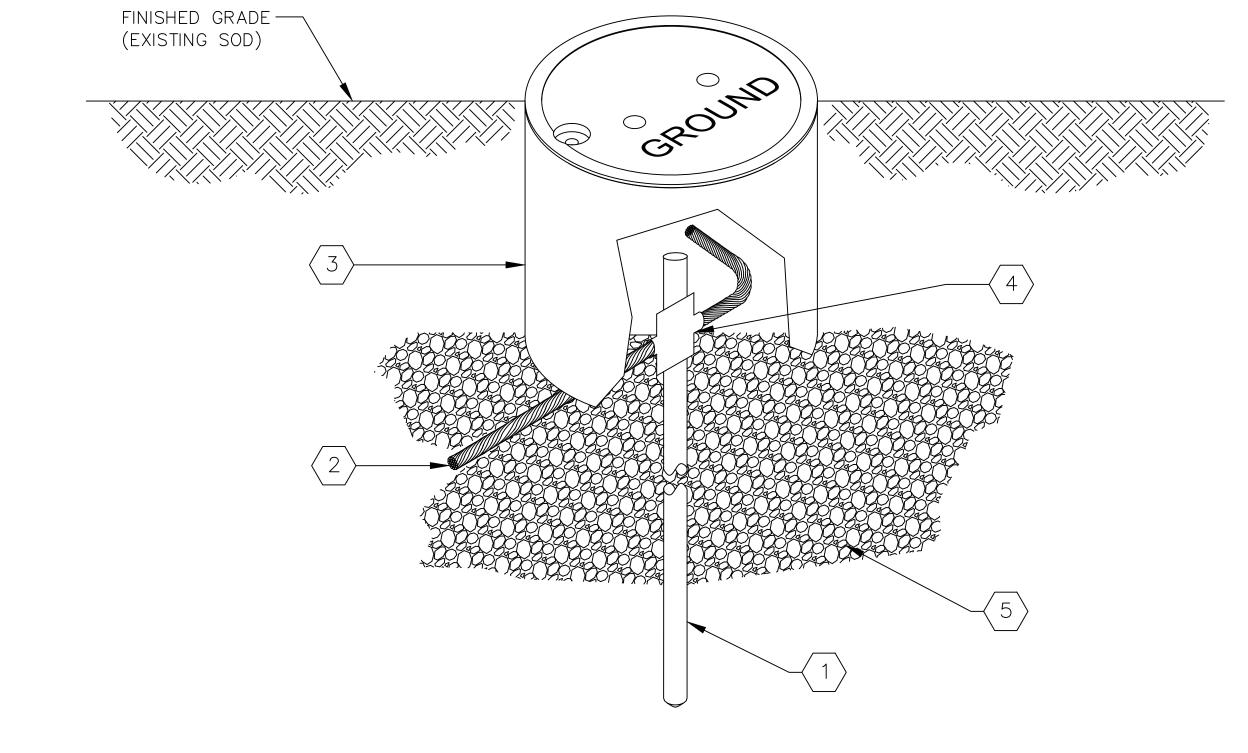

# GROUND TEST WELL DETAIL KEYED NOTES:

- 1 NEW GROUND ROD, STAINLESS STEEL, 5/8" X 10'-0" (TYP).
- #4 BARE STRANDED COPPER GROUNDING ELECTRODE CONDUCTOR (TYP).
- PROVIDE AND INSTALL OLDCASTLE PRECAST ENCLOSURE SOLUTIONS #F08 BOX WITH #F08C CAST IRON LID MARKED "GROUND".
- $\langle 4 \rangle$  exothermic weld.
- 5) PROVIDE 6" MINIMUM OF CRUSHED STONE.

## GROUNDING TEST WELL DETAIL

SCALE: N.T.S.

REV# DATE DESCRIPTION BY FI


ALAN M. SCHWAB, P.E. FLORIDA LICENSE NO. 61313


201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA
GRECO PUMP STATION
REHABILITATION

ELECTRICAL DETAILS (SHT. 2 OF 5)

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB SHEET

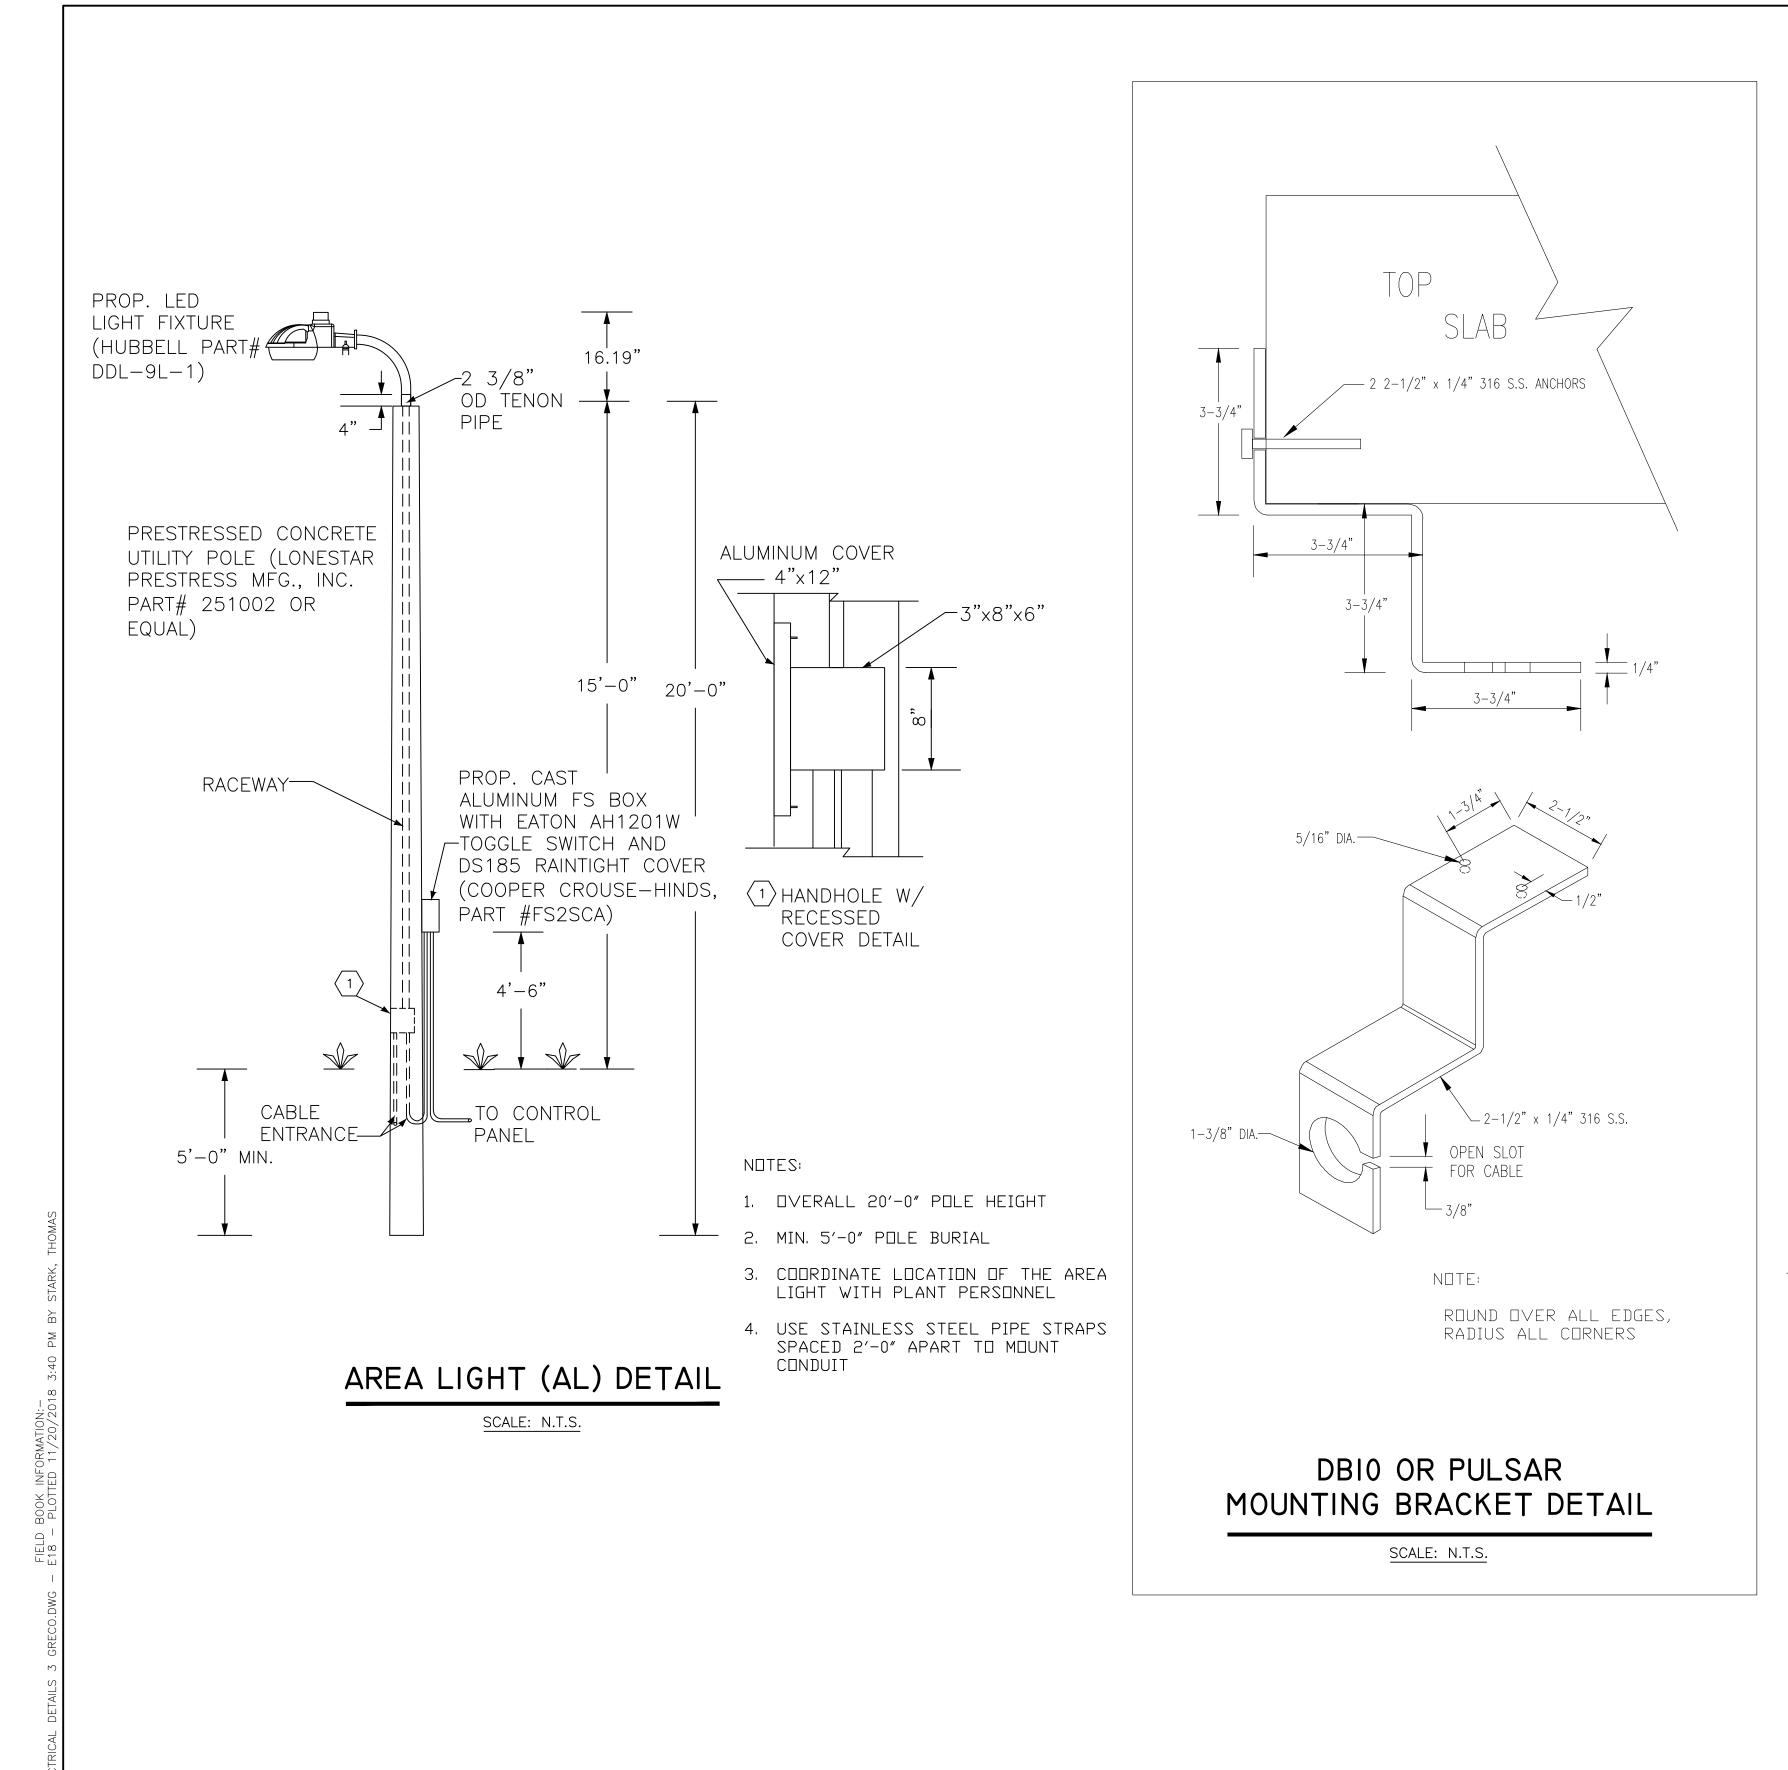

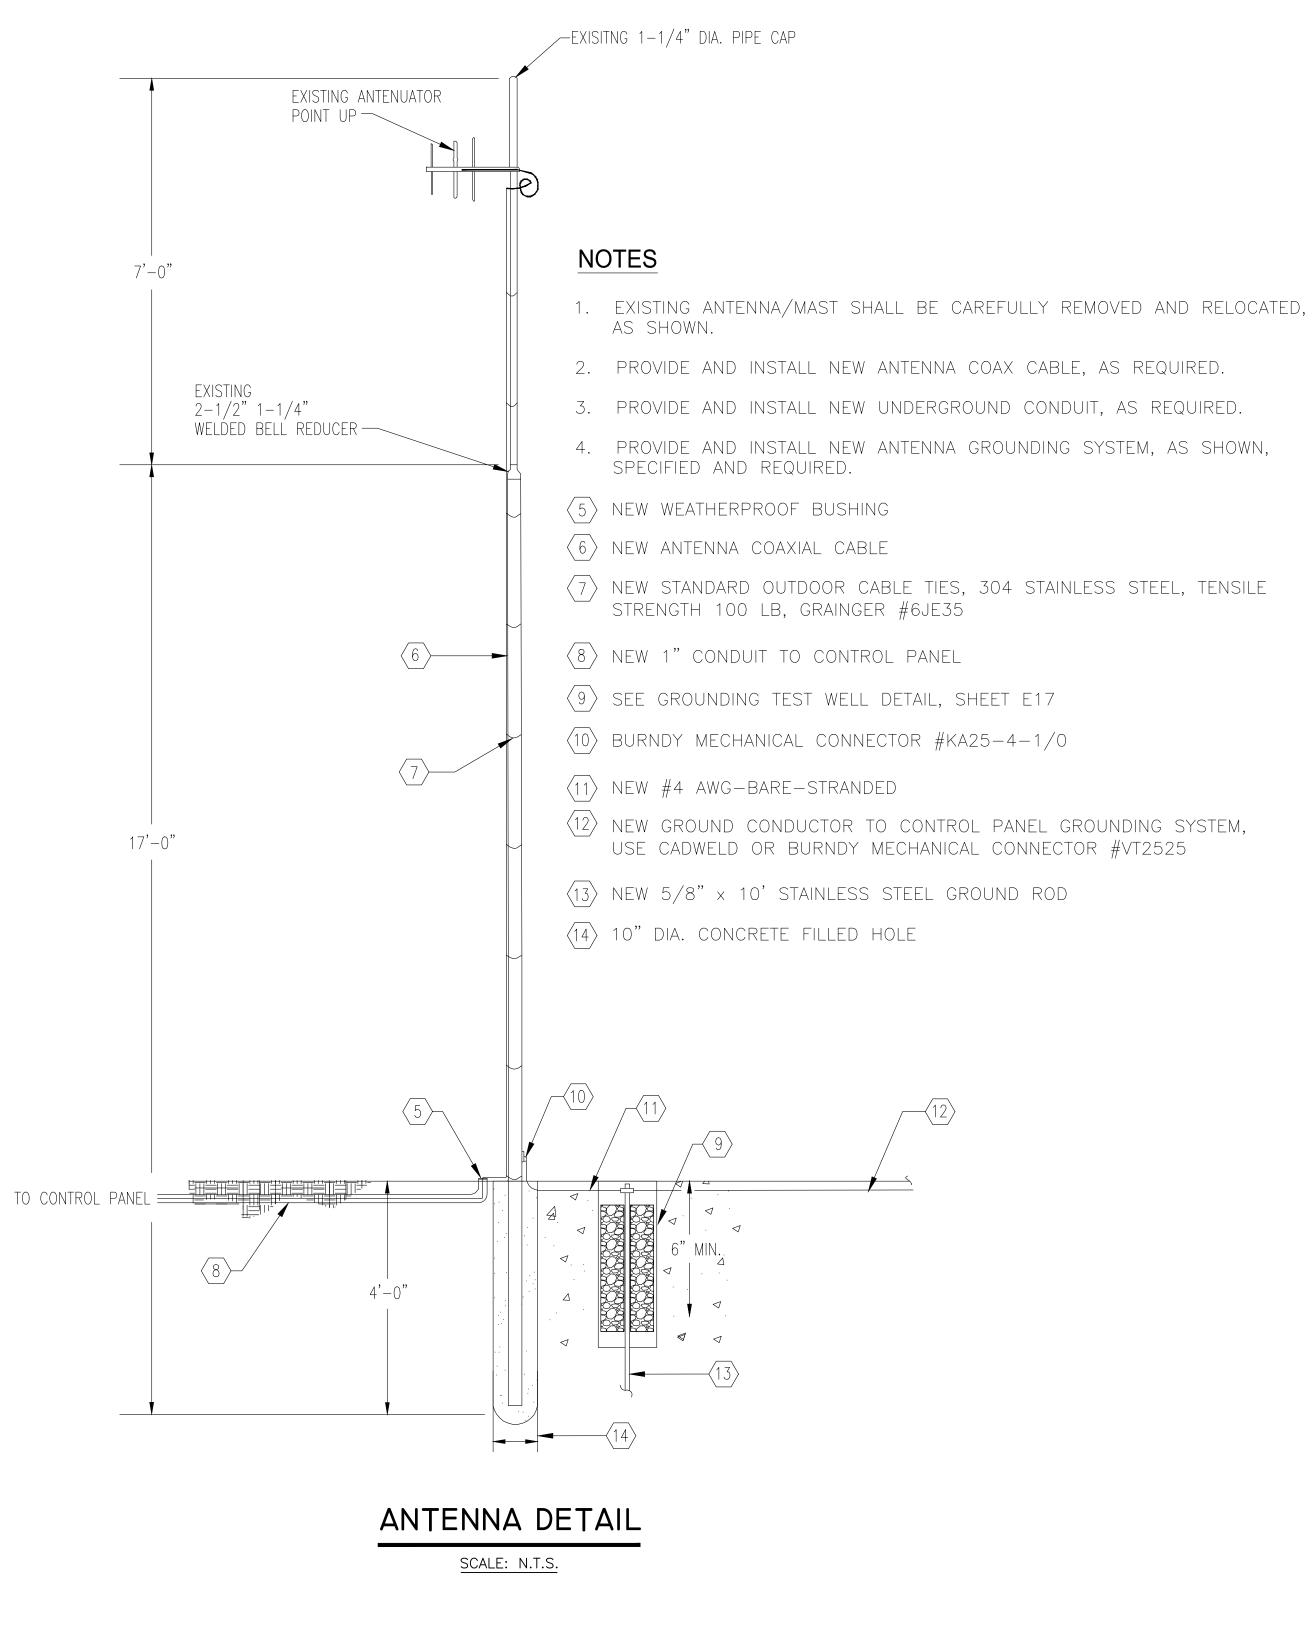

REV# DATE DESCRIPTION BY





201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952

CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION


ELECTRICAL DETAILS (SHT. 3 OF 5)


ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

E18


PROJECT MANAGER: John Pacifici C:\PW\_WORK2\D0861421\EDG-PLT

.882.4373
v.wadetrim.com
ifficate of Authorization No.: 3952

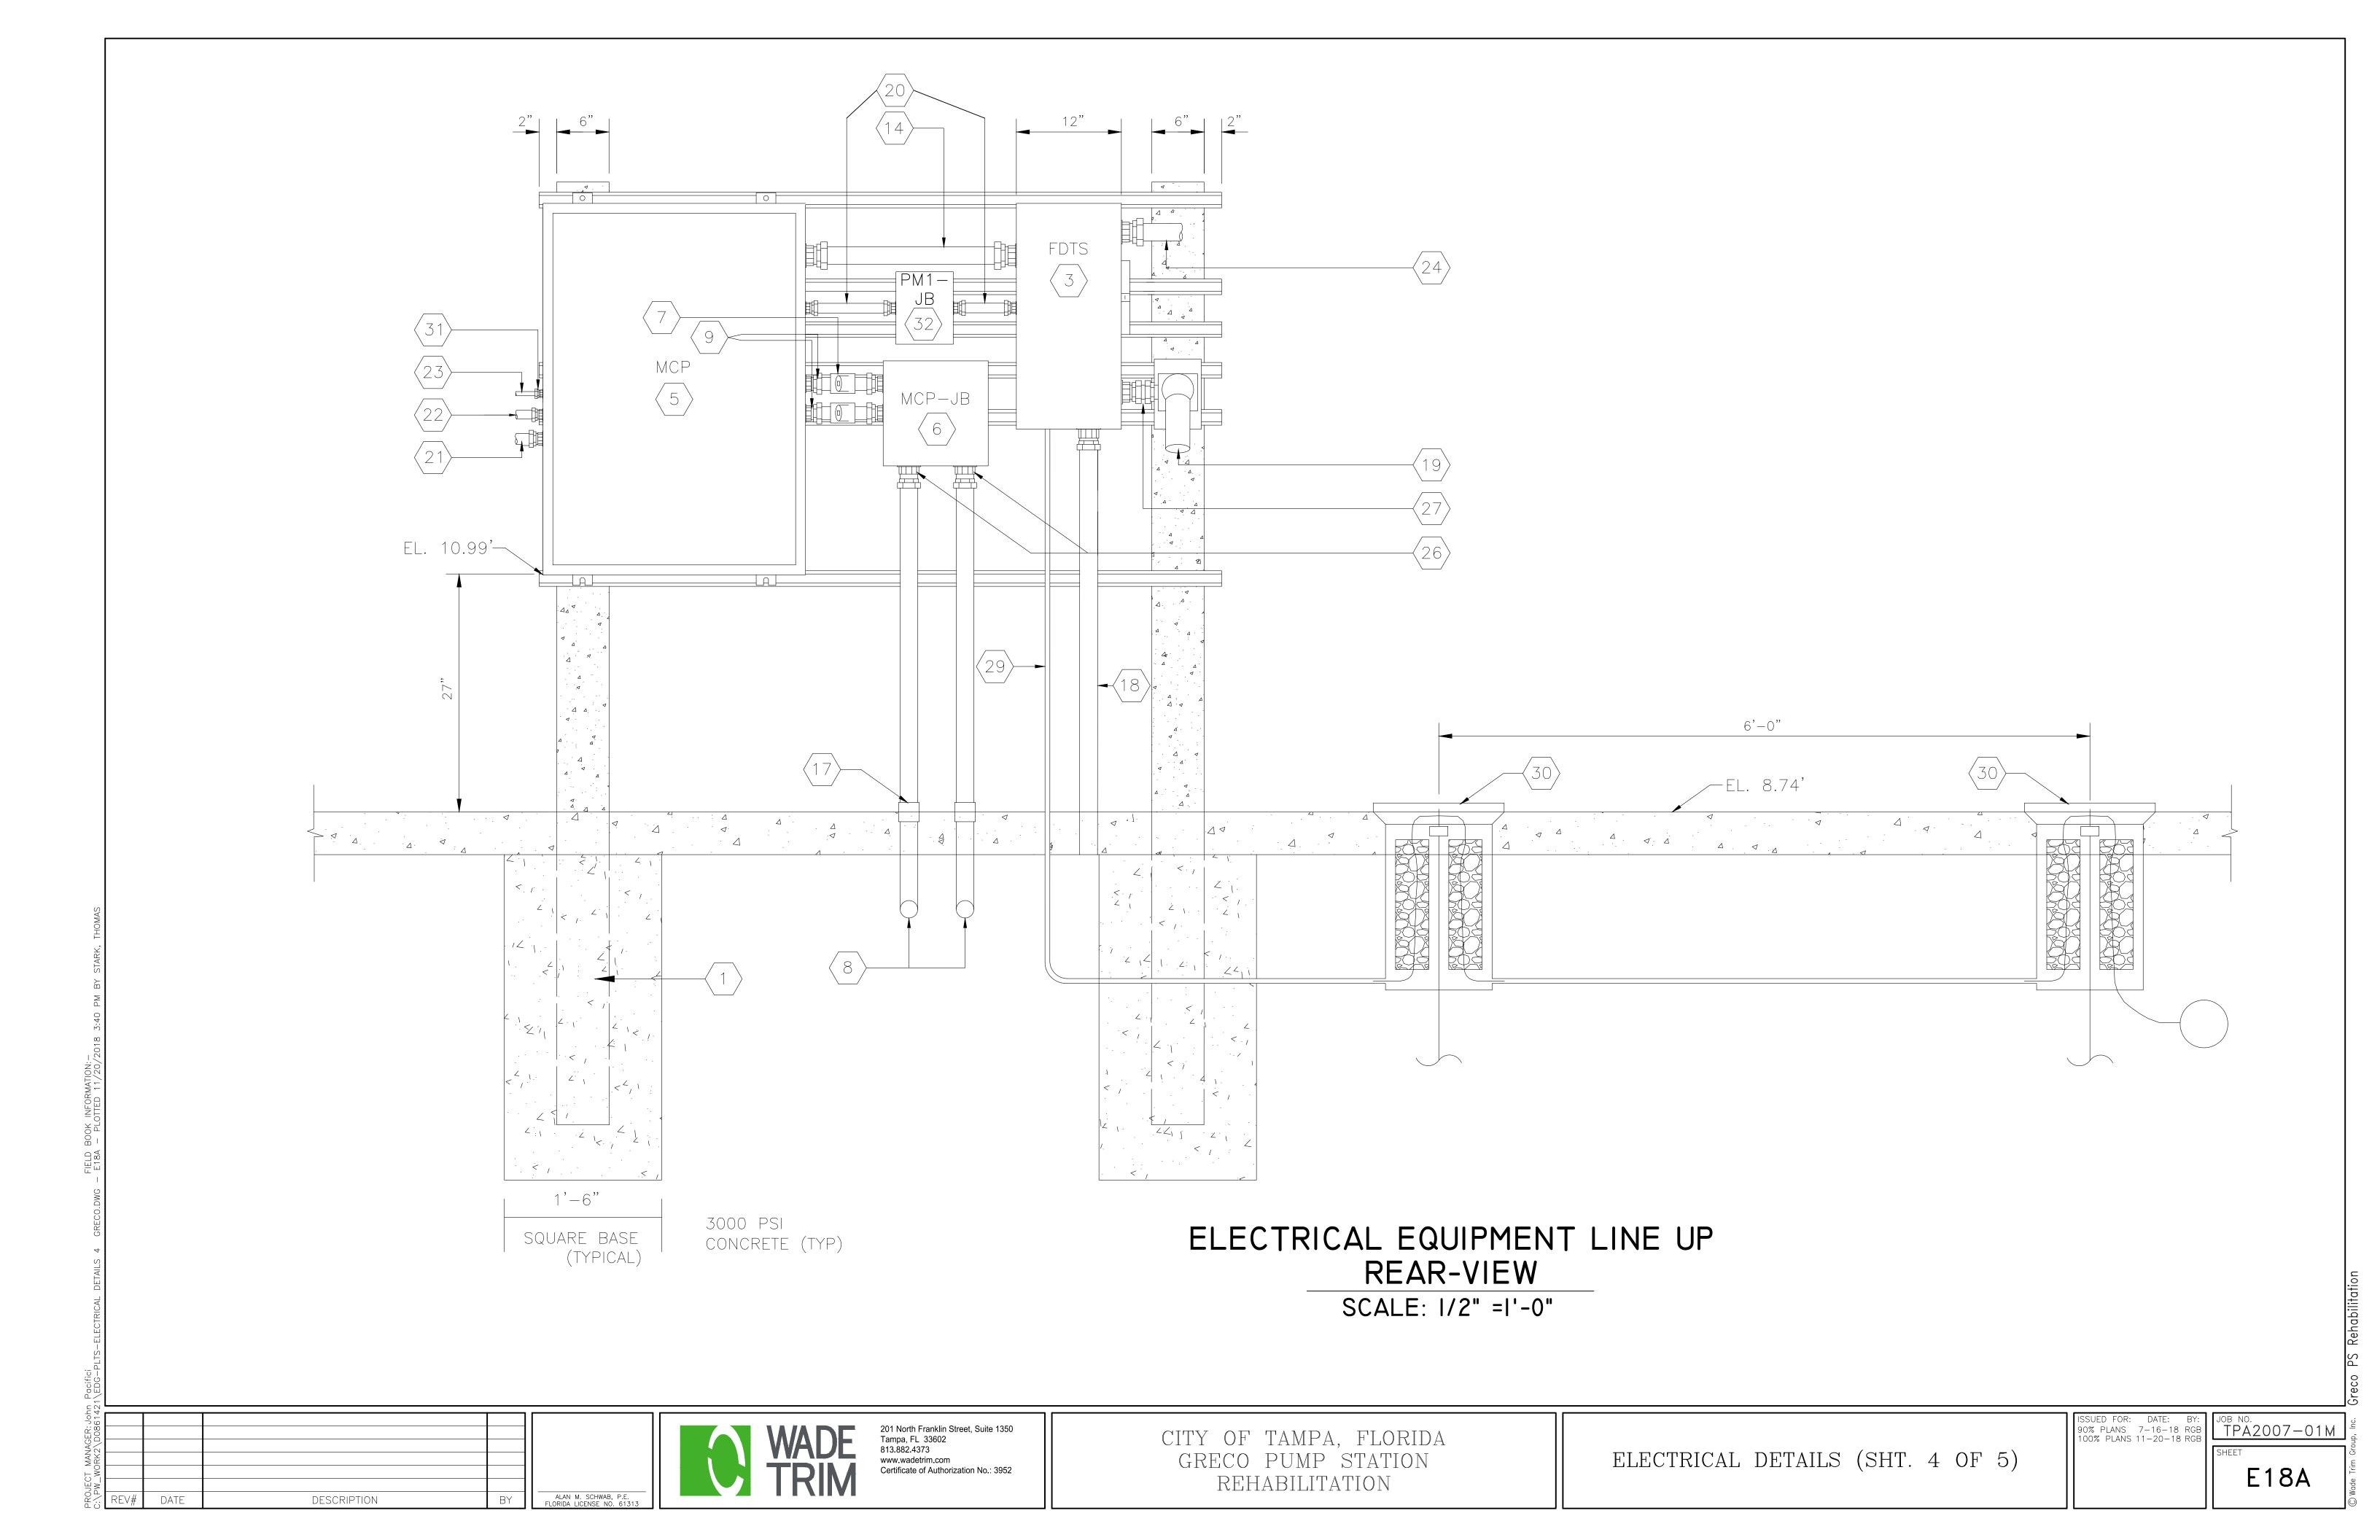

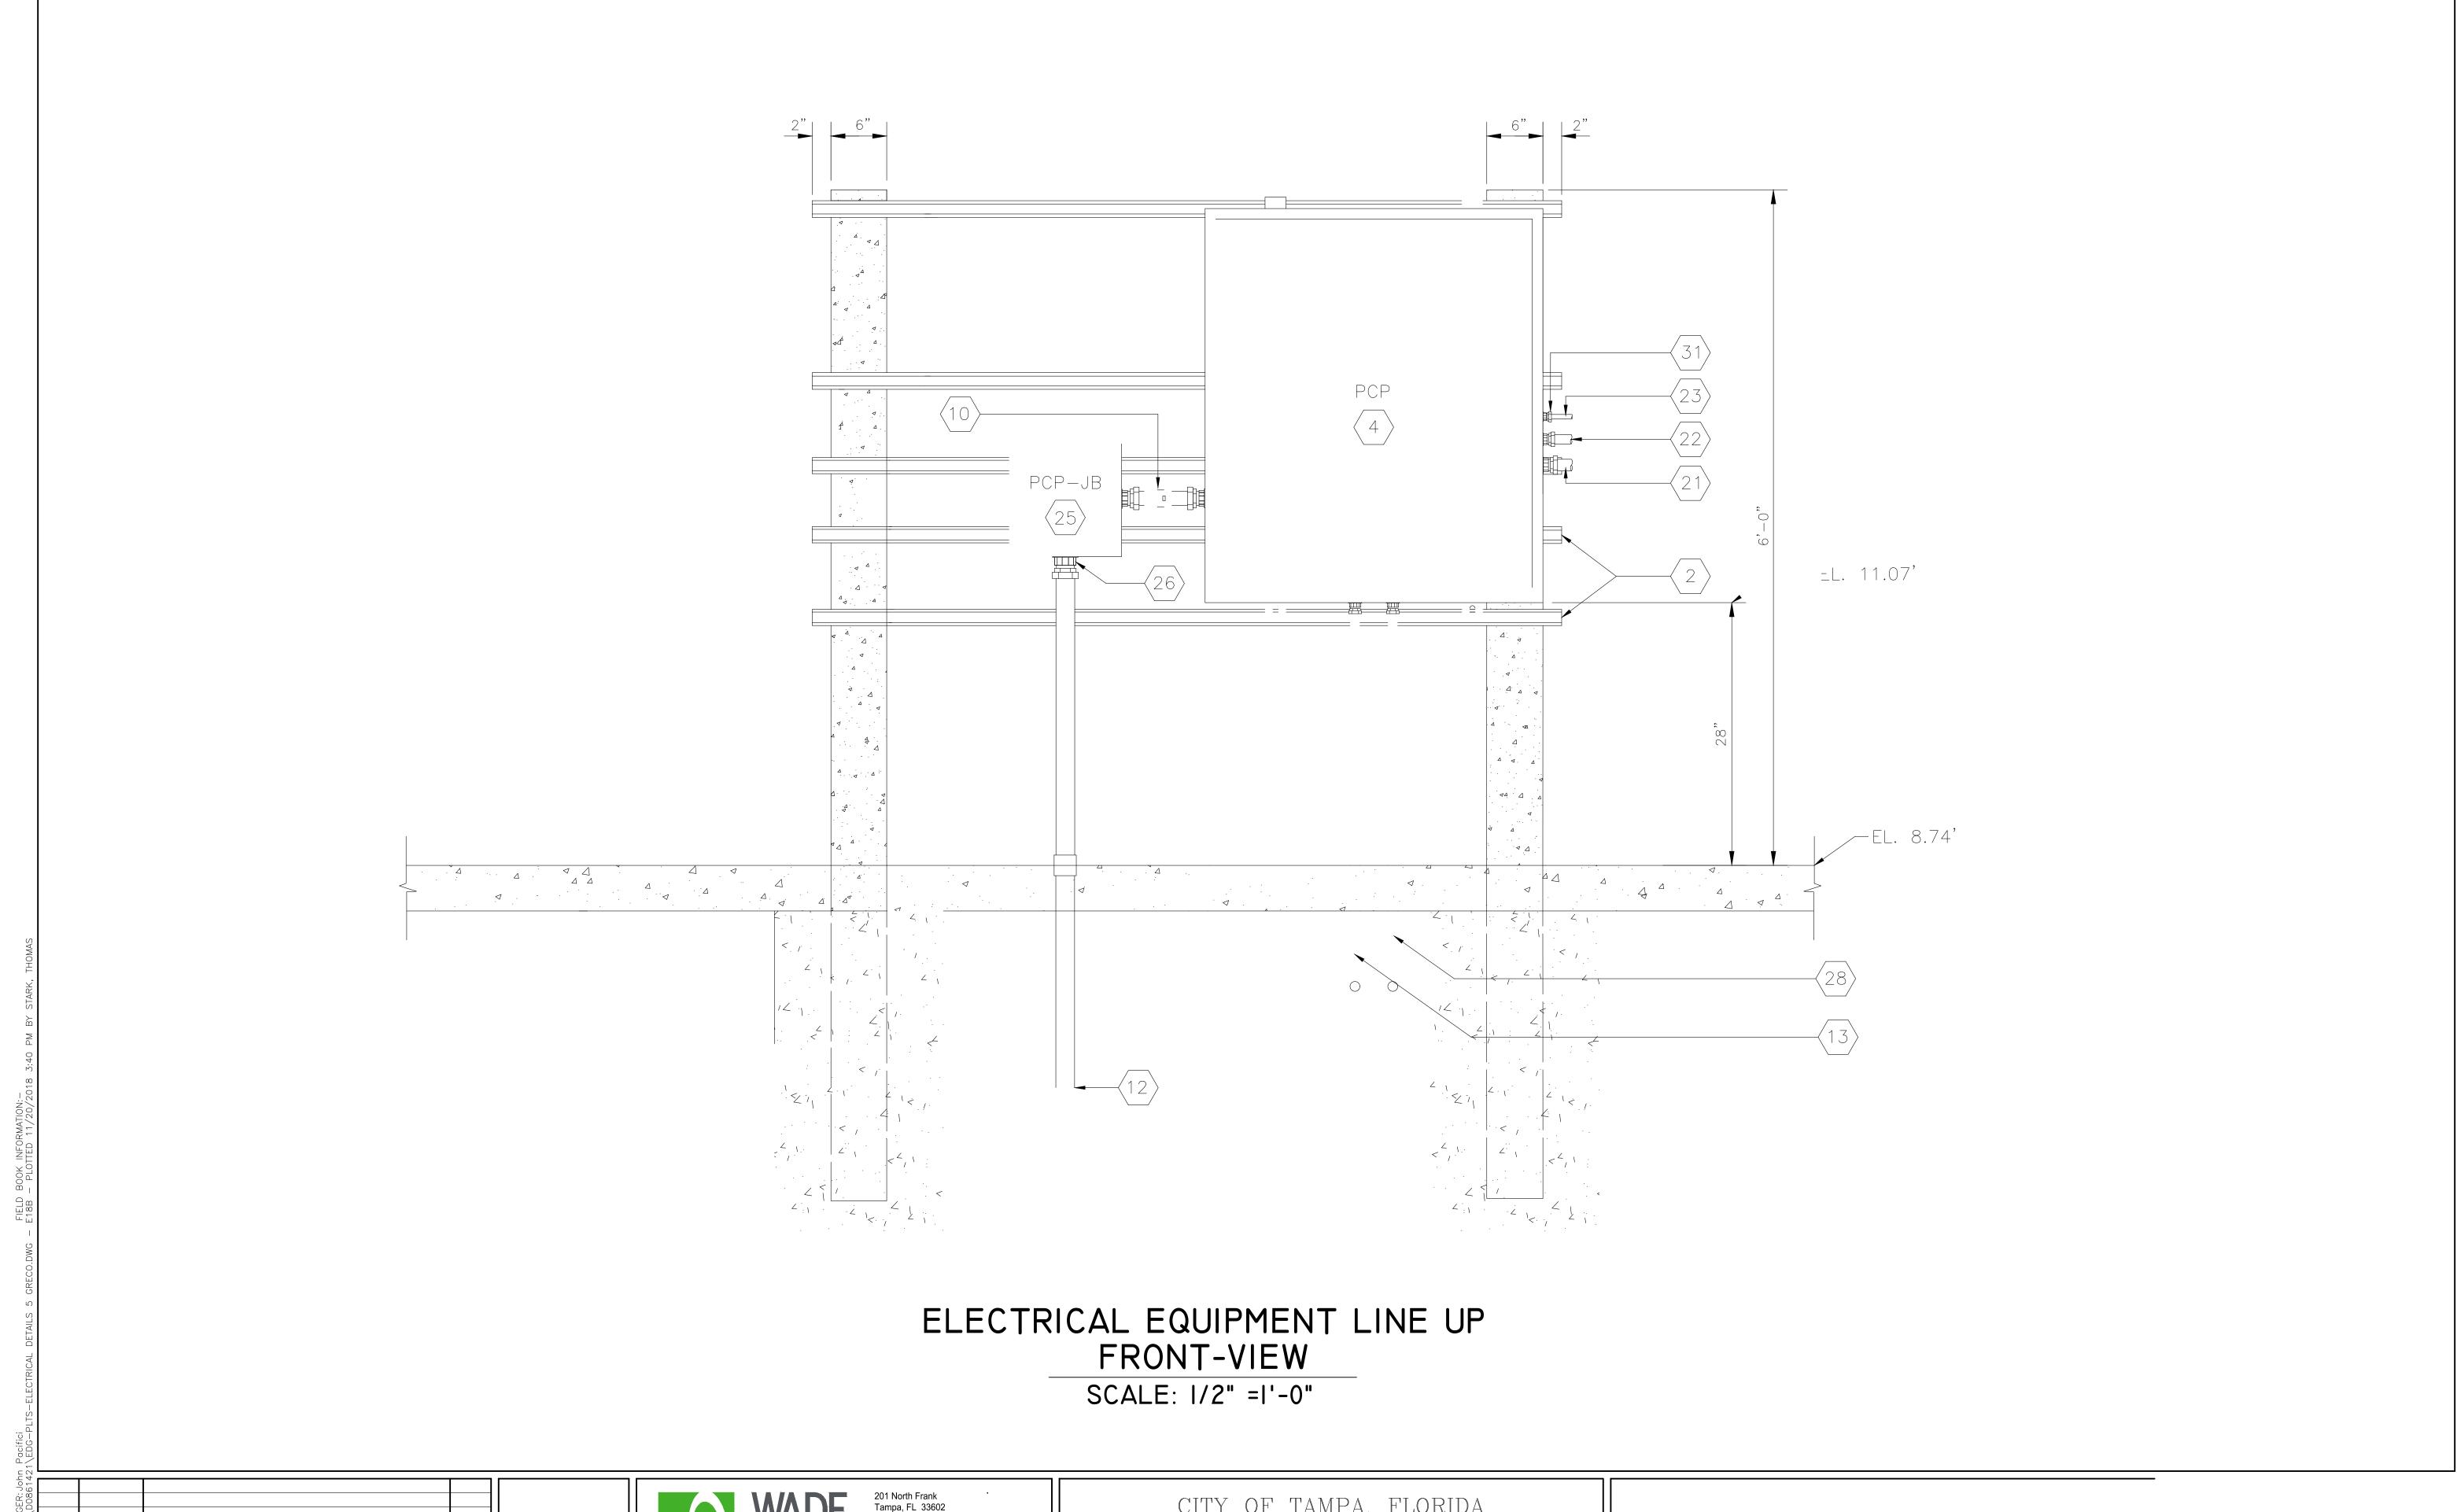





### KEYED NOTES:

- $\langle$  1  $\rangle$  provide and install three (3) 6" x 6" x 10' reinforced square concrete posts.
- PROVIDE AND INSTALL 1-5/8" x 1-5/8" 316 STAINLESS STEEL UNISTRUT WITH 316 STAINLESS STEEL HARDWARE NOTE, INSTALL ALL BOLTO FOR INSTALL BOLT HARDWARE. NOTE: INSTALL ALL BOLTS FOR UNISTRUT COMPLETELY THROUGH CONCRETE POSTS.
- PROVIDE AND INSTALL SERVICE ENTRANCE RATED HEAVY DUTY, DOUBLE THROW, FUSIBLE SWITCH, 3-POLE, 240 VAC, 60 AMP IN NEMA 4X TYPE ENCLOSURE, 240 VOLT, DUAL-ELEMENT, TIME-DELAY CLASS RK5 FUSES; SWITCH--EATON DT322FWK, DT100NK NEUTRAL KIT, DS100GK GROUND LUG KIT, DS36FK- "R" FUSE ADAPTER KIT.
- PROVIDE AND INSTALL PUMP CONTROL CABINET. REFER TO DETAIL ON SHEET E19.
- PROVIDE AND INSTALL MOTOR CONTROL CABINET. REFER TO DETAIL ON SHEET E20.
- (6) PUMP MOTOR CONNECTIONS J.B.-USED AS A DEMARCATION BOX TO PROVIDE ISOLATION BETWEEN THE WET WELL AND PUMP CONTROLS. PROVIDE AND INSTALL A 12"x12"x6" NEMA 4X, STAINLESS STEEL JUNCTION BOX WITH HINGED DOOR, WIEGMANN #BN4121206CHSS. INSTALL A STAINLESS STEEL LOUVER PLATE KIT (4.75"x 4.5") ON SIDE OF BOX TO PROVIDE NATURAL ASPIRATION, WIEGMANN #WAVK0304SSA. TERMINATIONS SHALL BE MADE (TYPICAL FOR EACH CONDUCTOR) SEE SHEET E16 FOR JB DETAILS.
- PROVIDE AND INSTALL CROUSE-HINDS EYS TYPE SEALS W/CHICO COMPOUNDS.
- PROPOSED 2" PVC COATED ALUMINUM CONDUITS FOR MOTOR CONDUCTORS. INSTALL CONDUIT AS DESCRIBED IN NOTE 1 OF SHEET E4.
- PROVIDE AND INSTALL (3)-#10 XHHW-2 CU + (1)-#10 XHHW-2 CU GND + (2)-#12 XHHW-2 CU (LEAK/TEMP) IN 1" CONDUIT FOR SUBMERSIBLE PUMP POWER.
- PROVIDE AND INSTALL (3)-#14 XHHW-2 CU + (1)-#14 XHHW-2 CU GND + (1)-3/C-#18 TWISTED SHIELDED CABLE IN 1" CONDUIT FOR FLOAT AND WET WELL LEVEL TRANSMITTER.
- $\langle 11 \rangle$  NOT USED.
- PROPOSED 2" PVC COATED ALUMINUM CONDUIT FOR I&C CONDUCTORS. INSTALL CONDUIT AS DESCRIBED  $^{\prime}$  in note 2 of sheet e4.
- PROVIDE AND INSTALL 1" CONDUIT FOR ANTENNA COAXIAL CABLE REFER TO SHEET E4 and E18 FOR CONTINUATION.
- $\langle 14 \rangle$  PROVIDE AND INSTALL (3)-#3 THWN CU, (1)-#4 THWN NEU, AND (1)-#6 THWN CU GND. IN 2" CONDUIT.
- $\langle 15 \rangle$  PROVIDE AND INSTALL ALUMINUM CONDUIT STRAPS (TYPICAL).
- $\langle 16 \rangle$  NOT USED.
- $\langle 17 \rangle$  for underground raceways to wetwell the contractor shall utilize PVC coated aluminum.
- PROVIDE AND INSTALL (3)-#3 AWG + (1)-#4 NEU. IN 2" CONDUIT TO INTERCEPT EXISTING CONDUIT TO LIGHTING PANEL. SEE SHEET E4 FOR CONTINUATION.

- $\langle 19 \rangle$  provide and install an emergency connector.
- $\langle 20 \rangle$  provide and install (3)-#12 xhhw-2 cu + (1)# 12 xhhw-2 cu gnd. in 3/4" c.
- $\langle 21 \rangle$  PROVIDE AND INSTALL (26)-#12 XHHW-2 CU + (1)# 12 XHHW-2 CU GND. IN 1-1/4" C. FOR 120VAC CONTROL SIGNALS. REFER TO MCP TO PCP INTERCONNECTIONS WIRING DIAGRAM ON SHEET E11.
- $\langle 22 \rangle$  PROVIDE AND INSTALL (15)-#14 XHHW-2 CU + (1)-#14 XHHW-2 CU GND. IN 1" C. FOR 24V DC CONTROL SIGNALS, REFER TO MCP TO PCP INTERCONNECTION WIRING DIAGRAM ON SHEET E11.
- PROVIDE AND INSTALL (1)-#12 XHHW-2 CU NUE. + (1)#12 XHHW-2 CU GND. IN 3/4" CONDUIT FROM MOTOR CONTROLS PANEL TO PUMP CONTROL PANEL FOR 120V POWER CIRCUIT.
- $\langle 24 \rangle$  NOT USED.
- INSTRUMENTATION AND CONTROLS J.B.—USED AS DEMARCATION BOX TO PROVIDE ISOLATION BETWEEN THE WET WELL AND PUMP CONTROLS. PROVIDE AND INSTALL A 12"x12"x6" NEMA 4X, STAINLESS STEEL JUNCTION BOX WITH HINGED DOOR, WIEGMANN #BN4121206CHSS. INSTALL A STAINLESS STEEL LOUVER PLATE KIT (4.75"x4.5") ON SIDE OF BOX TO PROVIDE NATURAL ASPIRATION, WIEGMANN #WAVK0304SSA. TERMINATIONS SHALL BE MADE WITH UNDERGROUND WIRE CONNECTORS - IDEAL MODEL #60 -(TYPICAL FOR EACH CONDUCTOR). SEE SHEET E16 FOR JB DETAILS.
- PROVIDE DUCT SEALING COMPOUND IN ALL CONDUITS EXTENDING TO THE WET WELL.
- $\langle 27 \rangle$  PROVIDE AND INSTALL (3)-#3 XHHW-2 CU + (1)-#4 XHHW-2 CU NEU + (1)-#6 XHHW-2 CU GND IN 1-1/4" CONDUIT FOR EMERGENCY CONNECTOR.
- $\langle 28 \rangle$  provide and install a 3/4" conduit to proposed area light, (al), see sht. E18 for details.
- $\langle 29 \rangle$  provide and install a 3/4" schedule 80 pvc conduit for #4 awg grounding conductor.
- $\langle 30 \rangle$  proposed ground test well. Minimum spacing between wells 6'-0". See sheet e17 for details.
- $\langle 31 \rangle$  Provide and install water-tight / dust-tight myers hub and union (typ.).
- $\sqrt{32}$  PM1 J.B.— PROVIDE AND INSTALL A 8"x6"x3.5" NEMA 4X, STAINLESS STEEL JUNCTION BOX, ENCLOSURE 🌱 part number ej863516. see e21 for jb details.


DATE DESCRIPTION



CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

TPA2007-01M

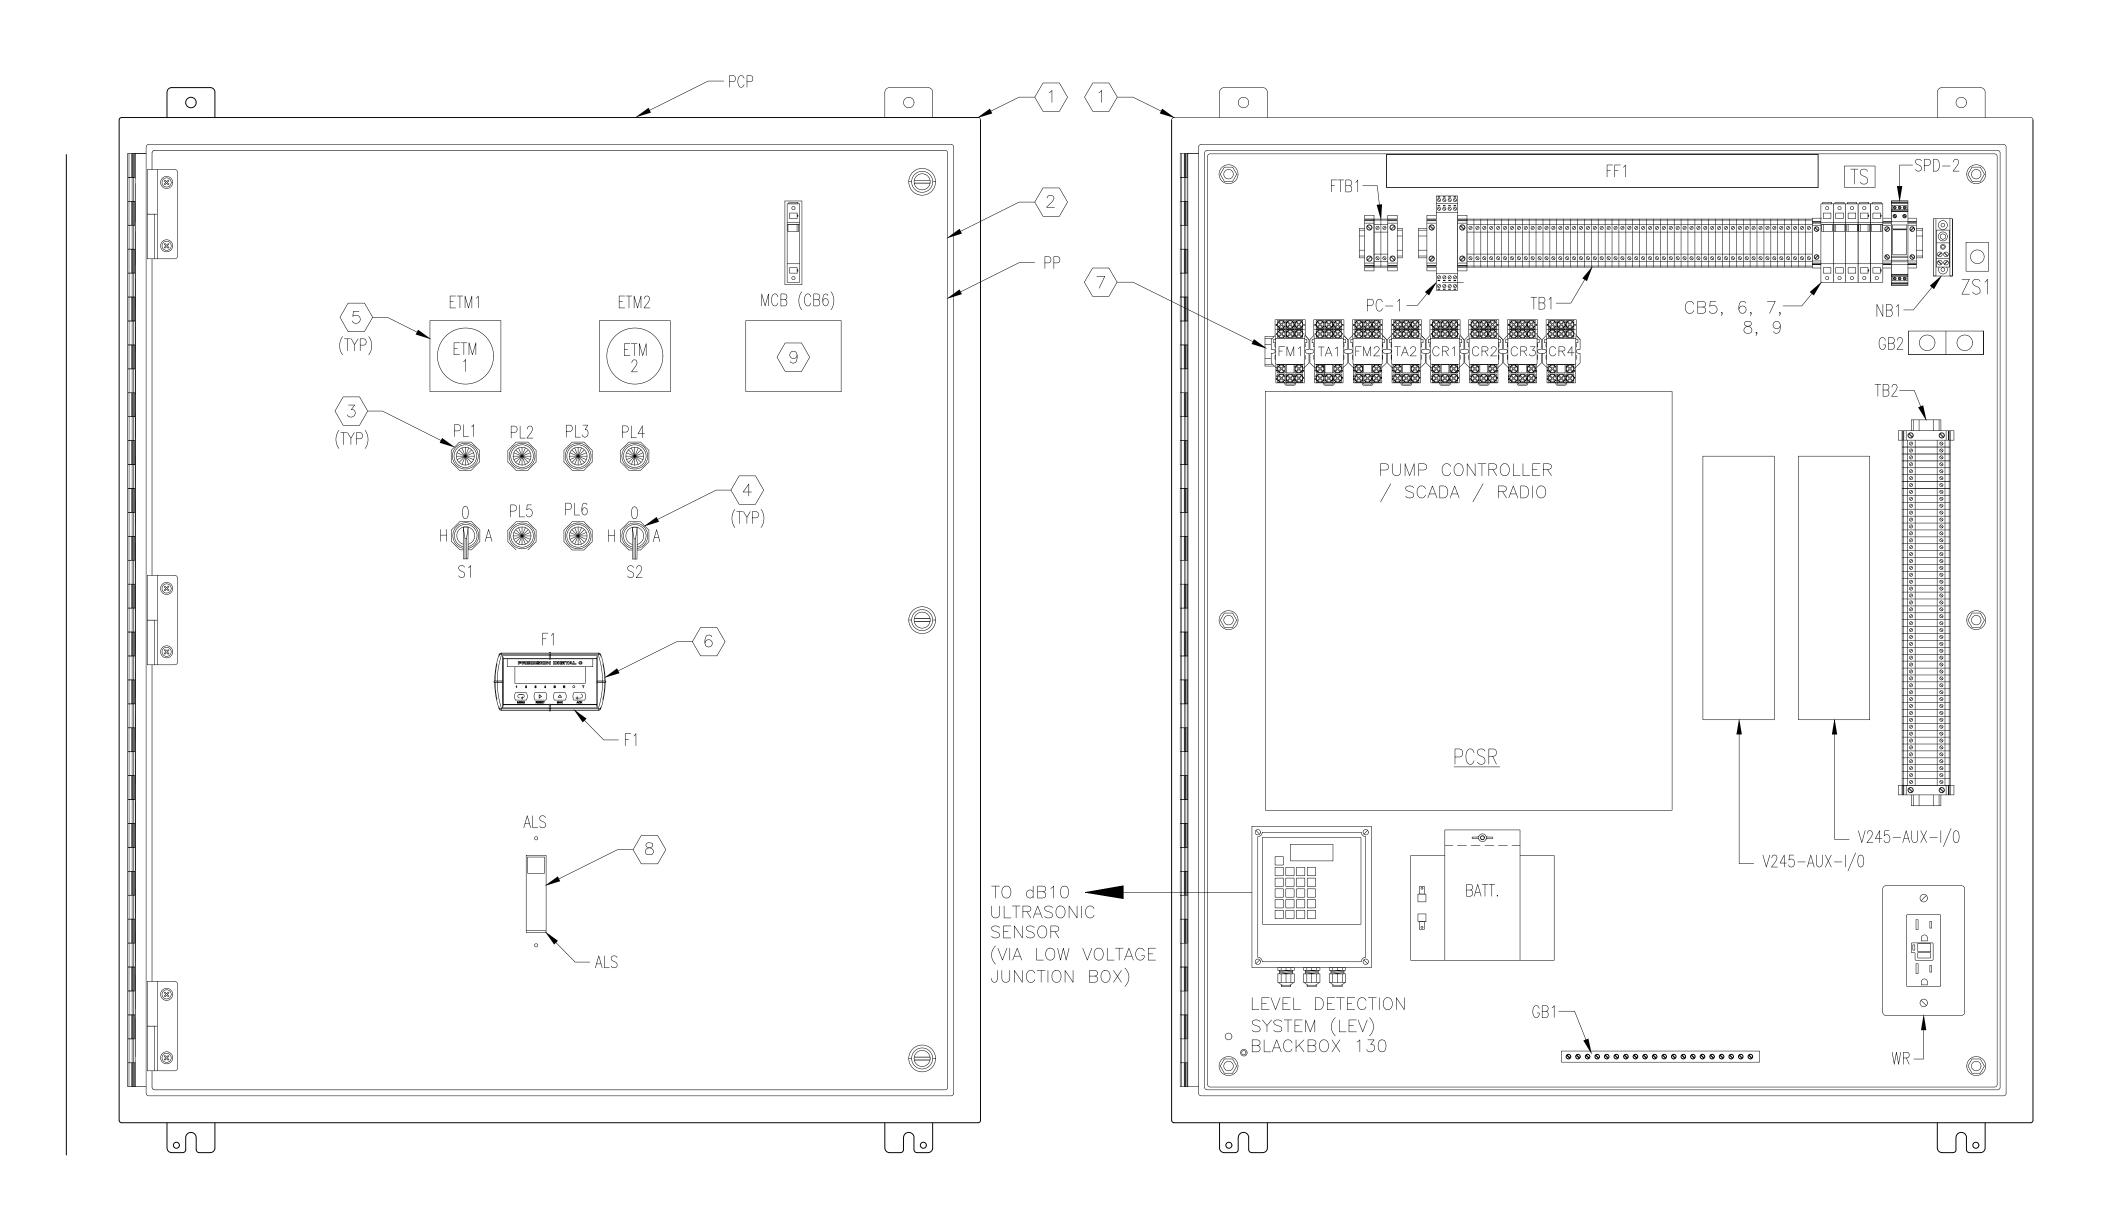

### PUMP CONTROL PANEL DETAILS

SCALE:  $1 \frac{1}{2} = 1'-0"$ 

NOTE: FRONT ENCLOSURE DOOR NOT SHOWN FOR CLARITY

PANEL INTERIOR


## LEGEND PLATE SCHEDULE

SYMBOL	DEVICE	LEGEND		
ETM1	ELAPSED TIME METER	PUMP NO. 1 HOURS		
ETM2	ELAPSED TIME METER	PUMP NO. 2 HOURS		
PL1	YELLOW PILOT LIGHT	PUMP NO. 1 ON		
PL2	RED ILLUMINATED PUSH BUTTON	PUMP NO. 1 TEMP. ALARM		
PL3	RED ILLUMINATED PUSH BUTTON	PUMP NO. 2 TEMP. ALARM		
PL4	YELOW PILOT LIGHT	PUMP NO. 2 ON		
PL5	RED PILOT LIGHT	PUMP NO. 1 SEAL LEAK ALARM		
PL6	RED PILOT LIGHT	PUMP NO. 2 SEAL LEAK ALARM		
S1	3 POSITION SWITCH	PUMP NO. 1 HAND-OFF-AUTO		
S2	3 POSITION SWITCH	PUMP NO. 2 HAND-OFF-AUTO		
MCB	PUMP CONTROL PANEL MAIN CIRCUIT BREAKER	MAIN CIRCUIT BREAKER		
F1	DIGITAL PROCESS METER	WET WELL LEVEL		
ALS	TOGGLE SWITCH	AREA LIGHT SWITCH		

#### KEYED NOTES:

- $\langle 1 \rangle$  PUMP CONTROL CABINET. 42" X 36" X 12" NEMA 4X SS, PAINTED WHITE.
- $race{2}$  provide and install aluminum deadfront door with stop kit.
- PROVIDE AND INSTALL NEW PILOT LIGHT. REFER ALSO TO PARTS SCHEDULE ON SHEET E14.
- PROVIDE AND INSTALL NEW SELECTOR SWITCH. REFER ALSO TO PARTS SCHEDULE ON SHEET E14.
- PROVIDE AND INSTALL NEW ELAPSED TIME METER. REFER ALSO TO PARTS SCHEDULE ON SHEET E14.
- PROVIDE AND INSTALL PRECISION DIGITAL PROCESS METER, MODEL PD765-6RO-10 WITH 4-20mA OUTPUT. REFER ALSO TO PARTS SCHEDULE ON SHEET E15.
- 7 PROVIDE AND INSTALL ALUMINUM DIN RAIL WHERE REQUIRED.
- PROVIDE AND INSTALL NEW SINGLE-POLE 120/277V, 20A LIGHT SWITCH TO CONTROL AREA LIGHT. REFER ALSO TO PARTS SCHEDULE ON SHEET E15.
- 9 PROVIDE WARNING LABEL ABOVE OR BELOW CB6. LABEL TO READ:
  - "WARNING: THE 120VAC SUPPLY FOR THIS PUMP CONTROL PANEL (PCP) IS FED FROM MOTOR CONTROL PANEL MCP AND WILL BE PRESENT AT THE LINE SIDE OF MCB (CB-6) LOCATED IN THIS PANEL. LOCK AND TAG OUT THE MOTOR CONTROL PANEL DISCONNECT PRIOR TO OPENING DEAD FRONT DOOR."

REV# DATE DESCRIPTION





201 North Franklin Street, Suite 1350 Tampa, FL 33602 813.882.4373 www.wadetrim.com Certificate of Authorization No.: 3952


CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION PUMP CONTROL PANEL DETAILS


90% PLANS 7-16-18
100% PLANS 11-20-18

| ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB

E19

-PLTS-PUMP CONTROL PANEL DETAILS GRECO.DWG - E19 - PLOTTED 11/20/2018

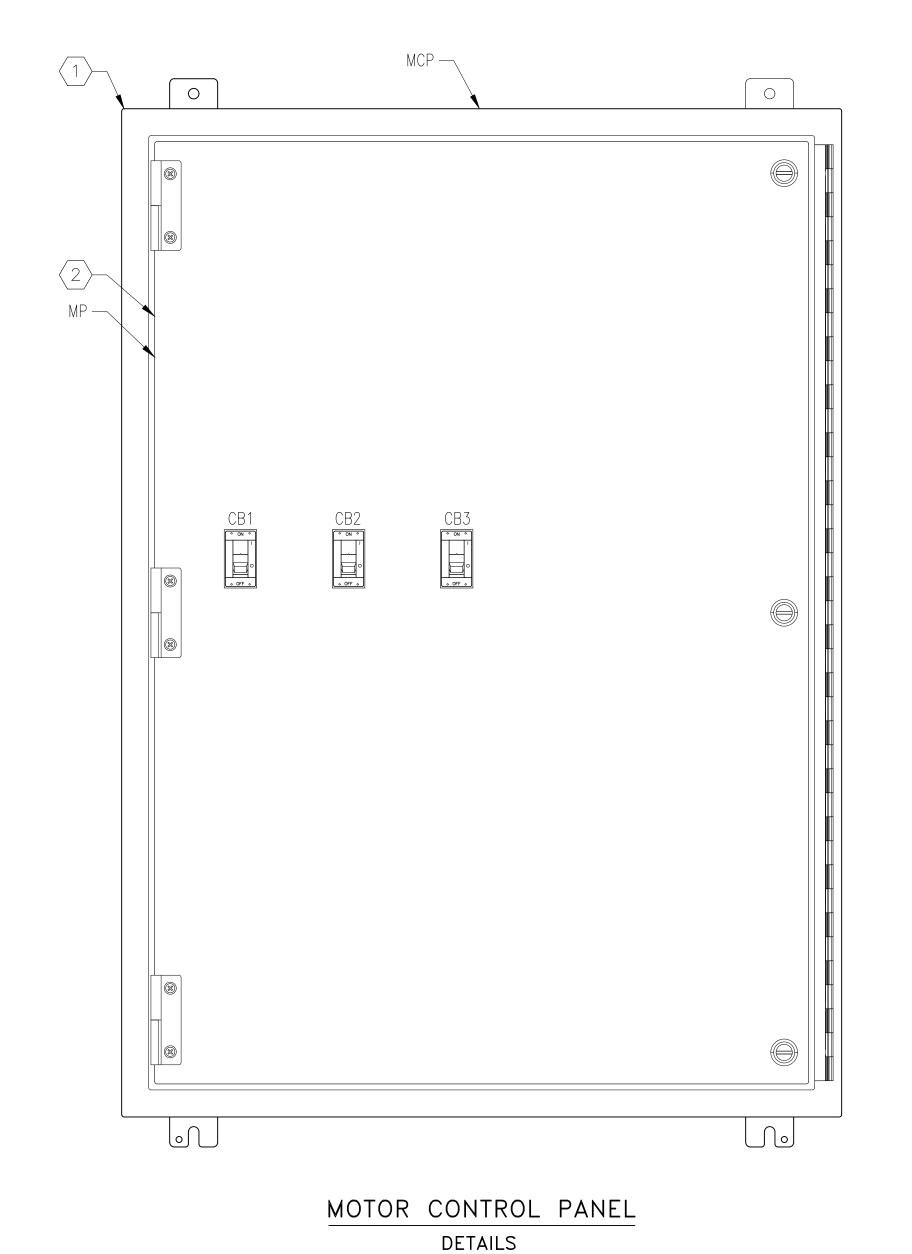

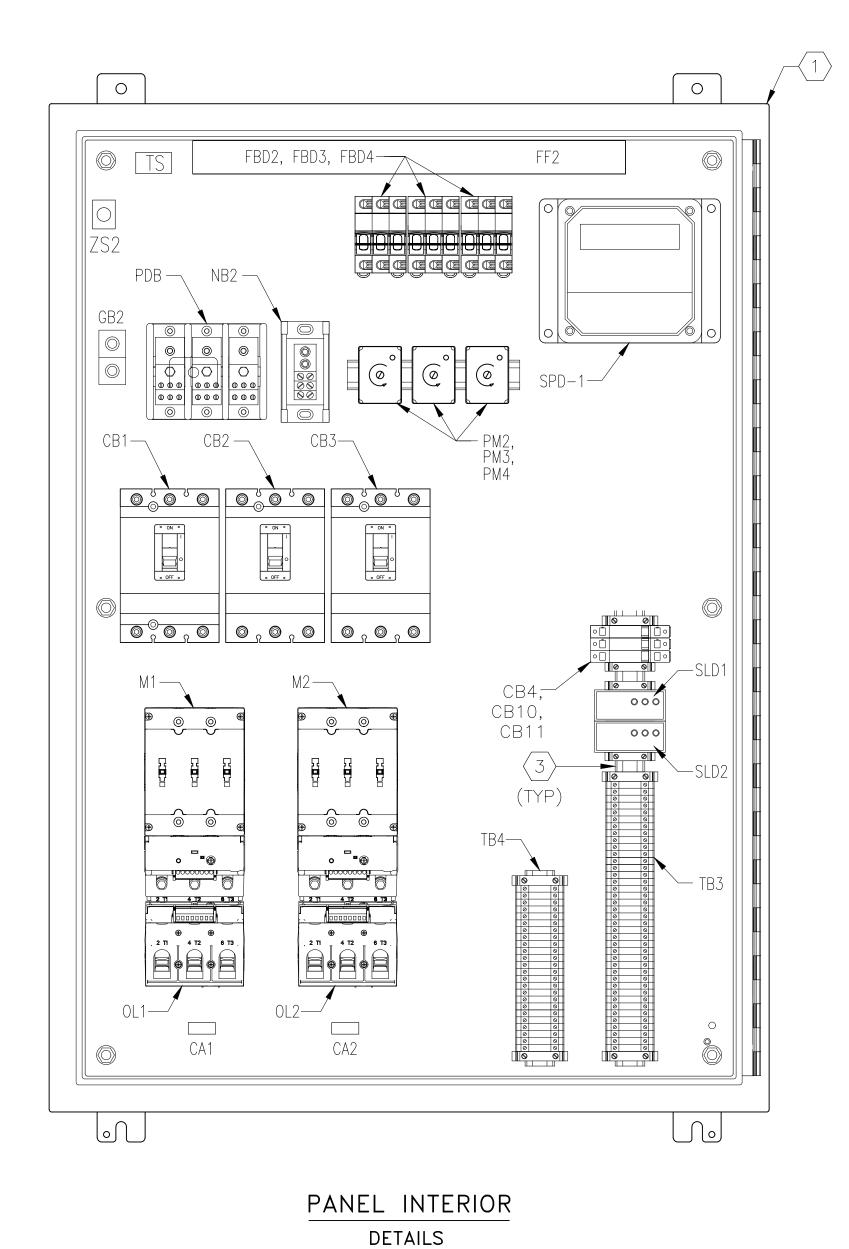

SYMBOL DEVICE LEGEND

CB1 CIRCUIT BREAKER PUMP NO. 1 CIRCUIT BREAKER

CB2 CIRCUIT BREAKER PUMP NO. 2 CIRCUIT BREAKER


CB3 CIRCUIT BREAKER SPARE CIRCUIT BREAKER


## **KEYED NOTES:**

- igg(1igg) motor control cabinet. 42" x 30" x 12" nema 4x ss, powder coat white.
- 2 PROVIDE AND INSTALL ALUMINUM DEADFRONT DOOR WITH STOP KIT.
- 3 PROVIDE AND INSTALL ALUMINUM DIN RAIL WHERE REQUIRED.
- PROVIDE WARNING LABEL ON ENCLOSURE DOOR. LABEL TO READ:

"WARNING — OPENING FUSED DOUBLE THROW SWITCH DOES NOT DE—ENERGIZE VOLTAGE TO THIS ENCLOSURE"

5 SEE SHEET E21 FOR FURTHER PM1 JUNCTION BOX DETAIL.

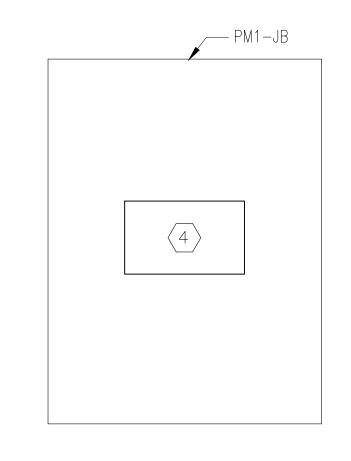


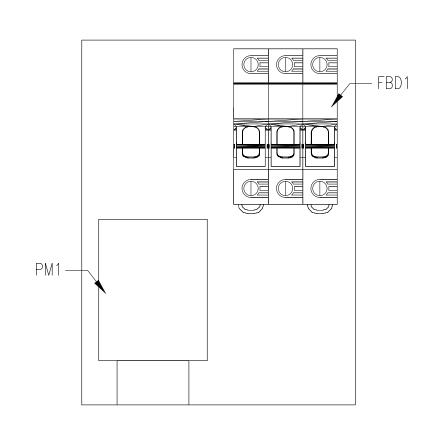

PM1 JUNCTION BOX
DETAILS 5

JUNCTION BOX INTERIOR
DETAILS 5

REV# DATE DESCRIPTION BY









CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION

MOTOR CONTROL PANEL DETAILS

ISSUED FOR: DATE: BY: 90% PLANS 7-16-18 RGB 100% PLANS 11-20-18 RGB SHEET

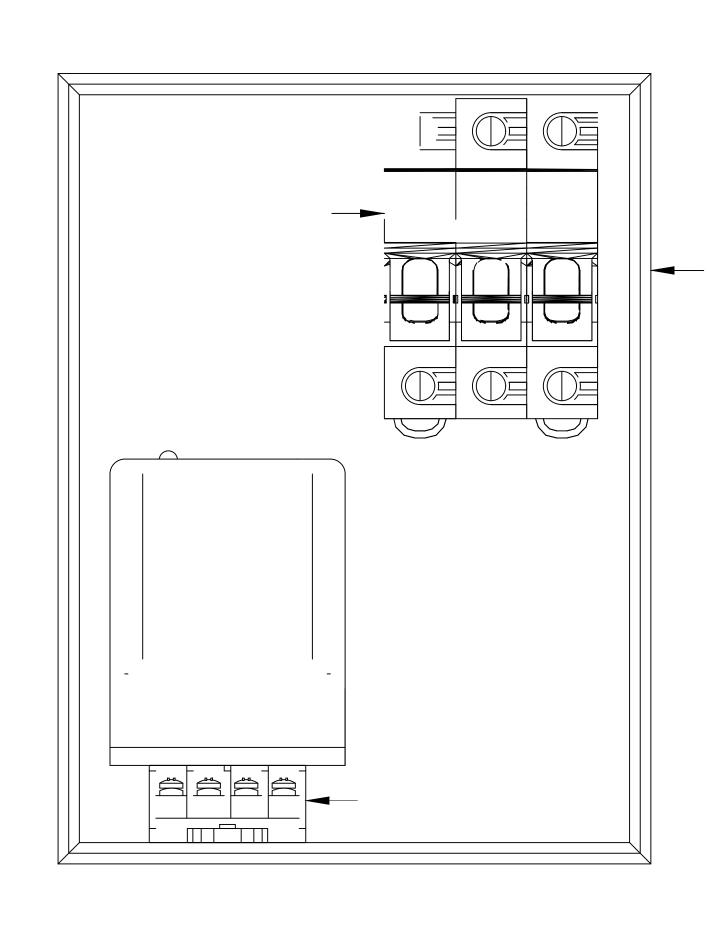

FRONT VIEW N.T.S.

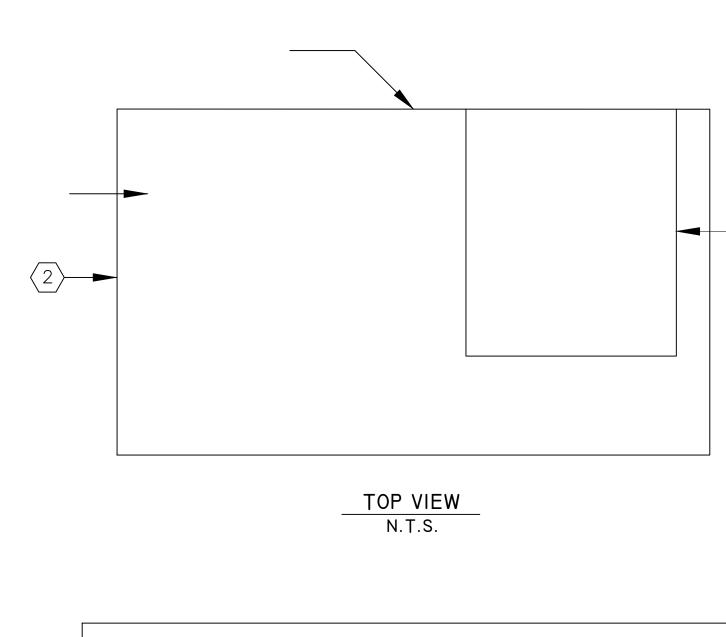


## KEYED NOTE ·


- $\langle 1 \rangle$  8 PIN OCTAL SOCKET, DIN RAIL MOUNTED OT08
- 2 NEMA 4X STAINLESS STEEL, 8"x 6"x 3.5" ENCLOSURE PART NUMBER EJ863516
- 3 3-PHASE POWER MONITOR, PM1
- 4 FUSE DISTRIBUTION BLOCK, FDB1
- 5 MOUNTED TO BOTTOM OF ENCLOSURE
- 6 DIRECTLY MOUNTED TO BACK OF ENCLOSURE
- (7) BACK OF ENCLOSURE

PM1 JUNCTION BOX DETAIL

REV# DATE DESCRIPTION BY ALAN M FLORIDA II







CITY OF TAMPA, FLORIDA GRECO PUMP STATION REHABILITATION